

Date = 06/05/23

Proposed Assembly Chart


As per DPR [Harni Dehri / Lalgarh]

Discharge = 350 LPM

Size = 200 X 150 mm ϕ

Slatted = 18 m

Assembly Size
200 X 200 mm ϕ

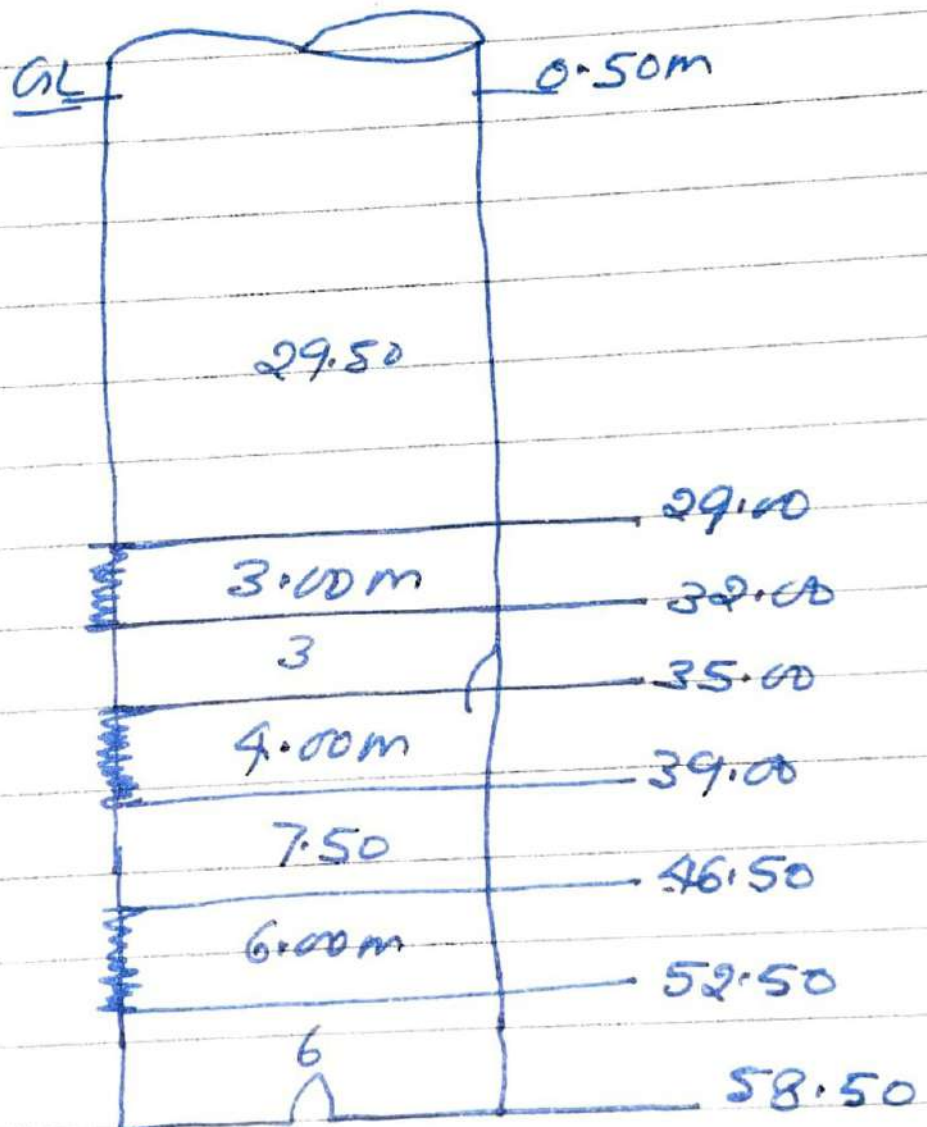



Aqua Xplore

(Groundwater Assessment & Allied Services)

243/5, New Colony Jiyamau, Hazratganj, Lucknow – 226001

Mob. 9918202546 / 9889323322, Email-aquaxploreelko@gmail.com

Advisor- Dr. R. A. Yadav, ex- Manager(Groundwater), U. P. Jal Nigam

Ref 505 - HT / AX - 2023

Date 05.05.2023

Geophysical Borehole Logging Report

Name of the site : Harne Dehra, Block – Tarwa

District : Azamgarh

Date : 05.05.2023

Depth logged : 165.0 mbgl

Depth drilled : 200.0 mbgl – as reported

Logger used : UPTRON make

Presence : Representative of M/S GAJA-SGIPL(JV), Azamgarh

Based on the interpretation of geophysical logs, following information may be deciphered, particularly with respect to salinity of the formation water;

Sl.No.	Depth range(mbgl)	Thickness(m)	Remarks
1	25.0–32.0	7.0	Good all
2	35.0–39.0	4.0	
3	46.0–53.0	7.0	

Note. All zones are intermixed with kankar. Quality of the formation water is deteriorating marginal to saline below 62.0 mbgl till depth logged.

for Aqua Xplore

CC;

M/S GAJA-SGIPL(JV), Azamgarh

ESTIMATE FOR
HARNI DEHRA GRAM PANCHAYAT WATER SUPPLY SCHEME
UNDER - JJM
BLOCK- LALGANJ, DISTRICT- AZAMGARH
Estimate of Cost of Tubewell construction

Discharge 350 LPM
Head 45 M
Drilling Depth of Tube well 275 M
Lowering of Tube well 250 M
Size of Tube well 200 x 150 mm

Sl No.	Item of work	No.	L	B	H/D	Qty	Rate	Unit	Amount	Remarks
1	DC/RC Drilling including Hiring Transportation, Erection, Dismantling with Loading and unloading of Rig and associated T&P complete in all respect including required all material labour & T&P etc.									As per RFP.
1.1	DC/RC Drilling up to 100Mtr.									
1.1.1	500 MMØ					40	2,709.57	Run	1,62,574.31	
1.1.2	450 MMØ					40	2,448.06	Run	97,922.59	
1.2	DC/RC Drilling from 101 Mtr. To 200 Mtr. Deep									
1.2.1	450 MMØ					100	2,766.83	Run	2,76,685.02	
1.2.2	Development / Flushing of tubewell						2,887.82	Hrs	-	
1.3	DC/RC Drilling from 201 Mtr. To 300 Mtr. Deep									
1.3.1	450 MMØ					75	3,150.13	Run	2,36,260.02	
1.4	Tube Well Assembly									
	MSE/WW plain pipe As per IS 4270									
1.4.1	200 MMØ					54	2,539.29	Run	1,37,121.66	
1.4.2	150 MMØ					178	1,991.60	Run	3,54,504.88	
	MSE/WW Pipe slotted pipe as per IS 4110									
1.4.3	200 MMØ					0	2,817.70	Run	-	
1.4.4	150 MMØ					38	3,067.06	Run	55,267.15	
1.5	MS fittings such as clamp, ball plug, reducer, well cap, girder & support structure									
	MS Ring-									
1.5.1	200 mm Ø MS Ring made by 150 mm x 12 mm Flat					10	1,593.28	No.	15,932.80	
1.5.2	150 mm Ø MS Ring made by 150 mm x 12 mm Flat					34	1,264.67	No.	42,998.64	
	MS Ball plug As per IS 2800									
1.5.3	150 mm Ø M.S. Ball Plug					1	1,717.76	No.	1,717.76	