



**kaarvee associates**  
multidisciplinary engineers & consultants pvt. ltd



QUALITY MANAGEMENT SYSTEM


Format No : KPTL/232223F/00023

DEPTH OF STARTA

**PROPOSED ASSEMBLY DETAILS**

Block- Nidhoul Kalan

GP- Nawali

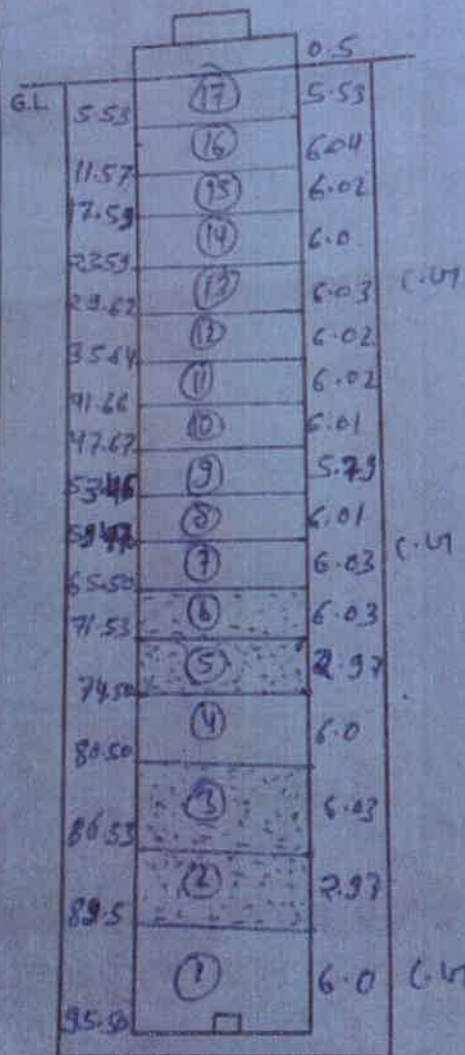

DPR Details -

Lowering Date -	13/05/2023
1. Water Discharge in LPM -	320 LPM
2. Bore well Drilling dia -	500mm
3. Bore well Drilling depth -	110mtr

**LOGGING REPORT**

Depth-	Date-	Remarks
SL. Depth Range	Thickness	
1 63-75	12mtr	
2		
3 80-92	12mtr	
4		
5		
6		
7		
8		
9		
10		
11		

**Assembly Details**

**Proposed Assembly for Lowering**

- 300mm dia MS Plain Pipe-
- 200mm dia MS Plain Pipe 78mtr
- 200mm dia MS Slotted Pipe- 12mtr
- 200mm dia LCG Pipe -
- 300/200 mm dia Reducer -
- MS Ball Plug- 1
- MS Ring 300mm-
- MS Ring 200mm- 16
- MSSI Clamp- 1
- Centre Guide - 3
- TW Assembly Support- 1
- Pea Gravel Packing-

*[Signature]*

TPI

Lowering work executed as per assembly chart

CLIENT (UPJN)