



KALPA-TARU

aarvee associates
architects engineers & consultants pvt. ltd.



QUALITY MANAGEMENT SYSTEM

Format No :

KPTL/232221F/00023

DEPTH OF STARTA

PROPOSED ASSEMBLY DETAILS

Block- Martara.

GP- Akhatauli Ratanpur.

SL. DPR Details -


1 Lowering Date - 25/10/2023

2 Water Discharge in LPM - 310

3 Bore well Drilling dia- 500 mm

Bore well Drilling depth- 100 mtr.

LOGGING REPORT

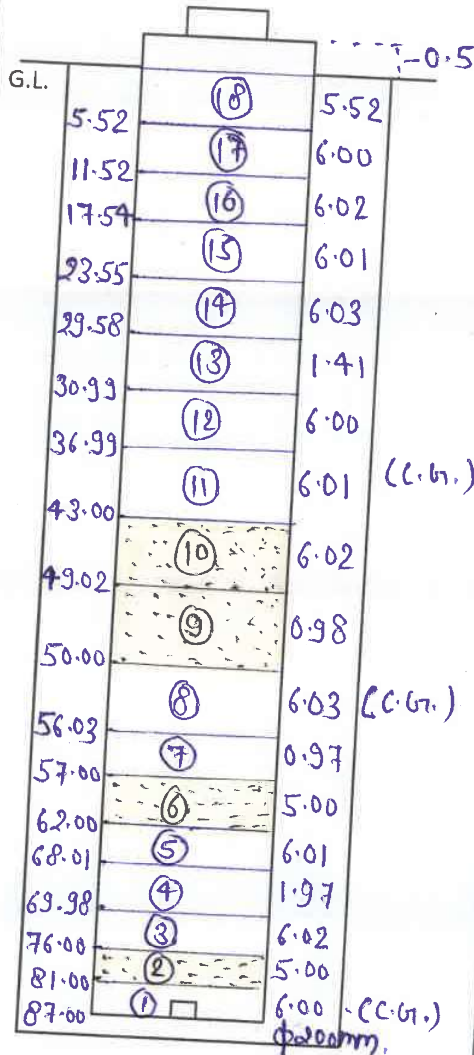

Depth- Date-

SL. Depth Range Thickness Remarks

1 43-50 07 mtr.

2

3 57-62 05 mtr.

4

5 76-81 05 mtr.

6

7

8

9

10

11

Assembly Details

Proposed Assembly for Lowering

- 300mm dia MS Plain Pipe-
- 200mm dia MS Plain Pipe - 70.50 mtr.
- 200mm dia MS Slotted Pipe- 17.00 mtr.
- 200mm dia LCG Pipe -
- 300/200 mm dia Reducer -
- MS Bail Plug- 1
- MS Ring 300mm-
- MS Ring 200mm- 17
- MSSI Clamp- 1
- Centre Guide - 3
- TW Assembly Support- 1
- Pea Gravel Packing- 16.89 cum.

Shubham
KPTL

TPI
TPI

Lowering work executed as per assembly chart.

CLIENT (UPJN)