



KALPA-TARU

vaarvee associates
architects engineers & consultants pvt. ltd.



QUALITY MANAGEMENT SYSTEM

Format No :
KPTL/232221F/00023

DEPTH OF
STARTA

PROPOSED ASSEMBLY DETAILS

Block- Aliganj
GP- Bilsasti Patti

SL.

DPR Details -

Lowering Date - 27/04/2023

1

Water Discharge in LPM - 620

2.

Bore well Drilling dia-

3.

Bore well Drilling depth- 120 MTR

LOGGING REPORT

Depth-

Date-

SL.

Depth Range

Thickness

Remarks

1

47-51

4

medium

2

3

58-73

15

medium

4

5

81-94

13

medium

6

7

8

9

10

11

Assembly Details

Proposed Assembly for Lowering

1. 300mm dia MS Plain Pipe- 42 MTR.

2. 200mm dia MS Plain Pipe 30.80 MTR.

3. 200mm dia MS Slotted Pipe- 27 MTR.

4. 200mm dia LCG Pipe -

5. 300/200 mm dia Reducer - 01 nos.

6. MS Bail Plug- 01 nos.

7. MS Ring 300mm- 06 nos.

8. MS Ring 200mm- 10 nos.


9. MSSl Clamp- 01 nos.

10. Centre Guide - 03 nos.

11. TW Assembly Support- 01 nos.

12. MS Well Cap 01 nos.

13. Pea Gravel Packing- 21.04 m³.

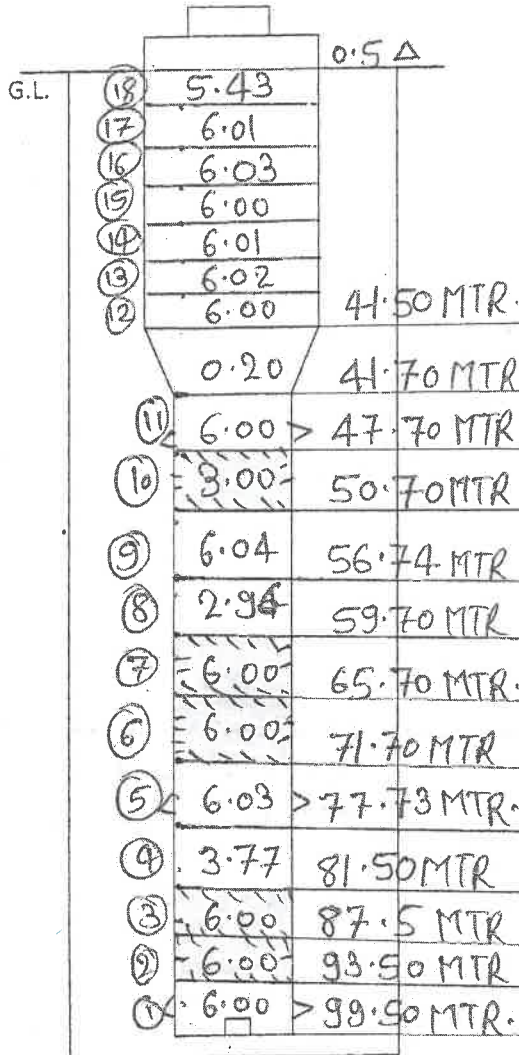

Sunil Kumar Yadav
KPTL

Pratibha
TPI

Lowering work
executed as per
assembly chart

CLIENT (UPJN)