



KALPA-TARU

kaarvee associates
architects engineers & consultants pvt. ltd




QUALITY MANAGEMENT SYSTEM
Format No :
KPTL/232221F/00023

DEPTH OF STARTA

PROPOSED ASSEMBLY DETAILS

Block- Mashura.
GP- Khangarpur daulapuri.

SL.	DPR Details -
	Lowering Date - <u>4/10/2023</u>
1.	Water Discharge in LPM - <u>450</u>
2.	Bore well Drilling dia- <u>500mm</u>
3.	Bore well Drilling depth- <u>110 mtr.</u>

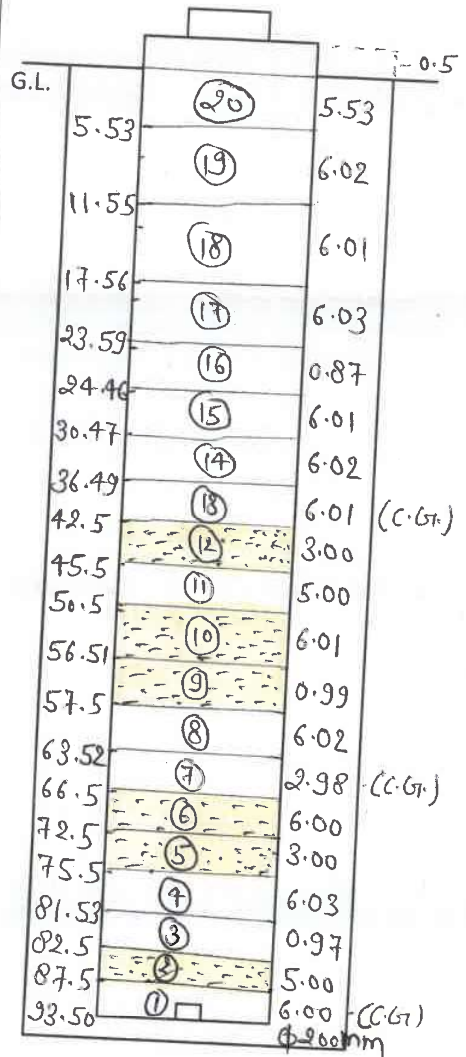

LOGGING REPORT

SL.	Depth Range	Thickness	Remarks
1	42-46	4 mtr.	
2			
3	50-58	8 mtr.	
4			
5	66-76	10 mtr.	
6			
7	82-88	6 mtr.	
8			
9			
10			
11			

Assembly Details

Proposed Assembly for Lowering

- 300mm dia MS Plain Pipe-
- 200mm dia MS Plain Pipe - 70mtr.
- 200mm dia MS Slotted Pipe- 24
- 200mm dia LCG Pipe -
- 300/200 mm dia Reducer -
- MS Bail Plug- 1
- MS Ring 300mm-
- MS Ring 200mm- 19
- MSSI Clamp- 1
- Centre Guide - 3
- TW Assembly Support- 1
- Pea Gravel Packing- 18.64 cum.

Shubham
KPTL

प्रीत
TPI

CLIENT (UPJN)

Lowering work executed as per assembly detail