



KALPA-TARU

daivee associates
architects engineers & consultants pvt. ltd.



QUALITY MANAGEMENT SYSTEM
Format No :
KPTL/232221F/00023

DEPTH OF STARTA

PROPOSED ASSEMBLY DETAILS

Block- Aliganj.

GP- Laximpur Katara.

SL. DPR Details -

- 1 Lowering Date - 13/06/2023.
- 2 Water Discharge in LPM - 280 LPM.
- 3 Bore well Drilling dia- 500 mm φ
- 3. Bore well Drilling depth- 100 MTR.


LOGGING REPORT

Depth-		Date-		Remarks
SL.	Depth Range	Thickness		
1	<u>49-60</u>	<u>11</u>		<u>Medium Sand.</u>
2	<u>70-83</u>	<u>13</u>		<u>Medium Sand.</u>
3				
4				
5				
6				
7				
8				
9				
10				
11				

Assembly Details

Proposed Assembly for Lowering

- 1. 300mm dia MS Plain Pipe -
- 2. 200mm dia MS Plain Pipe 71.00 MTR.
- 3. 200mm dia MS Slotted Pipe- 18.00 MTR.
- 4. 200mm dia LCG Pipe -
- 5. 300/200 mm dia Reducer -
- 6. MS Bail Plug- 01 nos.
- 7. MS Ring 300mm- 14 nos.
- 8. MS Ring 200mm- 01 nos.
- 9. MSSJ Clamp- 03 nos.
- 10. Centre Guide - 01 nos.
- 11. TW Assembly Support- 01 nos.
- 12. MS Well Cap - 01 nos.
- 13. Pea Gravel Packing-

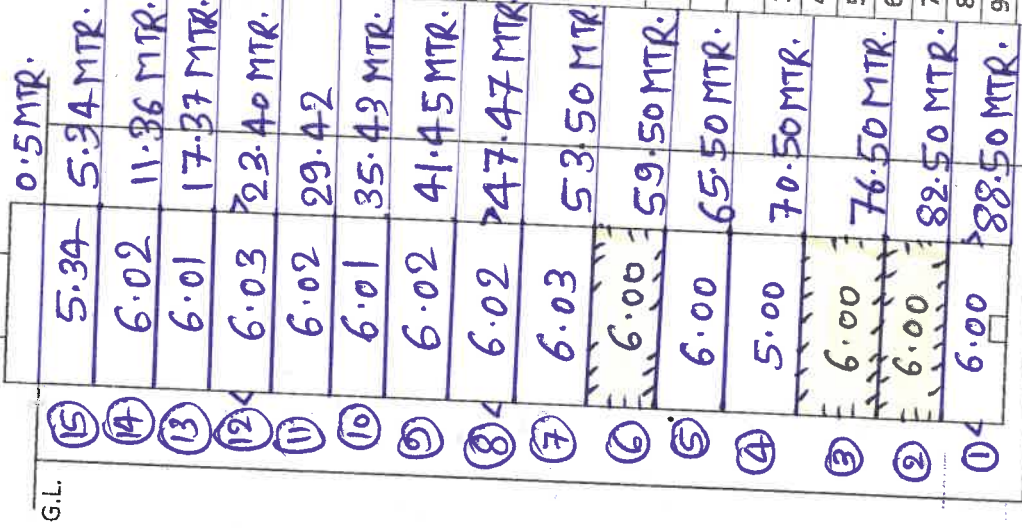

Sunil Kumar Yadav.
KPTL

TPI
TPI

Lowering work executed as per assembly chart.

CLIENT (UPJN)