

LOA No. : 3107/M-27/(Dev Patan)/2022-23, Dt. 04.11.2022.
 PROJECT : State Water & Sanitation Mission (SWSM) Under Jal Jeevan Mission (JJM).
 NAME OF WORK : Rural Water Supply Project
 EXECUTING AGENCY : M/S-GA Infra -VPL JV
 COVER AGREEMENT : 48/ED/PHASE-5/22-23/II(DA)TED-03.04.23
 NAME OF THE SCHEME : BAMPURWA
 GRAM PANCHAYAT : BAMPURWA
 NAME OF THE BLOCK : MIHPURWA
 DISTRICT : BAHARICH
 TRIPARTITE AGREEMENT : JJM/UP/Phase5/Baharich/GA Infra-VPLJV/3202/109 Dt. 28.02.23
 RA BILL NO : BAMPURWA # RA-07, DATE : 15/06/2024

(ANNEXURE-I)

BOQ Item No	Description of items	UOM	% of Claim	Quoted/Accepted rate @ -0.10%	BOQ			Previous Claim			Present Claim			Cumulative Claim			Remarks
					Qty	Claim Wise BOQ Qty	Amount	Qty	Amount	Qty	Amount	Qty	Amount	Qty	Amount		
1.00	SURVEY	(3)	(4)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)	(16)	(17)		
1.01	All the works including Hydrological survey, topographical survey, Design charges including preparation and approval of DPR	LS	100%	3,03,914.08	1.00	1.00	3,03,914.08	3,03,914.08	1.00	3,03,851.64	1.00	-	1.00	3,03,851.64			
2.04	Tube well construction DC/RC Drilling up to 100Mtr.	Mtr.	100%	2,515.37	100.00	100.00	2,51,537.00	2,51,537.00	100.00	2,51,537.00	100.00	-	100.00	2,51,537.00			
3.06	DC/RC Drilling from 101 Mtr. To 200 Mtr. Deep	Mtr.	100%	2,291.91	5.00	5.00	11,459.55	11,459.55	32.00	73,341.12	32.00	-	32.00	73,341.12			
2.08	DC/RC Drilling from 201 Mtr. To 300 Mtr. Deep	Mtr.	100%	2,914.03	95.00	95.00	2,78,732.85	2,78,732.85	68.00	1,99,514.04	68.00	-	68.00	1,99,514.04			
2.10	DC/RC Drilling from 201 Mtr. To 300 Mtr. Deep	Mtr.	100%	2,994.13	100.00	100.00	2,99,413.00	2,99,413.00	100.00	2,99,413.00	100.00	-	100.00	2,99,413.00			
3.02	MSEWR plain pipe-As per IS 4370	Mtr.	70%	1,998.00	203.00	203.00	4,05,594.00	4,05,594.00	203.00	2,83,915.80	19,822	-	183.18	2,83,915.80			
3.04	MSEWR plain pipe-As per IS 4370	Mtr.	5%	1,998.00	203.00	203.00	4,05,594.00	4,05,594.00	203.00	2,83,915.80	183.18	-	183.18	2,83,915.80			
3.06	MSEWR plain pipe-As per IS 4370	Mtr.	20%	3,996.01	42.00	42.00	1,67,412.42	1,67,412.42	42.00	1,17,188.69	0.12	-	42.12	1,17,188.69			
3.08	MSEWR plain pipe-As per IS 4370	Mtr.	5%	3,996.01	42.00	42.00	1,67,412.42	1,67,412.42	42.00	1,17,188.69	42.12	-	42.12	1,17,188.69			
3.10	MSEWR Pipe slotted pipe as per IS 8110	Mtr.	70%	3,076.92	30.00	30.00	92,307.60	92,307.60	30.00	64,615.32	30.00	-	30.00	64,615.32			
3.12	MSEWR Pipe slotted pipe as per IS 8110	Mtr.	20%	3,076.92	30.00	30.00	92,307.60	92,307.60	30.00	64,615.32	30.00	-	30.00	64,615.32			
3.14	MSEWR Pipe slotted pipe as per IS 8110	Mtr.	5%	3,076.92	30.00	30.00	92,307.60	92,307.60	30.00	64,615.32	30.00	-	30.00	64,615.32			
3.16	MS Ring	No.	70%	1,268.73	39.00	39.00	49,480.47	49,480.47	39.00	34,636.33	4.00	-	35.00	34,636.33			
3.18	MS Ring	Mtr.	20%	1,268.73	39.00	39.00	49,480.47	49,480.47	39.00	34,636.33	35.00	-	35.00	34,636.33			
3.20	MS Ring	Mtr.	5%	1,268.73	39.00	39.00	49,480.47	49,480.47	39.00	34,636.33	35.00	-	35.00	34,636.33			
3.22	300 mm ø MS Ring made by 175 mm x 16 mm Flat	No.	70%	2,067.93	7.00	7.00	14,475.51	14,475.51	7.00	10,132.86	7.00	-	7.00	10,132.86			
3.24	300 mm ø MS Ring made by 175 mm x 16 mm Flat	Mtr.	20%	2,067.93	7.00	7.00	14,475.51	14,475.51	7.00	10,132.86	7.00	-	7.00	10,132.86			
3.26	300 mm ø MS Ring made by 175 mm x 16 mm Flat	Mtr.	5%	2,067.93	7.00	7.00	14,475.51	14,475.51	7.00	10,132.86	7.00	-	7.00	10,132.86			
3.28	MS Ball plug As per IS 2800	No.	70%	1,723.28	1.00	1.00	1,723.28	1,723.28	1.00	1,206.30	1.00	-	1.00	1,206.30			
3.30	MS Ball plug As per IS 2800	Mtr.	20%	1,723.28	1.00	1.00	1,723.28	1,723.28	1.00	1,206.30	1.00	-	1.00	1,206.30			
3.32	MS Ball plug As per IS 2800	Mtr.	5%	1,723.28	1.00	1.00	1,723.28	1,723.28	1.00	1,206.30	1.00	-	1.00	1,206.30			
3.34	Reducer	No.	70%	5,494.50	1.00	1.00	5,494.50	5,494.50	1.00	3,846.15	1.00	-	1.00	3,846.15			
3.36	Reducer	Mtr.	20%	5,494.50	1.00	1.00	5,494.50	5,494.50	1.00	3,846.15	1.00	-	1.00	3,846.15			
3.38	Reducer	Mtr.	5%	5,494.50	1.00	1.00	5,494.50	5,494.50	1.00	3,846.15	1.00	-	1.00	3,846.15			
3.40	MSS Climp-As per IS 2800	No.	70%	4,045.95	1.00	1.00	4,045.95	4,045.95	1.00	2,832.17	1.00	-	1.00	2,832.17			
3.42	MSS Climp-As per IS 2800	Mtr.	20%	4,045.95	1.00	1.00	4,045.95	4,045.95	1.00	2,832.17	1.00	-	1.00	2,832.17			
3.44	MSS Climp-As per IS 2800	Mtr.	5%	4,045.95	1.00	1.00	4,045.95	4,045.95	1.00	2,832.17	1.00	-	1.00	2,832.17			
3.46	TW Assy Support	No.	70%	17,482.50	1.00	1.00	17,482.50	17,482.50	1.00	12,237.75	1.00	-	1.00	12,237.75			
3.48	TW Assy Support	Mtr.	20%	17,482.50	1.00	1.00	17,482.50	17,482.50	1.00	12,237.75	1.00	-	1.00	12,237.75			
3.50	TW Assy Support	Mtr.	5%	17,482.50	1.00	1.00	17,482.50	17,482.50	1.00	12,237.75	1.00	-	1.00	12,237.75			
3.52	MS Well Cap	No.	70%	1,548.45	1.00	1.00	1,548.45	1,548.45	1.00	1,083.92	1.00	-	1.00	1,083.92			
3.54	MS Well Cap	Mtr.	20%	1,548.45	1.00	1.00	1,548.45	1,548.45	1.00	1,083.92	1.00	-	1.00	1,083.92			
3.56	MS Well Cap	Mtr.	5%	1,548.45	1.00	1.00	1,548.45	1,548.45	1.00	1,083.92	1.00	-	1.00	1,083.92			



Signature

JUNIOR ENGINEER
U.P. JAL...

NAME OF THE SCHEME : RAMPURWA
GRAM PANCHAYAT : RAMPURWA
NAME OF THE BLOCK : MIHIPURWA
DISTRICT : BAHARICH
TRIPARTITE AGREEMENT : JIM/JUP/Phases/Baharich/GA Infra-VPL/JV/3202/109 Dt. 28.02.23
RA BILL NO : RAMPURWA # BA-07, DATE : 15/06/2024
LOA No. : 3207/N/27/Bent Patam/2022-23, Dt. 04.11.2022
PROJECT : State Water & Sanitation Mission (SWSM) Under Jal Jeevan Mission (JJM)
NAME OF WORK : Rural Water Supply Project
EXECUTING AGENCY : M's GA Infra - VPL JV
COVER AGREEMENT : 48/ED/PHASE5/22-23/III DATED-03.04.23

(ANNEXURE-I)

BOQ Item No	Description of Items	UOM	% of Claim	Quoted/Accepte d rate @ -0.10%	BOQ			Previous Claim		Present Claim		Cumulative Claim		Remarks	
					Qty	Claim Wise BOQ Qty	Amount	Qty	Amount	Qty	Amount	Qty	Amount		
11	[2]	[3]	[4]	[6]	[7]	[8]	[9]	[10]	[11]	[12]	[13]	[14]	[15]	[16]	[17]
33.00	Supply of following sizes pipes for distribution system conforming to latest/relevant I.S. 4994/1995 Specifications with all joining materials and specials conforming to latest/relevant I.S. specifications including F.O.R. destination and all taxes and insurance etc. with loading unloading and Carting up to site of work also including specials for these pipes and lowering them into the trenches and laying true to alignment and gradient and jointing etc. complete (including testing of pipe lines and cutting of pipes for making up the length but excluding the cost of trenches) all complete as per instructions to Engineer-in-charge.	Rmt	70%	253.75	1,509.00	3,82,908.75	2,68,036.13	1,509.00	1,509.00	2,68,036.13	1,509.00	2,68,036.13	1,509.00	2,68,036.13	
33.01	90mm dia HDPE Pipe PN-6; Class PE-100	Rmt	70%	253.75	1,509.00	3,82,908.75	2,68,036.13	1,509.00	1,509.00	2,68,036.13	1,509.00	2,68,036.13	1,509.00	2,68,036.13	
33.02	75mm dia HDPE Pipe PN-6; Class PE-100	Rmt	70%	289.81	728.00	1,36,181.68	96,727.18	728.00	728.00	96,727.18	728.00	96,727.18	728.00	96,727.18	
33.03	63mm dia HDPE Pipe PN-6; Class PE-100	Rmt	70%	145.86	13,129.00	19,14,995.94	13,40,497.16	13,129.00	13,129.00	13,40,497.16	13,129.00	13,40,497.16	13,129.00	13,40,497.16	
33.04	110mm dia HDPE Pipe PN-6; Class PE-100	Rmt	70%	368.64	985.00	3,65,110.40	2,54,177.28	985.00	985.00	2,54,177.28	985.00	2,54,177.28	985.00	2,54,177.28	
33.09	200mm dia HDPE Pipe PN-6; Class PE-100	Rmt	70%	1,137.86	1,019.00	11,59,480.36	8,11,636.25	1,019.00	1,019.00	8,11,636.25	1,019.00	8,11,636.25	1,019.00	8,11,636.25	
3	Purchasing of DG set of 30 KVA	Nos.	70%	4,05,000.00	1.00	4,05,000.00	2,83,500.00	1.00	1.00	2,83,500.00	1.00	2,83,500.00	1.00	2,83,500.00	
	Interim Payment														
	Total Amount					3,11,81,895.00	3,11,81,895.00			54,53,290.68		21,00,370.20		75,53,660.88	



Signature

JUNIOR ENGINEER
 DIVISION OFFICE (EIM)
 U.P. JAL NIGAM RURAL GONDA



**AKD GEOMINING SOLUTIONS
(OPC) PRIVATE LIMITED**

Geological, Geophysical & Planning Services for Mineral Exploration

CIN: U74999JH2017OPC010587

PAN: AAQCA1398C

TAN: RCHA02735F

Mob: +91 8969701960

GEOPHYSICAL DIGITAL LOGGING REPORT

SITE: RAMPURVA **DATE OF LOGGING:** 23.01.2024
BLOCK: MIHINPURWA **DRILLING DEPTH:** 300 m
DISTRICT: BAHRATICH **LOGGING DEPTH:** 300 m
STATE: UTTAR PRADESH **LOGGING COMPANY:** SHIV DRILLERS
LONGITUTDE 81.19833 **LOG PROCESSED BY:** AKDGSPL
LATITUDE 28.23727

Based on the downhole geophysical parameters following information (in terms of granular zones) may be deciphered

Sl. No.	Depth		Thickness (m)	INFERRED LITHOLOGY	Remark (Quality of Aquifer Water)
1	0	12	12	TOP SOIL	
2	12	37	25	COARSE TO MEDIUM SAND	GOOD
3	37	44	7	SANDY CLAY	
4	44	53	9	MEDIUM SAND	GOOD
5	53	68	15	COARSE TO MEDIUM SAND	GOOD
6	68	116	48	FINE TO MEDIUM SAND	GOOD
7	116	156	40	COARSE TO MEDIUM SAND	GOOD
8	156	167 ✓	11	SANDY CLAY	
9	167	226 ✓	59	COARSE TO MEDIUM SAND	GOOD
10	226	250 ✓	24	COARSE SAND	GOOD
11	250	252	2	FINE SAND	GOOD
12	252	278	26	COARSE SAND	GOOD
13	278	282	4	SANDY CLAY	
14	282	300	18	COARSE SAND	GOOD

NOTE:- 1. ALL zones have intermixed with thin band of kankar

AKD GEOMINING SOLUTIONS
(OPC) PRIVATE LIMITED

[Signature]
Director

Authorized Signatory

AKD GEOMINING SOLUTIONS (OPC) PRIVATE LIMITED

Office: Mahananda Apartment, Lake Avenue, Kanke Road, Ranchi - 834008, Jharkhand
 Geology | Mining | Geophysics | Ground Water | Engineering & Environmental Investigation
 Down Hole Geophysics | Hydrogeology | Expln. & Mining Project Management


Sen

[Signature]
JUNIOR ENGINEER
DIVISION OFFICE (E/M)
U.P. JAL NIGAM RURAL GONDA



GA INFRA- VISHWANATH PROJECTS LIMITED

ACTUAL STRATA CHART & TUBEWELL ASSEMBLY OF RAMPURWA W/S SCHEME, BLOCK-MIHIPURWA , DISTRICT- BAHAIRACH

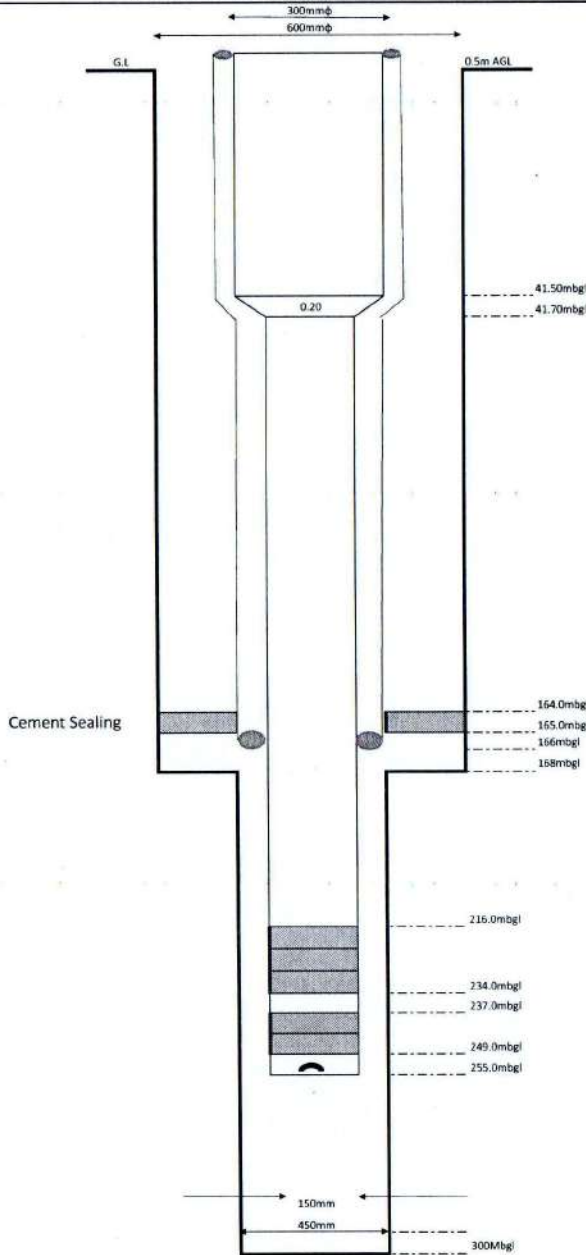

1	Bore Size	600 X 450 mm
2	Assembly Size	300 X 150 mm
3	Drilling Depth	300 Mbgl
4	Logging Depth	300.00Mbgl
5	Date of Logging	23.01.2024
6	Required Discharge	1070LPM/45m
7	Date of Lowering	25.01.2024

LOGGING REPORT-

Sl. No.	Depth Range(mbgl)		Inferred Lithology	Thickness(m)	Remark
	From (m)	To (M)			
1	0	12	TOP SOIL	12.0	
2	12	37	COARSE TO MEDIUM SAND	25.0	GOOD
3	37	44	SANDY CLAY	7.0	
4	44	53	MEDIUM SAND	9.0	GOOD
5	53	68	COARSE TO MEDIUM SAND	15.0	GOOD
6	68	116	FINE TO MEDIUM SAND	48.0	GOOD
7	116	156	COARSE TO MEDIUM SAND	40.0	GOOD
8	156	167	SANDY CLAY	11.0	
9	167	226	COARSE TO MEDIUM SAND	59.0	GOOD
10	226	250	COARSE SAND	24.0	GOOD
11	250	252	FINE SAND	2.0	GOOD
12	252	278	COARSE SAND	26.0	GOOD
13	278	282	SANDY CLAY	4.0	
14	282	300	COARSE SAND	18.0	GOOD

Note:-

Sl. No.	Descriptions	Length(m)	Remarks
1	300mmφ Housing Pipe	42.00	
2	150mmφ Plain Pipe	183.70	
3	150mm Slotized Pipe	30.00	
Total Assembly		255.50	
Less AGL		0.50	
TOTAL BGL		255.00	

Handwritten signature/initials



Handwritten signature
 JUNIOR ENGINEER
 DIVISION OFFICE (E/M)
 U.P. IAL NIGAM RURAL GONDA


(AE, UPJN(RURAL) E&M GONDA

(EE, UPJN(RURAL) E&M GONDA)



GA INFRA- VISHWANATH PROJECTS LIMITED

ACTUAL STRATA CHART & TUBEWELL ASSEMBLY OF RAMPURWA W/S SCHEME, BLOCK-MIHIPURWA, DISTRICT-BAHRAICH

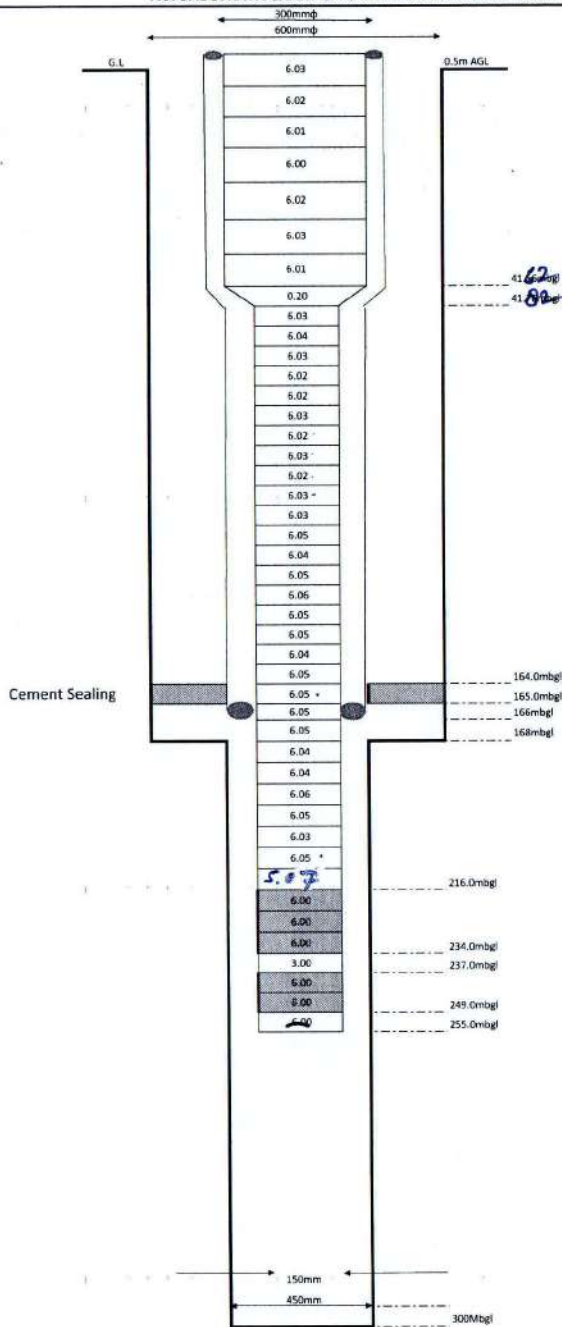

1	Bore Size	600 X 450 mm
2	Assembly Size	300 X 150 mm
3	Drilling Depth	300 Mbgl
4	Logging Depth	300.00Mbgl
5	Date of Logging	23.01.2024
6	Required Discharge	1070LPM/45m
7	Date of Lowering	25.01.2024

LOGGING REPORT-

Sl. No.	Depth Range (mbgl)		Inferred Lithology	Thickness (m)	Remark
	From (m)	To (M)			
1	0	12	TOP SOIL	12.0	
2	12	37	COARSE TO MEDIUM SAND	25.0	GOOD
3	37	44	SANDY CLAY	7.0	
4	44	53	MEDIUM SAND	9.0	GOOD
5	53	68	COARSE TO MEDIUM SAND	15.0	GOOD
6	68	116	FINE TO MEDIUM SAND	48.0	GOOD
7	116	156	COARSE TO MEDIUM SAND	40.0	GOOD
8	156	167	SANDY CLAY	11.0	
9	167	226	COARSE TO MEDIUM SAND	59.0	GOOD
10	226	250	COARSE SAND	24.0	GOOD
11	250	252	FINE SAND	2.0	GOOD
12	252	278	COARSE SAND	26.0	GOOD
13	278	282	SANDY CLAY	4.0	
14	282	300	COARSE SAND	18.0	GOOD

Note:-

Sl. No.	Descriptions	Length (m)	Remarks
1	300mm ϕ Housing Pipe	42.22	
2	150mm ϕ Plain Pipe	183.18	
3	150mm Slotted Pipe	30.00	
4	300mm \times 150mm Radius	0.20	
Total Assembly		255.50	
Less AGL		0.50	
TOTAL BGL		255.00	



GA INFRA-VISHWANATH P. LTD.

Su
 (JE, UPJN(RURAL) E&M GONDA)
 JUNIOR ENGINEER

(AE, UPJN(RURAL) E&M GONDA)

(EE, UPJN(RURAL) E&M GONDA)

DIVISION OFFICE (E&M)
 U.P. JAL NIGAM RURAL GONDA



GA INFRA- VISHWANATH PROJECTS LIMITED

TEST REPORT OF DEVELOPMENT OF TUBEWELL BY 600 PSI AIR COMPRESSOR UNDER J.J.M PROGRAMME

1. G.P NAME - RAMPURWA

6. AIR LINE LOWERED - 246 MTR

2. BLOCK- MIHIPURWA

7. DISCHARGE MEASURED BY- M.S 90° V-NOTCH TANK

3. DATE OF TESTING - 14.03.2024

8. DEPTH OF TUBEWELL- 255.00 MTR

4. T.W SIZE - 300X150 MM

9. REQUIRED DICHARGE - 1070 Lpm

5. S.W.L- 3.50 MTR

SR.NO	DEPTH OF AIR LINE LOWERED		DISCHARGE WATER HEAD 90° V-NOTCH TANK		STARTING PRESSURE IN KGF/CM ²	RUNNING PRESSURE IN KGF/CM ²	DEPRESSION		SAND CONTENT IN PPM				REMARK	
	IN MTR	IN MM	IN MM	IN LPM			IN KGF/CM ²	MTR	STARTING	5 MIN	10 MIN	15 MIN		20 MIN
1	246	250	250	2624	24.50	23.50	1.0	10	6,000	3,300	2,200	1,500	700	

NOTE: RECOMMENDED FOR DEVELOPMENT OF T.W BY O.P UNIT.

TEST CONDUCTED IN PRESENCE OF BY.



[Handwritten Signature]
T.P.

[Handwritten Signature]
Junior Engineer

JUNIOR ENGINEER
DIVISION OFFICE (E/M)

Assistant Engineer

Executive Engineer

U.P. JAL NIGAM RURAL GONDA

Divisional office U.P Jal Nigam (Rural) Gonda.U.P-271001.

Log Book

Log Sheet : Compressor

Name of Block : Mithi Purwa District : Bahraich
 Name of Gram Panchayat : Rampurwa Discharge :
 Name of Village : Rampurwa Discharge Mesur :

Date	Start	Stop	Hours	Air Line Lowered(m)	Starting Pressure	Running Pressure	Signature of Compressor Operator	Remarks
08.03.24	7:29 AM	9:03 AM	1:34				SAHA	
"	9:17 AM	10:39 AM	1:22				SAHA	
"	11:01 AM	12:31 PM	1:30				SAHA	
09.03.24	12:47 PM	2:13 PM	1:26				SAHA	
"	2:53 PM	4:33 PM	1:40				SAHA	
"	4:48 PM	6:18 PM	1:30				SAHA	
"	7:28 AM	8:40 AM	1:12				SAHA	
10.03.24	8:52 AM	10:37 AM	1:45				SAHA	
"	10:52 AM	12:10 PM	1:18				SAHA	
"	12:32 PM	2:09 PM	1:37				SAHA	
"	2:24 PM	3:29 PM	1:05				SAHA	
"	3:59 PM	5:23 PM	1:24				SAHA	
"	5:38 PM	7:18 PM	1:40				SAHA	
11.03.24	8:25 AM	9:58 AM	1:30				SAHA	
"	10:13 AM	11:36 AM	1:23				SAHA	
"	11:50 AM	1:22 PM	1:32				SAHA	
"	1:43 PM	3:27 PM	1:44				SAHA	
"	3:57 PM	5:15 PM	1:18				SAHA	
"	5:31 PM	7:03 PM	1:32				SAHA	
12.03.24	8:17 AM	9:52 AM	1:35				SAHA	
"	10:06 AM	11:20 AM	1:14				SAHA	
"	11:34 AM	12:54 PM	1:20				SAHA	
"	1:12 PM	2:27 PM	1:15				SAHA	
"	2:42 PM	4:04 PM	1:22				SAHA	
"	4:04 PM	5:49 AM	1:45				SAHA	
13.03.24	7:04 AM	8:34 AM	1:30				SAHA	
"	8:50 AM	10:15 AM	1:25				SAHA	
"	10:15 AM	11:38 AM	1:23				SAHA	
14.03.24	8:15 AM	9:40 AM	1:25				SAHA	
"	9:55 AM	11:29 AM	1:34				SAHA	
"	11:47 AM	1:11 PM	1:24				SAHA	
"	1:36 PM	2:59 PM	1:23				SAHA	
"	3:14 PM	4:44 PM	1:30				SAHA	
"	4:58 PM	6:24 PM	1:26				SAHA	
			49:43					



Signature: San
 Signature: Sul
 JUNIOR ENGINEER
 DIVISION OFFICE (E/M)
 U.P. JAL NIGAM RURAL GORDA



GA INFRA- VISHWANATH PROJECTS LIMITED



YIELD TEST REPORT OF DEVELOPMENT OF TUBEWELL BY O.P UNIT UNDER J.J.M PROGRAMME

1. G.P NAME - RAMPURWA
2. BLOCK - MIHINPURWA
3. DATE OF TESTING - 01-04-2024
4. T.W SIZE - 300 X 200
5. S.W.L- 3.50 MTR
6. COLUMN PIPE LOWERED - 24 MTR
7. SIZE OF COLUMN PIPE - 150 MM
8. ORIFICE SIZE - 6"X5"
9. CAPACITY OF O.P UNIT- 3 Cusec
10. REQUIRED DICHARGE - 1070 Lpm

SR.NO	DISCHARGE THROUGH ORIFICE SIZE (6"X5")		S.W.L IN MTR	R.W.L IN MTR	DEPRESSION IN MTR	SAND CONTENT IN PPM				REMARK	
	IN INCH	IN LPM				STARTING	5 MIN	10 MIN	15 MIN		20 MIN
1	24	2255	3.50	8.68	5.18	400	200	100	50	Tr	
2	18	1983	3.50	7.98	4.48	250	100	50	Tr	CL	
3	5.5	1109	3.50	6.12	2.62	100	50	Tr	CL	CL	

NOTE: Recommended Discharge 1070 Lpm at 2.62 mtr depression pump should be run atleast 15 min in By pass then after taken in line.
TEST CONDUCTED IN PRESENCE OF BY



[Signature]
TPI

[Signature]
Junior Engineer

JUNIOR ENGINEER

DIVISION OFFICE (E/M)

U.P. JAL NIGAM RURAL GONDA

Assistant Engineer

Executive Engineer



Jal Jeevan Mission

Har Ghar Jal

Har Ghar Jal
Jal Jeevan Mission

State Level Water Analysis Laboratory , U.P Jal Nigam (Rural), Lucknow

6 Rana pratap Marg Lucknow (Test Address only)

[Print](#)

Test report

Sample ID: U1683852S19358703

User Information

Name: Vishwanath Projects Limited shankar

Mobile: 7799887237

Email: pc-jm@vplindia.com

Pin Code:

Full Address: Village- Shahpur Jot Yusuph , Gram Panchayat- Shahpur Jot Yusuf, Block- Chitaura, District- Bahraich, State- Uttar Pradesh

Sample description

Source of Sample: RAMPURWA

Village: RAMPURWA

Gram Panchayat: RAMPURWA

Block: Mihirpurwa

District: Bahraich

State: Uttar Pradesh

Address:

Remarks:

Latitude: 28.237325

Longitude: 81.198273

Date & time of sample collection

02.04.2024 | 10:12:00 AM

Date & time of sample received in lab

02.04.2024 | 05:30:00 PM

Date & time of sample analysed

09.04.2024 | 03:18:00 PM

Date & time of report generation

14.05.2024 | 06:44:52 AM

Scan
Su
JUNIOR ENGINEER
DIVISION OFFICE (E/M)
U.P. JAL NIGAM RURAL GONDA

- 1)*indicates parameters that are NABL accredited.
- 2)This test results related to the sample tested above
- 3)The report shall not to be reproduced in full without approval of authority
- 4)This is the end of the report

Authorised signatory
Anil Kumar (Test Lab Incharge)

*****This is an electronically generated report and does not require a signature.*****

Jal Jeevan Mission aims at potable tap water supply to every home

Let's join hands to ensure drinking water is potable. It helps in preventing water borne diseases and improve public health.

Designed & Developed by NIC. Copyright ©copy NJJM 2024

Print



REQUEST FOR INSPECTION AND APPROVAL



Project	Jal Jeevan Mission Water Project, Shrawasti (UP)		
Client	State Water & Sanitation Mission , Uttar Pradesh		
Consultant /TPA	Ceinsys Tech LTD.		
EPC Contractor	Ga Infra - VPL (JV)		
RFI No	VPL/JJM/BAHRAICH		
RFI Start Date and Time	17.01.2024		
Location:	RAMPURWA	Block-MIHIPURWA	
For Civil /Works :	E&M WORK		
Drawing No.			
Description of Work:	TUBEWELL DRILLING WORK		
RFI Raised By	Asadullah		
Signature	Asadullah		
Date	16.01.2024		
Approved	Rejected	Not Ready	
Department	M/s GA INFRA -VPL(JV)	TPI (M/s Ceinsys Tech LTD)	Client (UP Jal Nigam)
Comments		Dpt test was not conduct before lowering work	
Signature	AS		
Date			



REQUEST FOR INSPECTION AND APPROVAL



Project	Jal Jeevan Mission Water Project, Shrawasti (UP)		
Client	State Water & Sanitation Mission , Uttar Pradesh		
Consultant /TPA	Ceinsys Tech LTD.		
EPC Contractor	Ga Infra - VPL (JV)		
RFI No	VPL/JJM/BAHRAICH		
RFI Start Date and Time	22.01.2024		
Location:	RAMPURWA	Block-MIHIPURWA	
For Civil /Works :	E&M WORK		
Drawing No.			
Description of Work:	TUBEWELL ELECTRO LOGGING WORK		
RFI Raised By	Asadullah		
Signature	Asadullah		
Date	22.01.2024		
Approved		Rejected	Not Ready
Department	M/s GA INFRA -VPL(JV)	TPI (M/s Ceinsys Tech LTD)	Client (UP Jal Nigam)
Comments			
Signature	ACP		
Date			



REQUEST FOR INSPECTION AND APPROVAL



Har Ghar Jal
Jal Jeevan Mission



SWSM
Uttar Pradesh

Project	Jal Jeevan Mission Water Project, Shrawasti (UP)		
Client	State Water & Sanitation Mission , Uttar Pradesh		
Consultant /TPA	Ceinsys Tech LTD.		
EPC Contractor	Ga Infra - VPL (JV)		
RFI No	VPL/JJM/BAHRAICH		
RFI Start Date and Time	17.01.2024		
Location:	RAMPURWA	Block-MIHIPURWA	
For Civil /Works :	E&M WORK		
Drawing No.			
Description of Work:	TUBEWELL DRILLING WORK		
RFI Raised By	Asadullah		
Signature	Asadullah		
Date	16.01.2024		
Approved		Rejected	
			Not Ready
Department	M/s GA INFRA -VPL(JV)	TPI (M/s Ceinsys Tech LTD)	Client (UP Jal Nigam)
Comments		DPT test was not conduct before lowering work	
Signature	AGI		
Date			



REQUEST FOR INSPECTION AND APPROVAL



Project	Jal Jeevan Mission Water Project, Shrawasti (UP)		
Client	State Water & Sanitation Mission , Uttar Pradesh		
Consultant /TPA	Ceinsys Tech LTD.		
EPC Contractor	Ga Infra - VPL (JV)		
RFI No	VPL/JJM/BAHRAICH		
RFI Start Date and Time	26.01.2024		
Location:	RAMPURWA	Block-MIHIPURWA	
For Civil /Works :	E&M WORK		
Drawing No.			
Description of Work:	TUBEWELL ASSEMBLY LOWERING WORK		
RFI Raised By	Asadullah		
Signature	Asadullah		
Date	25.01.2024		
Approved		Rejected	Not Ready
Department	M/s GA INFRA -VPL(JV)	TPI (M/s Ceinsys Tech LTD)	Client (UP Jal Nigam)
Comments		Dpt test was not conduct before lowering work.	
Signature	AGI		
Date			



REQUEST FOR INSPECTION AND APPROVAL



Project	Jal Jeevan Mission Water Project, Shrawasti (UP)		
Client	State Water & Sanitation Mission , Uttar Pradesh		
Consultant /TPA	Ceinsys Tech LTD.		
EPC Contractor	Ga Infra - VPL (JV)		
RFI No	VPL/JJM/BAHRAICH		
RFI Start Date and Time	14.03.2024		
Location:	RAMPURWA	Block-MIHIPURWA	
For Civil /Works :	E&M WORK		
Drawing No.			
Description of Work:	AIR COMPRESSER TESTING WORK		
RFI Raised By	Asadullah		
Signature	Asadullah		
Date	13.03.2024		
Approved	Rejected	Not Ready	
Department	M/s GA INFRA -VPL(JV)	TPI (M/s Ceinsys Tech LTD)	Client (UP Jal Nigam)
Comments		L-Work area was not barricaded at site.	
Signature	AGI	AGI	
Date			



REQUEST FOR INSPECTION AND APPROVAL



Project	Jal Jeevan Mission Water Project, Shrawasti (UP)		
Client	State Water & Sanitation Mission , Uttar Pradesh		
Consultant /TPA	Ceinsys Tech LTD.		
EPC Contractor	Ga Infra - VPL (JV)		
RFI No	VPL/JJM/BAHRAICH		
RFI Start Date and Time	01.04.2024		
Location:	RAMPURWA	Block-MIHIPURWA	
For Civil /Works :	E&M WORK		
Drawing No.			
Description of Work:	OP UNIT TESTING WORK		
RFI Raised By	Assadullah		
Signature	Assadullah		
Date	01.04.2024		
Approved		Rejected	Not Ready
Department	M/s GA INFRA -VPL(JV)	TPI (M/s Ceinsys Tech LTD)	Client (UP Jal Nigam)
Comments		L Site area was not barricade at site,	
Signature	AG	Assadullah	
Date			