


VINDHYA TEDELINKS LTD -GAJA ENGINEERING PVT.LTD JV
 Actual T.W. Assembly & Strata Chart As Per Logging Report
 G P-, Daturaha , Block - Dostpur, Sultanpur
 JJM Phase - III


MP BILA
 GROUP

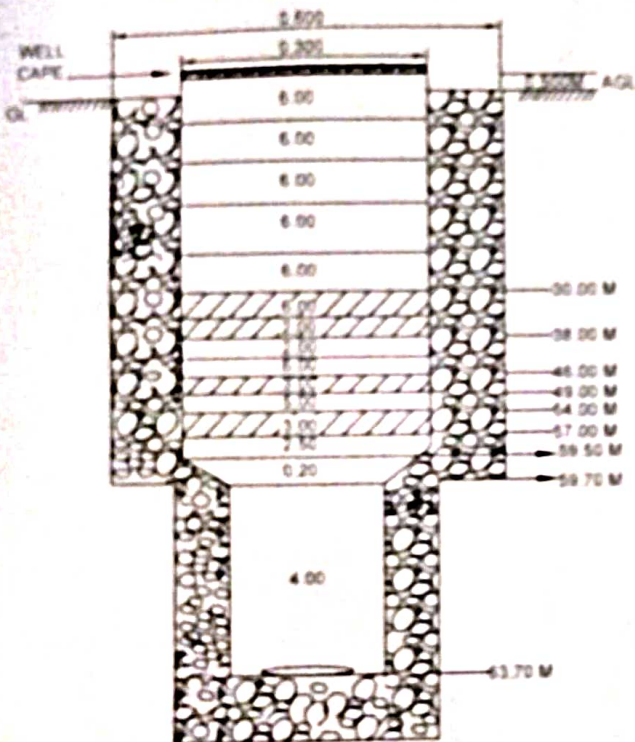

Actual Assembly for Lowering	
1	Bore Size 800*600 mm
2	T.W. Assembly size 300*200 mm
3	Discharge 1275 LPH @ 10 HP
5	Date of Logging 30-04-2023
6	Date of lowering 01-05-2023

1	300mm@Plain Pipe	46.00 M
2	300mm@Galvanized Pipe	14.00 M
3	200mm@Plain Pipe	4.00 M
4	300*200 Reducer	0.20 M
5	Total Length	64.20 M
6	A.G.L.	1-0.50
7	Lowering	63.70

Logging Report (30-04-23)		
1	30 - 38	08 M
2	46 - 49	03 M
3	54 - 57	03 M




JUNIOR ENGINEER
 DIVISION OFFICE (E&M)
 U.P. JAL NIGAM (UPJN) AYODHYA
 JE E & M
 UPJN

AE E & M
 UPJN

EE E & M
 UPJN

Hand Draw Assembly Chart of Datasaha w/s scheme block 20stair Dist Sultanpura.

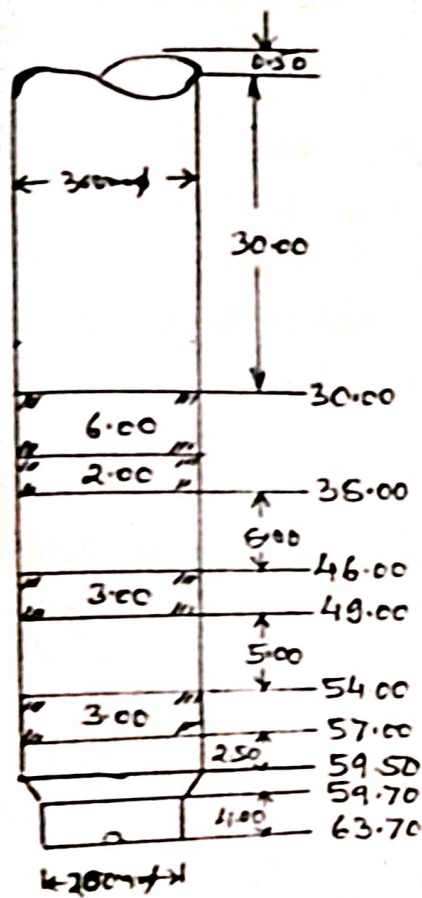

- 1- Discharge 1270Lpm
- 2- Assembly 300x200
- 3- Battery = 600x500
- 4- Logging Report 30hr

1. 30 - 38 = 8 Good
2. 46 - 49 = 3 water
3. 54 - 57 = 3 water

formation of water is deteriorating from 62m bgl till logged death



M/s Mahalaxmi Tube well

Rajnendra Nagar Pukhrayan Kanpur 9935299290

Geophysical Well Logging Report

Well No -04/307

Date -30/04/2023

Site Location : - Daturaha Dostpur Sultanpur

District : - Sultanpur

Logged Depth : - 165 M BGL

Date of Logging : - 30/04/2023

Types of Log : - S.P & NT5, N-64 LAT

Logger used : - IGIS

Rm - 11.3 Ohm Rw - 12.1 Ohm

The following permeable granular zones have been deciphered with the help of Electrical Logger

Sr NO	Depth Range From M.B.G.L	Depth Range M.B.G.L	Thickness Mtr.	Inferred Lithology	Quality of G.W.
01	30	38	08	Fine to medium Sand	Good
02	46	49	03	<u>Fine Sand</u>	Moderate
03	54	57	03		

Note- All zones are intermixed with fine bands of kankar. Quality of the formation water is deteriorating from 62 Mbgl to tilld logged depth and highly kankar.

- Logging performed as per SWSM guidelines

- Groundwater quality M/s Mahalaxmi Tube Well interpreted by firm as per their logger calibration

GSL
01/05/23



Block - Dewater
Grp - Daturaha

Discharge - 1270 LPM
 Assembly - 300 x 200 mm ϕ
 Base Size - 600 x 500 mm ϕ

- Plain Pipe 300 mm ϕ = 4 M
- Slotted Pipe 300 mm ϕ = 14 M
- Plain Pipe 200 mm ϕ = 4 M
- Ring 300 mm ϕ = 12 Nos
- Cap 300 mm ϕ = 1 Nos
- Reducer 300 x 200 mm ϕ = 1 Nos
- Grid Plug - 200 mm ϕ = 1 Nos
- W-Frame 300 mm ϕ = 1 Nos
- SI Clamp 300 mm ϕ = 1 Nos

