

2024/10/11 11:47

GROUND WATER SURVEY CONSULTANCY

GEOLOGISTS, GEOPHYSICISTS & TUBEWELL ENGINEERS

GEO-PHYSICAL WELL ELECTROLOGGING REPORT

Ref No:-B- 203

Date:- 24-04-2023

NAME OF SITE

GRAM PANCHAYAT- Kalyanpur

BLOCK- Milak

DISTT- Rampur

NAME OF AGENCY

M/s NKG Infrastructure Limited
Delhi



GROUND WATER SURVEY CONSULTANCY

Electric Well Logging, Geophysical Resistivity Survey, Ground Water Investigations.


112 A-Shree Nagar Colony, Firozabad Road, Agra- 282006

(M) : 9412260823, 9794625420, 9761163000, Email : gwsc_agra@yahoo.com

ISO ; 9001 : 2015

Ground Water Survey Consultancy

Agra

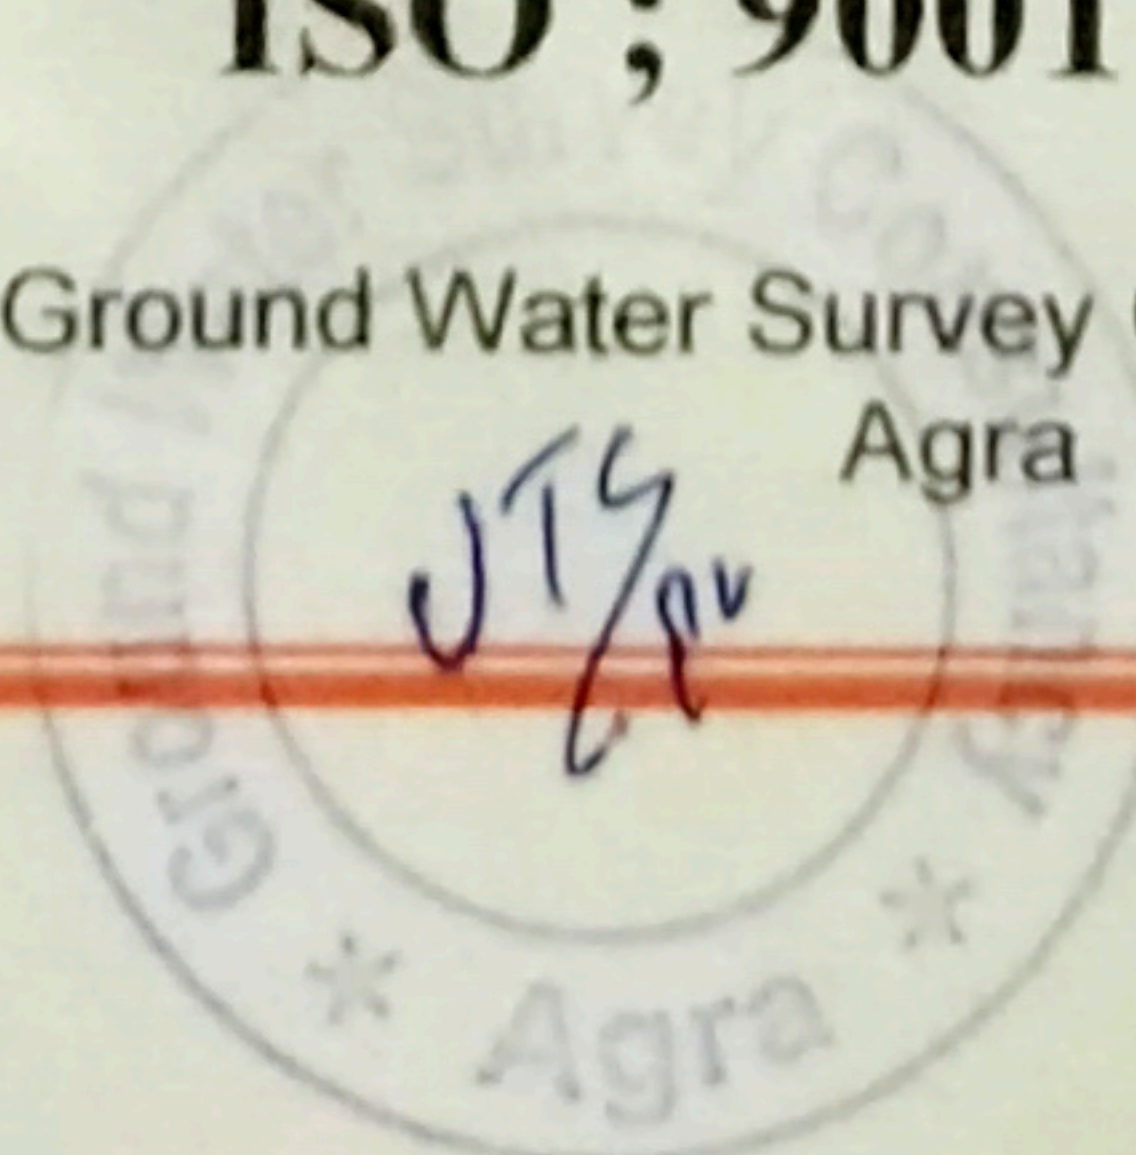

2024/10/11 11:47

REPORT ON GEOPHYSICAL WELL LOGGING AT

GRAM PANCHAYAT- KALYANPUR, BLOCK- MILAK,
DISTT- RAMPUR
UNDER
JAL JIVAN MISSION

Introduction :


A Deep bore hole was drilled 10 mtrs. depth. and Logged depth 140 mtrs. at above site. Was drilled by M/s NKG Infrastructure Limited, Delhi.

On the request of M/s NKG Infrastructure Limited, Delhi. a Geophysical well Logging in the above bore hole using IGIS Well Logger on 24.April.2023.

Logging Para meters - Self potential, short normal (N-16), Long Normal (N-64), Lateral. Details of major equifer formations explored from logging of bore hole combined with the study of Strata Chart prepared from drill cuttings are given in the following table:-

S.No.	Depth range(m)	Thickness(m)	Lithology	Expected Water Quality
1.	0 - 5	5	Surface soil	
2.	5 - 15	10	Clay kankar	
3.	15 - 22	7	Fine sand	
4.	22 - 27	5	Clay kankar	
5.	27 - 45	18	Medium sand	Good
6.	45 - 51	6	Clay kankar	
7.	51 - 62*	11	Medium sand & kankar	Good
8.	62 - 67	5	Clay kankar	
9.	67 - 85*	18	Medium sand & kankar	Good
10.	85 - 88	3	Clay kankar	
11.	88 - 95*	7	Medium sand	Good
12.	95 - 98	3	Clay kankar	
13.	98 - 108*	10	Medium sand & kankar	Good
14.	108 - 110	2	Clay kankar	
15.	110 - 113	3	Fine sand	Good
16.	113 - 120	7	Clay kankar	
17.	120 - 140*	20	Medium sand	Good

Ground Water Survey Consultancy

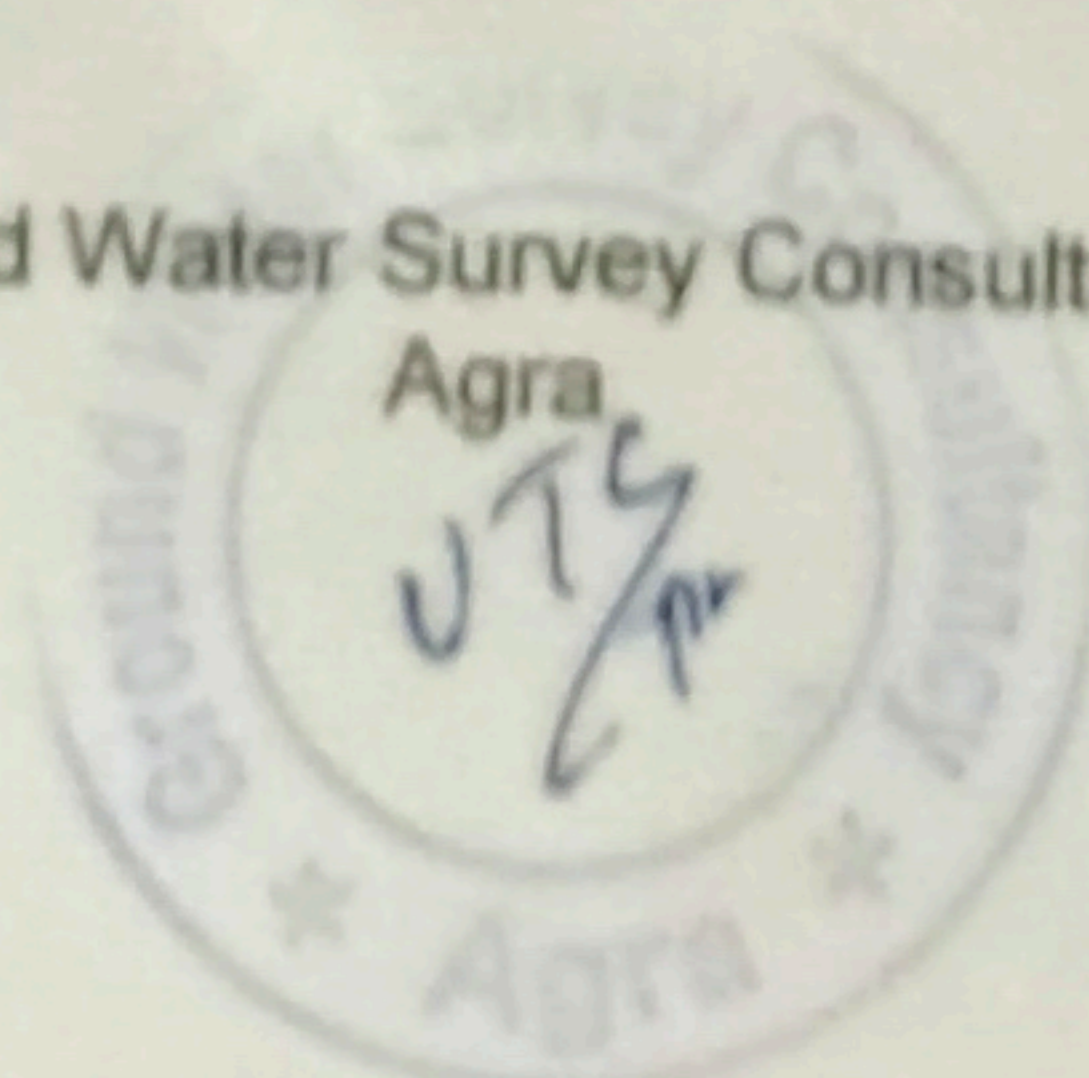


2024/10/11 11:48

Conclusions and Recommendations :-

1. The Lithology broadly tallies with that of drill cutting starta chart.
2. The zones marked with asterisk (*) appear to be aquifer zones for possible development of tubewell.
3. The Quality of water is expected Good.
4. It is recommended to have a chemical and bacteriological analysis of the water sample before using it for human consumption or for any other use.
5. All projections and recommendations are subject to the inherent limitations of the technique employed and there could be variations as the underground conditions are not always amenable to physical interpretations.

Geophysicist

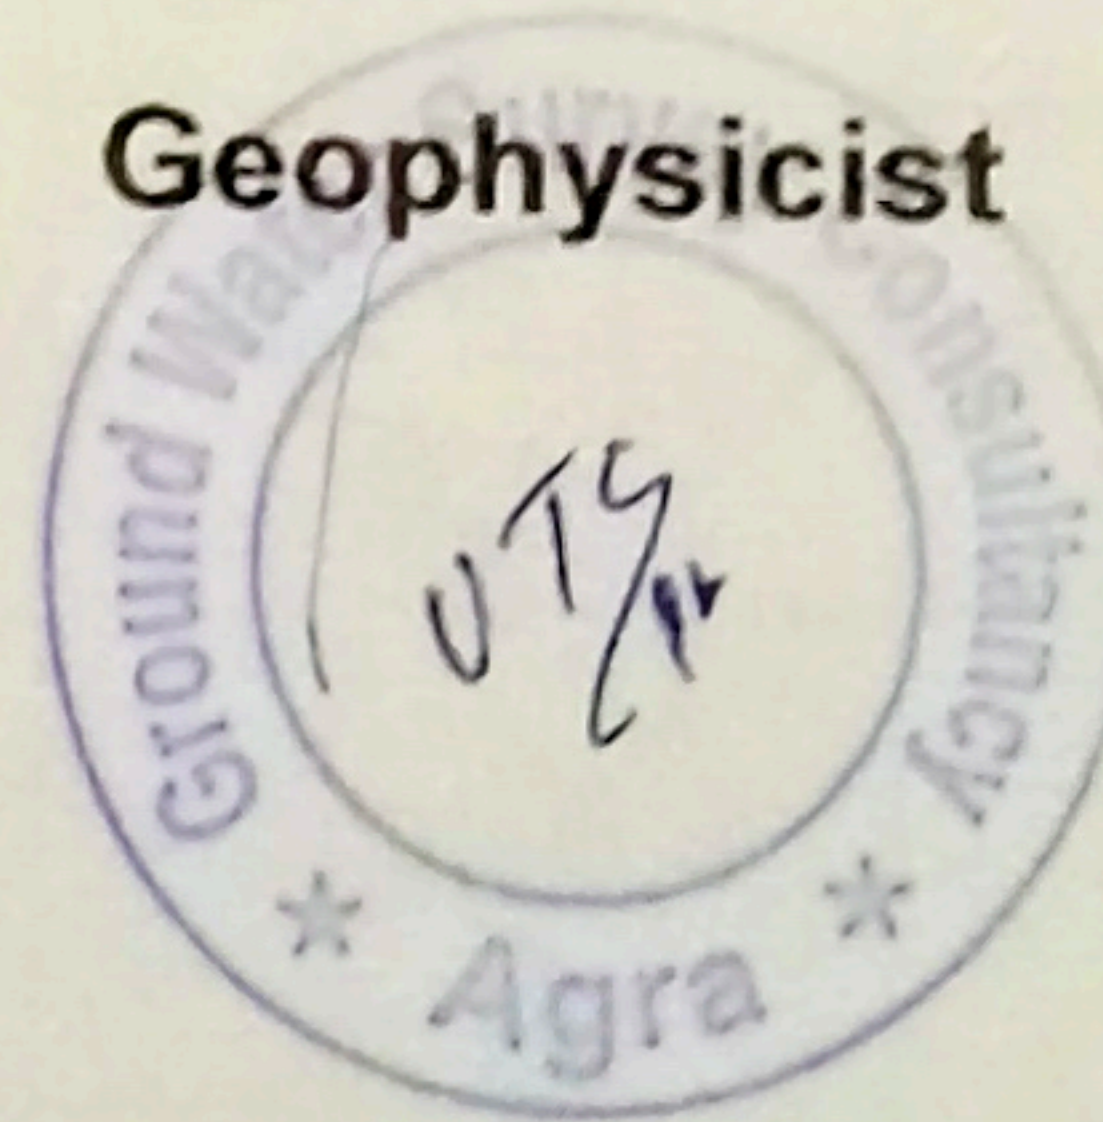

Ground Water Survey Consultancy

Location: Logging in
 Kalyanpur Block,
 Mandla Distt - Rampur
 Log No.:
 LOG/2023/04
 Date: 24 Apr 2023
 Time: 16:20
 Observer:
 Utkarsh Gupta (KS)
 Well Depth:

Rho a
 N 16(SN)
 N 64 (LN)
 LAT

SP

