


Bashoo

RURAL WATER SUPPLY SCHEME UNDER SWSM-JJM

Date- / /

Actual Strata chart & Assembly Lowered of 300X150 mm Size of Bashoo, Block-Bhetua
District-Amethi
Q=400 LPM,H=

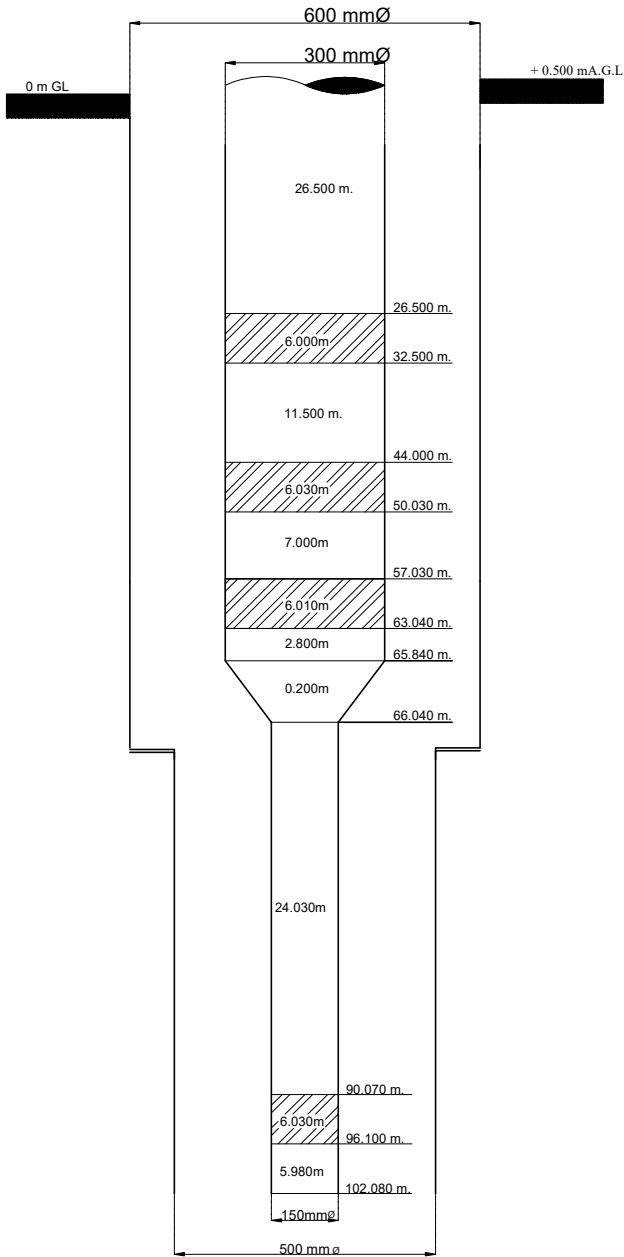

1. Bore Size	=	600 x 500 mm
2. Assembly Size	=	300 x 150 mm
3. Drilling Depth	=	372.000 m
4. Logging Depth	=	358.000 m
5. Date of Logging	=	09.05.2023
6. Date of Lowering	=	17.05.2022

Logging Report

S.No.	Depth Range (mbgl)	Thickness (m)	Remarks
1.	26-33	07	Good
2.	44-50	06	Good
3.	52-64	12	Good
4.	90-96	06	Good
5.	287-294	07	Moderate
6.	312-316	04	Good to Moderate
7.	337-347	10	Good to Moderate

1. 300 mm @ Housing Pipe	=	47.800m
2. 150 mm @ Plain Pipe	=	30.010m
3. 150 mm @ Screen Pipe	=	6.030m
4. 300 mm @ Soleted pipe	=	18.040m
5. 300 X150 mm @ Reducer	=	0.200m
A.G.L =		0.500m
B.G.L =		102.080m
Total Lowering =		102.580m