


Gayaspur

RURAL WATER SUPPLY SCHEME UNDER SWSM-JJM

Date- / /

Actual Strata chart & Assembly Lowered of 300X150 mm Size of Gayaspur, Block-Sukul Bazar
District-Amethi
Q=500 LPM,H=48.400 M

1. Bore Size	=	600 x 500 mm
2. Assembly Size	=	300 x 150 mm
3. Drilling Depth	=	405.000 m
4. Logging Depth	=	400.000 m
5. Date of Logging	=	19.06.2022
6. Date of Lowering	=	27.06.2022

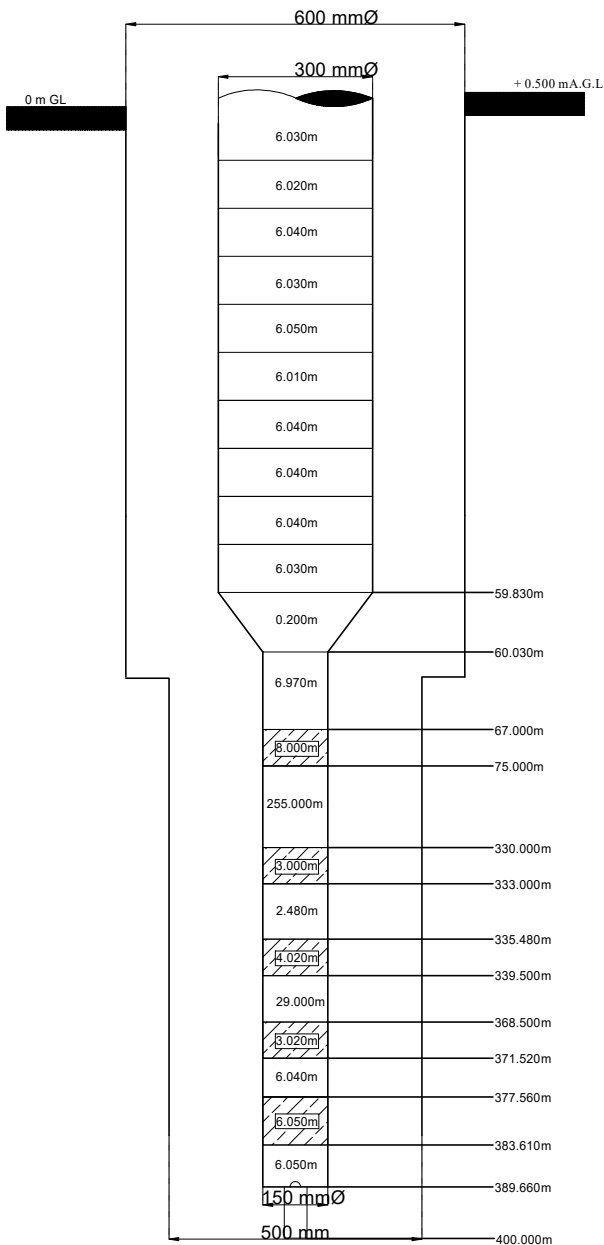

Logging Report

S.No.	Depth Range (mbgl)	Thickness (m)	Remarks
1.	21-25	04	Good
2.	29-39	10	Good
3.	44-47	03	Good
4.	67-75	08	Good
5.	330-333	03	Good
6.	335-340	05	Good
6.	368-372	04	Good
6.	377-384	07	Good

- | | |
|----------------------------|----------|
| 1. 300 mm@ Housing Pipe = | 60.330m |
| 2. 150 mm@ Plain Pipe = | 305.540m |
| 3. 150 mm@ Slotted Pipe = | 24.090m |
| 4. 300 X 150 mm@ Reducer = | 0.200m |

A.G.L = 0.500m

B.G.L = 389.660m

Total Lowering = 390.160m