



## YIELD TEST REPORT

S.W.L. 10.20 Taste of Water SWEET V - Notch/Office 150X125mm Date of test 20-10-11

[illegible]

Recommended 1800 LPM.

discharge at 4.00 mts depression

Journal

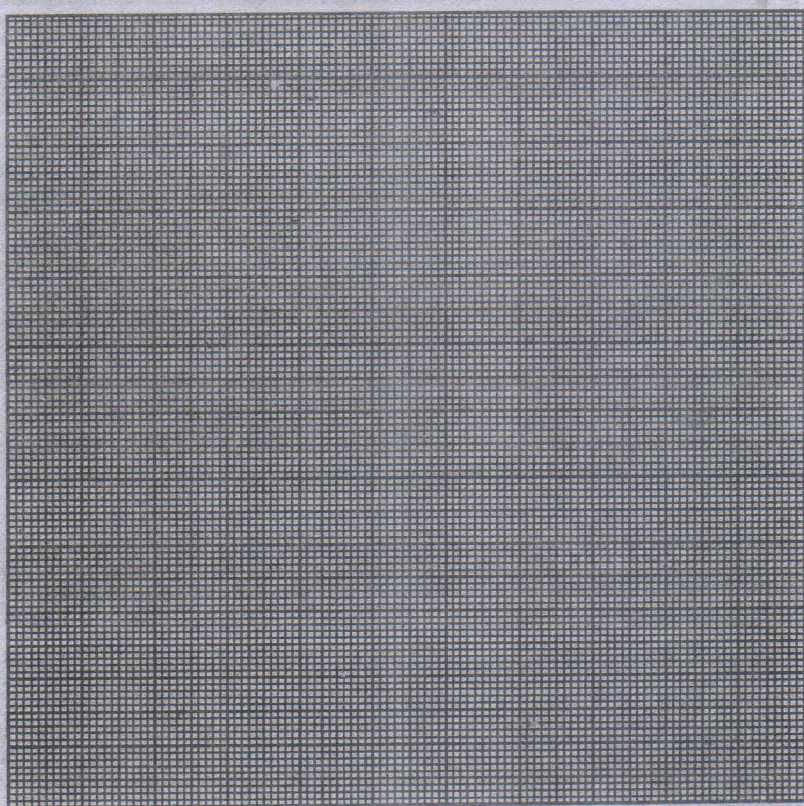
~~2000~~  
A.E.

## VERTICALITY TEST REPORT

DIA OF Disc ..... TOTAL HOUSING ..... DATE OF TEST .....

Height of Suspension ...

### Circla diagram

[illegible]

CLEAR SPACE ..... At .....  
..... At .....  
..... At .....

AGENCY

## C120 MLD WATER TREATMENT

LAB. PRATAP VIHAR, GHAZIABAD.

## WATER TEST RESULTS

REF :- H. M.

**.DATED**

|                                                      | NTU | 0.5   |
|------------------------------------------------------|-----|-------|
| 1. TURBIDITY.....                                    |     |       |
| 2. PH.....                                           |     | 7.25  |
| 3. TOTAL DISSOLVED SOLIDS mg/l.....                  |     | 320   |
| 4. TOTAL HARDNESS (as ca co <sub>3</sub> ) mg/l..... |     | 240   |
| 5. CHLORIDES (as CL) mg/l.....                       |     | 30    |
| 6. SULPHATES (as So <sub>4</sub> ) mg/l.....         |     | 34    |
| 7. FLUORIDES (as F) mg/l.....                        |     | 0.3   |
| 8. NITRATES (as No <sub>3</sub> ) mg/l.....          |     | 2     |
| 9. CALCIUM (as Ca) mg/l.....                         |     | 59.30 |

10. MAGNESIUM (as mg) mgl. 22.30  
11. IRON (as Fe) mgl. 0.04

11. IRON (as Fe) mgl. .... 0.04