


# M/S VSAIPPL-SMC JV, Ghazipur (U.P)

ACTUAL STRATA CHART OF KARIMUDDINPUR REORGANISATION WSS, BLOCK -MARDAH, ZONE 1, GRAM PANCHAYAT - KARIMUDDINPUR TW1 Under Jal Jeevan Mission, District- Ghazipur(U.P.)

PHYSICAL STRATA			
S.No.	BGL in meter		Formation
	From	to	
	0	16	Clay
	16	36	Kankad
	36	46	Kankad Clay
	46	66	Kankad With Very Fine Sand
	66	74	Clay
	74	90	Kankad With Fine Sand
	90	106	Kankad Clay
	106	172	Fine Sand with Kankad
	172	184	Kankad Clay
	184	190	Very Fine Sand With Kankad
	190	193	Clay
	193	222	Kankad With Very Very Fine Sand
	222	230	Kankad Clay
	230	242	Fine Sand with Kankad
	242	256	Very Fine Sand With Kankad
	256	312	Kankad Clay
	312	358	Very Fine Sand With Kankad

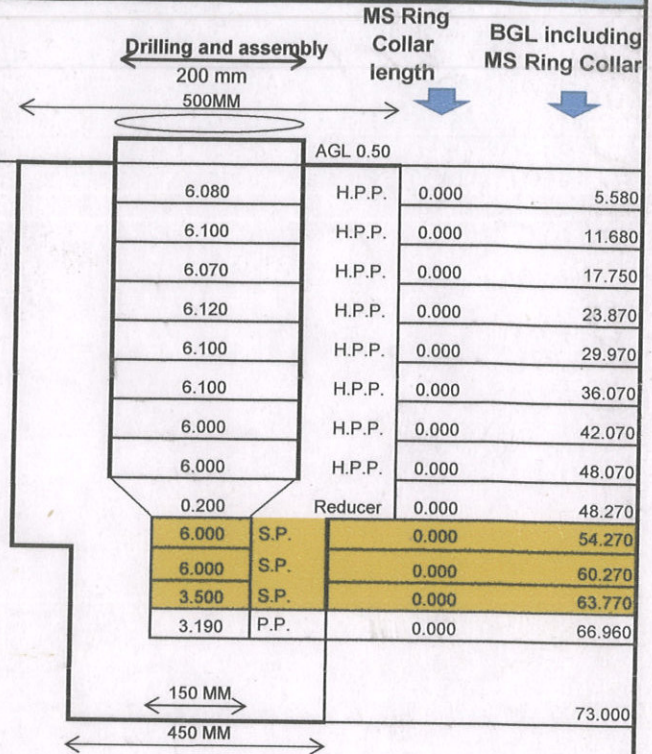

### Logging Report

18-11-2023

S.N.	Depth Range	Thickness	Quality/Remark
1	18 - 35	17	Good
2	48 - 64	16	Good
3	85 - 88	3	Moderate
4	108 - 132	24	Moderate
5	145 - 150	5	Moderate
6	158 - 170	12	Moderate to Good
7	185 - 190	5	Moderate to Good
8	195 - 203	8	Good
9	206 - 220	14	Good
10	232 - 238	6	Moderate

Note -

- Please ensure pre-monsoon water level before lower the well assembly.
- Quality of Ground water is deteriorating Marginally Saline in between 75 to 81 Mtr and 242 Mtr bgl to till depth logged bgl.
- Predominated clay is present in depth range 67 to 74 and 93 to 102 and 133 to 142 and 152 to 157 mtr bgl.

DETAILS		AS PER DPR	ACTUAL	
1	Proposed Discharge	455.000	LPM	
2	Clear Depth of bore 600mm	0	Mbgl	0.000
3	Clear Depth of bore 500mm	65	Mbgl	53.000
4	Clear Depth of bore 450mm	295	Mbgl	358.000
5	Plane pipe 300MM	0	m	0.000
6	Plane pipe 200MM	60	m	48.570
7	Plane pipe 150MM	258	m	3.190
8	Reducer 200 X 150 MM	0	m	0.200
9	Slotted pipe 300MM	0	m	0.000
10	Slotted pipe 200MM	0	m	0.000
11	Slotted pipe 150MM	12	m	15.500
12	Date of lowering			25-11-2023

Company Repre.  
 M/S VSAIPPL-SMC JV, Ghazipur (U.P)

TPIA  
 Medhaj Techno Concept Pvt. Ltd., Ghazipur

(A. Srivastava)  
 Junior Engineer

(Nitish Kumar)  
 Assistant Engineer

(Adarsh Verma)  
 Exe. Engineer

Division Office(E/M) ,U.P. Jal Nigam(Rural), Varanasi



# REPORT ON GEOPHYSICAL WELL LOGGING AT

GRAM PANCHAYAT- KARIMUDDINPUR, BLOCK- BARACHAWAR, DISTT- GHAZIPUR  
UNDER  
JAL JIVAN MISSION

## Introduction :

A Deep bore hole was drilled 360 mtrs. depth. and Logged depth 358 mtrs. at above site. Was drilled by M/S VSA Infra Pvt. Ltd. Ghazipur.

On the request of M/S VSA Infra Pvt. Ltd. Ghazipur. a Geophysical well Logging in the above bore hole using IGIS Well Logger on 18.Nov.2023.

Logging Para meters - Self potential, short normal (N-16), Long Normal (N-64), Lateral. Details of major aquifer formations explored from logging of bore hole combined with the study of Strata Chart prepared from drill cuttings are given in the following table:-


Mud Resistivity = 16.14 Ohms.

Drilling Water Resistivity = 12.29 Ohms.

Approx Water Level = 9 Mtr

S.No.	Depth range(m)	Thickness(m)	Lithology	Expected Water Quality
1.	18 - 35	17	Medium sand	Good
2.	48 - 64	16	Medium sand	Good
3.	85 - 88	3	Fine sand	Moderate
4.	108 - 132	24	Fine sand	Moderate
5.	145 - 150	5	Fine to medium sand	Moderate
6.	158 - 170	12	Fine to medium sand	Mod to Good
7.	185 - 190	5	Fine sand	Mod to Good
8.	195 - 203	8	Fine to medium sand	Good
9.	206 - 220	14	Fine to medium sand	Good
10.	232 - 238	6	Fine sand	Moderate

- Note :-
1. Please ensure pre-monsoon water level before lower the well assembly
  2. Quality Of Ground water is deteriorating Marginally Saline in between 75 to 81 Mtr and 142 Mtr bgl to till depth logged bgl.
  3. Predominated clay is present in depth range 67 to 74 and 93 to 102 and 133 to 142 and 152 to 157 mtr bgl.





## M/S VSAIPPL-SMC JV, Ghazipur (U.P.)

**Regd. Office-#10, APIIC Building, Type-III, I.E, Prashanth Nagar Kukatpally, Hyderabad-500072**

**Under Jal Jivan Mission, District- Ghazipur(U.P.)**

**Test Report of Karimuddinpur GP (Zone-1, TW-1) Tubewell under Saraimubarak WSS, Block-Barachawar Development By 250 PSI Air Compressor**






**Size of tube well (mm):** 200 X 150 **RPM**

**Static water level (m):** 6.80 **Discharge by-90 'V' notch (Rectangular)**

**Depth of TW (m):** 66.960 **Required Discharge- 455 LPM** **Date of testing** 31-12-2023


S. N.	Pressure in kg/cm <sup>2</sup>		Depression		Discharge by 'V' Notch		Sand content in P.P.M.				
	Starting Pressure	Running Pressure	In	In mtr.	Inch	LPM	At start	After 5 min	After 10 min	After 15 min	After 20 min
1	4.00	3.30	0.70	7.00	6 3/4	1008	6400	3500	3300	3100	3000





**Remark-** Recommended for further development by O.P. Unit

 (.....) Company Repre. M/S VSAIPPL-SMC JV, Ghazipur (U.P.)	 (.....) TPIA Medhaj Techno Concept Pvt. Ltd., Ghazipur	 (Abhishek Srivastava) Junior Engineer	 (Nitish Kumar) Assistant Engineer	 (Adarsh Verma) Executive Engineer
Division Office (E&M), U.P. Jal Nigam(Rural), Varanasi				

Latitude - 25.69675 Longitude - 83.86221

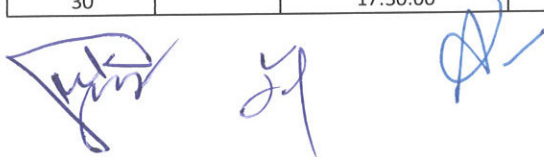M/S VSAIPPL-SMC JV, Ghazipur (U.P)					
Job Code:		Compressor unit capacity	As per DPR:	600 PSI	
Block:	Barachwar	Compressor unit Hours	As per Site:	250 PSI	
Scheme	KARIMUDDINPUR REORGANISATION WSS		As per DPR:	60	
GP	KARIMUDDINPURz-1,tw-1		As per Site:	58.83 Hrs	
Lowering Depth(mtr):	66.960	Cumm Gravel(cumt)	As per DPR:	79.5	
Lowering Date :	25-Nov-23	Cumm Gravel(cumt)	As per Site:	66.78	
SI No	Date	Start Time	End Time	Total Hours	Remarks
1	23-Dec-23	07:29:00	08:50:00	1:21	
2		10:10:00	11:25:00	1:15	
3		12:00:00	13:21:00	1:21	
4		14:00:00	15:30:00	1:30	
5		16:00:00	17:20:00	1:20	
6	24-Dec-23	08:29:00	09:54:00	1:25	
7		10:00:00	11:15:00	1:15	
8		13:00:00	14:30:00	1:30	
9		16:20:00	17:50:00	1:30	
10	25-Dec-23	18:00:00	19:30:00	1:30	
11		09:00:00	10:20:00	1:20	
12		11:00:00	12:26:00	1:26	
13		14:00:00	15:30:00	1:30	
14		16:00:00	17:20:00	1:20	
15	26-Dec-23	18:29:00	19:34:00	1:05	
16		10:00:00	11:10:00	1:10	
17		12:00:00	12:50:00	0:50	
18		13:30:00	14:30:00	1:00	
19		15:00:00	16:26:00	1:26	
20	27-Dec-23	17:00:00	18:30:00	1:30	
21		08:00:00	09:14:00	1:14	
22		10:10:00	11:20:00	1:10	
23		13:30:00	14:10:00	0:40	
24		15:20:00	16:26:00	1:06	
25	28-Dec-23	17:30:00	19:00:00	1:30	
26		08:00:00	09:14:00	1:14	
27		10:10:00	11:30:00	1:20	
28		13:30:00	14:30:00	1:00	
29		15:20:00	16:46:00	1:26	
30		17:30:00	18:31:00	1:01	



M/S VSAIPPL-SMC JV, Ghazipur (U.P)					
Job Code:		Compressor unit capacity	As per DPR:	600 PSI	
Block:	Barachwar		As per Site:	250 PSI	
Scheme	KARIMUDDINPUR REORGANISATION WSS	Compressor unit Hours	As per DPR:	60	
GP	KARIMUDDINPURz-1,tw-1		As per Site:	58.83 Hrs	
Lowering Depth(mtr):	66.960	Cumm Gravel(cumt)	As per DPR:	79.5	
Lowering Date :	25-Nov-23		As per Site:	66.78	
		Cumm Gravel(cumt)	As per Site:	66.78	
SI No	Date	Start Time	End Time	Total Hours	Remarks
31	29-Dec-23	09:00:00	10:10:00	1:10	
32		11:00:00	12:06:00	1:06	
33		14:00:00	15:00:00	1:00	
34		16:00:00	17:10:00	1:10	
35		18:29:00	19:34:00	1:05	
36	30-Dec-23	09:00:00	10:10:00	1:10	
37		11:00:00	12:33:00	1:33	
38		14:00:00	15:30:00	1:30	
39		16:00:00	17:30:00	1:30	
40		18:29:00	19:54:00	1:25	
41	31-Dec-23	08:00:00	09:24:00	1:24	
42		10:10:00	11:34:00	1:24	
43		13:30:00	14:50:00	1:20	
44		15:20:00	16:46:00	1:26	
45		17:30:00	19:52:00	2:22	
			<b>Total</b>	<b>58:50</b>	
			<b>Total (Hrs)</b>	<b>58.83 Hrs</b>	
					
Site Incharge	TPIA	Junior Engineer	Assistant Engineer		
M/S VSAIPPL-SMC JV, Ghazipur (U.P)	M/s Medhaj Techno Concept Pvt. Ltd., Ghazipur	Construction Division Office(E/M) ,U.P.Jal Nigam(Rural), Varanasi			



## M/S VSAIPPL-SMC JV, Ghazipur (U.P.)

Regd. Office-#10, APIIC Building, Type-III, I.E, Prashanth Nagar Kukatpally, Hyderabad-500072

Under Jal Jivan Mission, District- Ghazipur(U.P.)

Yield Test Report Of T.W at Karimuddinpur GP (Zone-1, TW-1) Tubewell under Karimuddinpur

Reorganisation WSS, Block-Barachawar by 1 Cusec O.P. Unit

Size of Ventury 4" X 3" Column Pipe Lowered(m): 30.00

Static water level(m): 6.90 Required Discharge(LPM)- 455 LPM Date: 12-01-2024

S.N.	Discharge		Running Water Level (m)	Depression (m)	Sand content in P.P.M.				
	Inch	LPM			At start	After 5 min	After 10 min	After 15 min	After 20 min
1	43.00	1041	14.00	7.10	600	300	200	150	100
2	23.00	761	12.10	5.20	400	200	150	100	50
3	8.00	462	10.80	3.90	100	50	Tr	Tr	Cl

Remark- Recommended discharge 455 LPM L.P.M. at 3.9 m depression after running 20 minute bypass.

  
(.....)  
Company Repre.

M/S VSAIPPL-SMC  
JV, Ghazipur (U.P.)

  
(.....)  
TPIA

Medhaj Techno Concept Pvt.  
Ltd., Ghazipur

  
(Abhishek Srivastava)  
Junior Engineer

Division Office (E&M), U.P. Jal Nigam(Rural), Varanasi

  
(Nitish Kumar)  
Assistant Engineer

Executive Engineer

  
(Adarsh Verma)  
Executive Engineer

### M/S VSAIPPL-SMC JV, Ghazipur (U.P)

<b>Block:</b>	BARACHAWAR	<b>Op unit Capacity</b>	<b>As per DPR:</b>	1 cusec	
			<b>As per Site:</b>	1 cusec	
<b>Scheme</b>	KARIMUDDINPUR REORGANISATION WSS	<b>Op unit Hours</b>	<b>As per DPR:</b>	100	
<b>GP</b>	KARIMUDDINPUR Z-1, T.W-1		<b>As per Site:</b>	99.75	
<b>REQUIRED DISCHARGE</b>	455	<b>Compressor Testing Date :</b>			
				<b>31-12-2023</b>	
<b>SI No</b>	<b>Date</b>	<b>Start Time</b>	<b>End Time</b>	<b>Total Hours</b>	<b>Remarks</b>
1	28-12-2023	08:23:00	09:54:00	1:31	
2		10:24:00	11:56:00	1:32	
3		15:46:00	17:16:00	1:30	
4		18:03:00	19:21:00	1:18	
5		19:40:00	20:25:00	0:45	
6	29-12-2023	08:43:00	09:40:00	0:57	
7		12:51:00	13:20:00	0:29	
8		15:56:00	17:17:00	1:21	
9	30-12-2023	08:55:00	09:50:00	0:55	
10		10:33:00	11:54:00	1:21	
11		12:50:00	13:20:00	0:30	
12		15:56:00	17:19:00	1:23	
13		18:06:00	19:10:00	1:04	
14	31-12-2023	08:15:00	09:40:00	1:25	
15		10:45:00	11:50:00	1:05	
16		15:57:00	17:18:00	1:21	
17		18:02:00	19:11:00	1:09	
18		19:40:00	20:34:00	0:54	
19	01-01-2024	08:55:00	10:16:00	1:21	
20		10:44:00	11:55:00	1:11	
21		12:41:00	13:51:00	1:10	
22		15:56:00	17:23:00	1:27	
23		19:38:00	21:10:00	1:32	
24	02-01-2024	08:45:00	10:10:00	1:25	
25		10:44:00	11:50:00	1:06	
26		12:52:00	14:20:00	1:28	
27		15:46:00	17:16:00	1:30	
28		19:50:00	21:10:00	1:20	
29	03-01-2024	08:35:00	10:05:00	1:30	
30		10:44:00	11:55:00	1:11	
31		15:46:00	17:16:00	1:30	
32		18:12:00	19:20:00	1:08	
33		19:40:00	21:00:00	1:20	
34	04-01-2024	08:45:00	10:10:00	1:25	
35		10:44:00	11:50:00	1:06	
36		12:50:00	14:10:00	1:20	
37		15:56:00	17:16:00	1:20	
38		19:40:00	21:00:00	1:20	
39	05-01-2024	08:55:00	10:16:00	1:21	
40		10:44:00	11:55:00	1:11	
41		12:40:00	14:00:00	1:20	
42		15:56:00	17:26:00	1:30	
43		18:12:00	19:20:00	1:08	
44		19:40:00	21:00:00	1:20	







Longitude - 25.69675

Longitude - 83.86221



**M/S VSAIPPL-SMC JV,Ghazipur (U.P)**

<b>Block:</b>	BARACHAWAR	<b>Op unit Capacity</b>	<b>As per DPR:</b>	1 cusec	
			<b>As per Site:</b>	1 cusec	
<b>Scheme</b>	KARIMUDDINPUR REORGANISATION WSS	<b>Op unit Hours</b>	<b>As per DPR:</b>	100	
<b>GP</b>	KARIMUDDINPUR Z-1, T.W-1		<b>As per Site:</b>	99.75	
<b>REQUIRED DISCHARGE</b>	455	<b>Compressor Testing Date :</b>			31-12-2023
<b>SI No</b>	<b>Date</b>	<b>Start Time</b>	<b>End Time</b>	<b>Total Hours</b>	<b>Remarks</b>
45	06-01-2024	08:45:00	10:00:00	1:15	
46		10:44:00	11:50:00	1:06	
47		12:50:00	14:10:00	1:20	
48		15:56:00	17:08:00	1:12	
49		19:40:00	21:00:00	1:20	
50	07-01-2024	08:45:00	10:00:00	1:15	
51		10:44:00	11:50:00	1:06	
52		12:40:00	14:00:00	1:20	
53		15:56:00	17:16:00	1:20	
54		19:40:00	21:00:00	1:20	
55	08-01-2024	08:45:00	10:10:00	1:25	
56		10:44:00	11:50:00	1:06	
57		12:50:00	14:10:00	1:20	
58		15:56:00	17:18:00	1:22	
59		18:02:00	19:10:00	1:08	
60	09-01-2024	08:45:00	10:10:00	1:25	
61		10:44:00	11:50:00	1:06	
62		12:50:00	14:10:00	1:20	
63		15:56:00	17:18:00	1:22	
64		18:02:00	19:10:00	1:08	
65	10-01-2024	19:40:00	21:09:00	1:29	
66		10:44:00	11:50:00	1:06	
67		12:50:00	14:10:00	1:20	
68		15:56:00	17:18:00	1:22	
69		18:02:00	19:10:00	1:08	
70	11-01-2024	19:40:00	21:09:00	1:29	
71		08:45:00	10:10:00	1:25	
72		15:56:00	17:18:00	1:22	
73		18:02:00	19:10:00	1:08	
74		19:40:00	21:09:00	1:29	
75	12-01-2024	08:45:00	10:10:00	1:25	
76		10:44:00	11:50:00	1:06	
77		12:48:00	14:01:00	1:13	
78		15:56:00	17:18:00	1:22	
79		19:40:00	20:45:00	1:05	
			<b>Total</b>	<b>99:45</b>	
			<b>Total (Hrs)</b>	<b>99.75</b>	
					
<b>Site Incharge</b>		<b>TPIA</b>	<b>Junior Engineer</b>	<b>Assistant Engineer</b>	<b>Exe. Engineer</b>
M/S VSAIPPL-SMC JV,Ghazipur (U.P)		M/s Medhaj Techno Concept Pvt. Ltd.,Ghazipur	Construction Division Office(E/M) ,U.P.Jal Nigam(Rural),Varanasi		





# QA Testing Laboratories Pvt. Ltd.

(Govt. Approved Testing Laboratories)

B-76, Sector-64, Gautam Buddha Nagar, Noida-201301 (Uttar Pradesh)

Quality Assurance

Tel.: +91-120-4133953 • Mobile: +91-8287945370 • E-mail: admin@qatestinglaboratories.com

Website : www.qatestinglaboratories.com

CIN : U51100UP2018PTC108293 • GSTIN : 09AAACQ5609C1ZN



IAS-ANZ



M54009131N



ISO 9001:2015, 14001:2015, 45001:2018 & ISO/IEC 17025:2017 Accredited & BIS Recognised Laboratory

## TEST CERTIFICATE

(This Certificate is not Valid without Hologram)



Test Report No : QAL/WT/240122002639  
Sample Name: : Tube Well Water  
Sample Code : -  
Issued To : VSAIPPL-SMC JV  
District-Ghazipur.

Issue Date : 28/01/2024  
Sample Received On : 22/01/2024  
Reference No : VSAIPPL/EE/UPJN/23-24/66  
Sampling Date : 22/01/2024  
Sampling Quantity : 2 Ltr.  
Batch No./Lot No. : NA  
Date of Mfg. : NS  
Date of Exp. : NS  
Date of Starting : 22/01/2024  
Date of Completion : 28/01/2024

Sample Submitted By : VSAIPPL-SMC JV  
Mfg. By : NA  
Sample Description : Physical, Chemical & Heavy Metals Analysis Of Water  
Location : B-Barachawar GP-Karrimuddinpur Zone-1

S.No.	Test Parameter	Units	Results	Specification as per IS:10500:2012		Test Method
				Acceptable Limit	Permissible Limit	
1	Color	Hazen	2	5 max.	15 max.	IS : 3025( P-4)
2	Turbidity	NTU	0.1	1 max.	5 max.	IS : 3025( P-10)
3	pH value at 25°C	-	7.26	6.5-8.5	No Relaxation	IS : 3025 (P-11)
4	Total Hardness as CaCO3	mg/l	158	200 max	600 max.	IS : 3025 (P-21)
5	Calcium (as Ca)	mg/l	37.7	75 max	200 max	IS : 3025 (P-40)
6	Iron (as Fe)	mg/l	0.028	1 max	-	IS : 3025 (P-53)
7	Magnesium (as Mg)	mg/l	16.1	30 max	100 max	IS : 3025 (P-46)
8	Chloride (as Cl)	mg/l	18.5	250 max.	1000 max.	IS : 3025 (P-32)
9	Free Residual Chlorine	mg/l	Nil	0.2 max.	1 Max	IS : 3025 (P-26)
10	Sulphates (as SO4)	mg/l	6.6	200 max.	400 max.	IS : 3025 (P-24)
11	Total Alkalinity (as CaCO3)	mg/l	102	200 max.	600 max.	IS : 3025 (P-23)
12	Fluoride (as F)	mg/l	0.034	1 max.	1.5 max.	IS : 3025 (P-60)
13	Total Dissolved Solid (TDS)	mg/l	386	500 max.	2000 max.	IS : 3025 (P-16)
14	Total Coliform Bacteria	MPN/10 0 ml	Absent	Shall not be detectable in any 100 ml sample	Shall not be detectable in any 100 ml sample	IS : 1622
15	E coli	MPN/10 0 ml	Absent	Shall not be detectable in any 100 ml sample	Shall not be detectable in any 100 ml sample	IS : 1622

SAMPLE COLLECTED BY US

\*\*\*End of Report\*\*\*

Upendra Kumar  
Technical Manager  
Authorized By (Sign & Stamp):

Dileep Kumar  
Quality Manager  
Approved By (Sign & Stamp):

Note: a) This report is not reproduced wholly or in partially and forbidden to be used as an evidence in the court of law and ought not be used in any advertisement media without our special permission in writing. b) The data reported in this TEST CERTIFICATE are valid at the time of and under the stipulated conditions of measurement and the test results are applicable to those items of product which have been tested and do not apply to the other products even though declared to be identical. c) Except by special arrangement, the test items will not be retained by the company not more than one month. d) Report refers to the sample received by M/s QA Testing Laboratories Pvt. Ltd. e) This report is valid for the tested sample only.





# QA Testing Laboratories Pvt. Ltd.

(Govt. Approved Testing Laboratories)

B-76, Sector-64, Gautam Buddha Nagar, Noida-201301 (Uttar Pradesh)

Quality Assurance

Tel.: +91-120-4133953 • Mobile: +91-8287945370 • E-mail: admin@qatestinglaboratories.com

Website : www.qatestinglaboratories.com

CIN : U51100UP2018PTC108293 • GSTIN : 09AAACQ5609C1ZIN

JAS-ANZ



M5400913IN



ISO 9001:2015, 14001:2015, 45001:2018 & ISO/IEC 17025:2017 Accredited & BIS Recognised Laboratory



## TEST CERTIFICATE

(This Certificate is not Valid without Hologram)

Test Report No : QAL/WT/240122002639

Issue Date : 28/01/2024

Sample Name: : Tube Well Water

Sample Received On : 22/01/2024

S.No.	Test Parameter	Units	Results	Specification as per IS:10500:2012		Test Method
				Acceptable Limit	Permissible Limit	
16	Nitrate (as NO <sub>3</sub> )	mg/l	0.34	45 max	No Relaxation	IS : 3025 (P-34)
17	Copper (as Cu)	mg/l	ND	0.05 max	1.5 max	IS : 3025 (P-42)
18	Manganese (as Mn)	mg/l	0.014	0.1 max	0.3 max	IS : 3025 (P-59)
19	Mercury (as Hg)	mg/l	ND	0.001 max	No Relaxation	IS : 3025 (P-48)
20	Cadmium (as Cd)	mg/l	ND	0.003 max	No Relaxation	IS : 3025 (P-41)
21	Selenium (as Se)	mg/l	ND	0.01 max	No Relaxation	IS : 3025 (P-56)
22	Total Arsenic (as As)	mg/l	ND	0.01 max	0.05 max	IS : 3025 (P-37)
23	Lead (as Pb)	mg/l	ND	0.01 max	No Relaxation	IS : 3025 (P-47)
24	Zinc (as Zn)	mg/l	0.026	5 max	15 max	IS : 3025 (P-49)
25	Cobalt	mg/l	ND	-	-	IS : 3025 (P-2)
26	Aluminium (as Al)	mg/l	ND	0.03 max	0.2 max	IS : 3025 (P-55)
27	Boron (as B)	mg/l	0.012	0.5 max	1.0 max	IS : 3025 (P-57)
28	Barium (as Ba)	mg/l	0.018	0.7 max	No Relaxation	IS:13428
29	Silver (as Ag)	mg/l	ND	0.1 max	No Relaxation	IS:13428
30	Molybdenum (as Mo)	mg/l	ND	0.07 max	No Relaxation	IS : 3025 (P-2)
31	Nickel (as Ni)	mg/l	ND	0.02 max	No Relaxation	IS : 3025 (P-54)
32	Total Chromium (as Cr)	mg/l	ND	0.05 max	No Relaxation	IS : 3025 (P-52)
33	Antimony (as Sb)	mg/l	ND	-	-	IS :3025 (P-2)

Note: ND= Not Detected

SAMPLE COLLECTED BY US

\*\*\*End of Report\*\*\*

Upendra Kumar

Technical manager

Authorized By (Sign & Stamp):

Dileep Kumar

Quality Manager

Approved By (Sign & Stamp):

Note: a) This report is not reproduced wholly or in partially and forbidden to be used as an evidence in the court of law and ought not to be used in any advertisement media without our special permission in writing. b) The data reported in this TEST CERTIFICATE are valid at the time of and under the stipulated conditions of measurement and the test results are applicable to those items of product which have been tested and do not apply to the other products even though declared to be identical. c) Except by special arrangement, the test items will not be retained by the company not more more than one month. d) Report refers to the sample received by M/s QA Testing Laboratories Pvt. Ltd. e) This report is valid for the tested sample only.