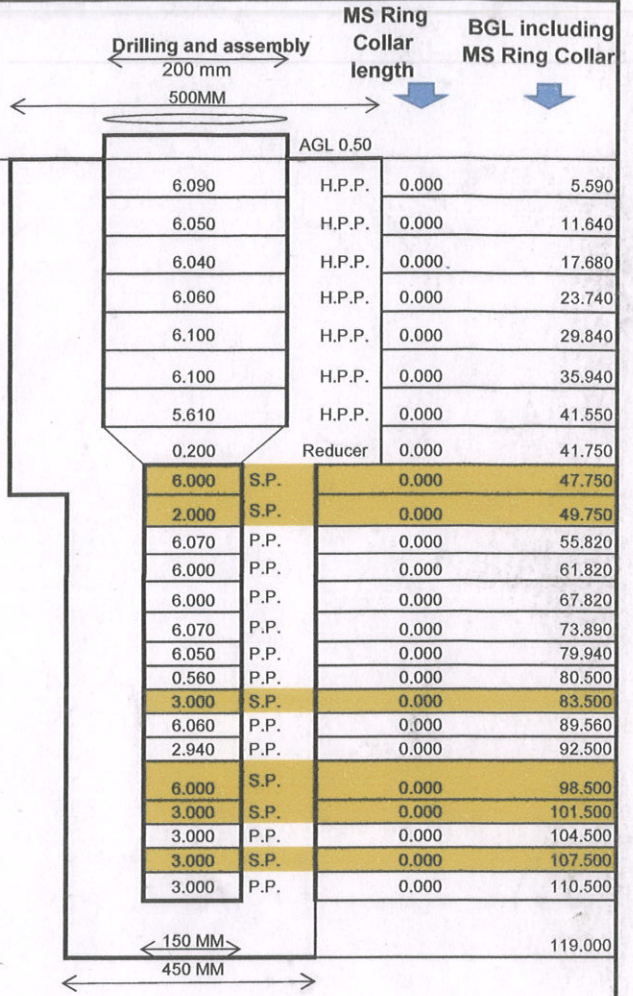
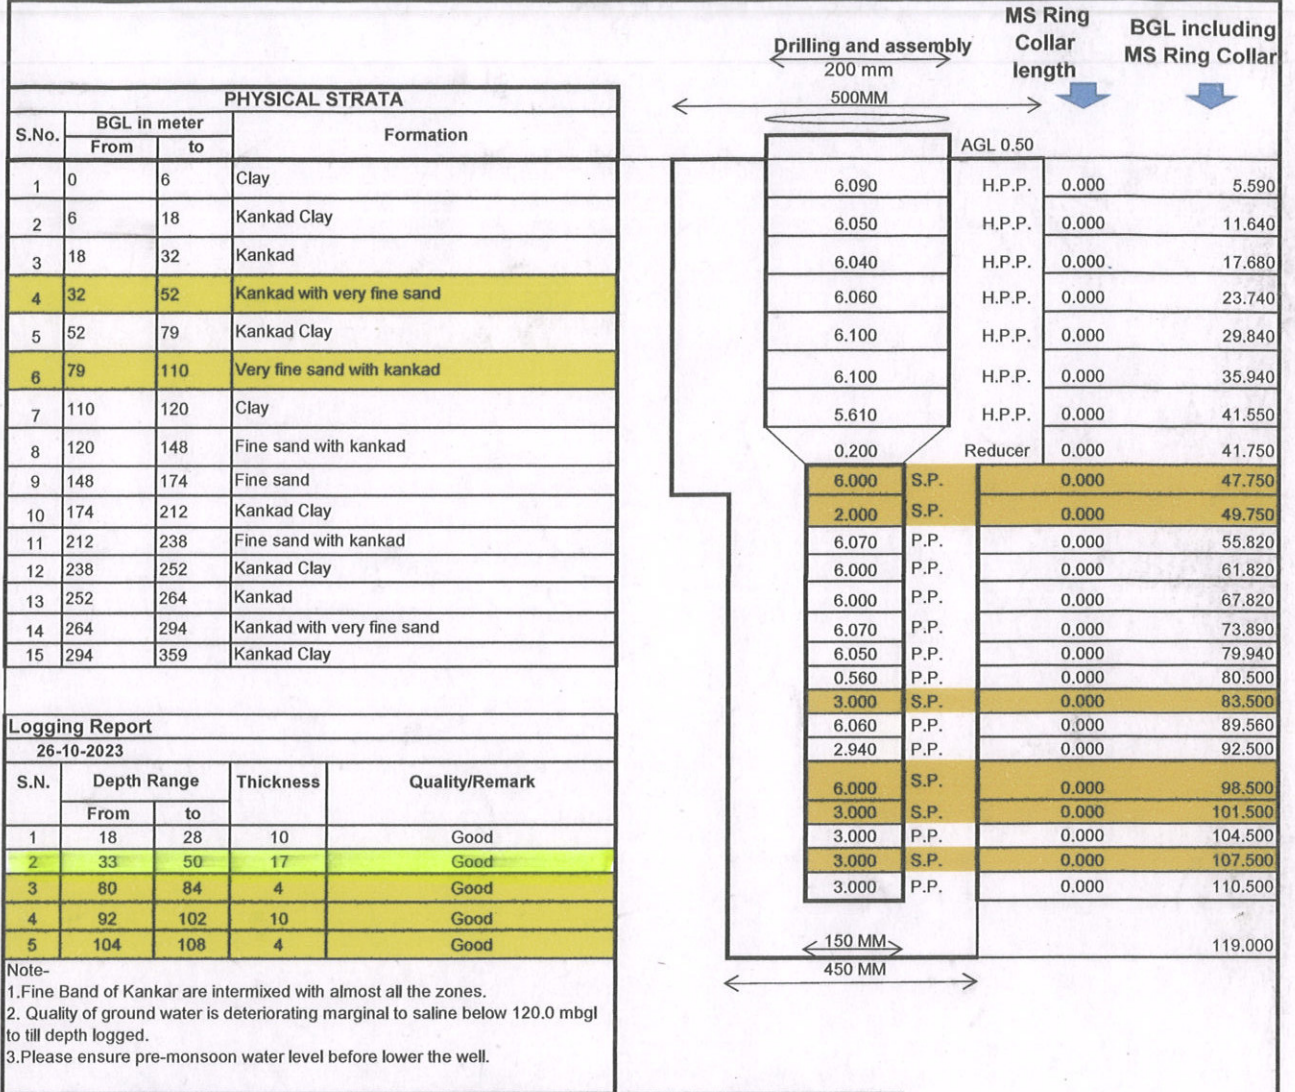







## M/S VSAIPPL-SMC JV, Ghazipur (U.P)

**ACTUAL STRATA CHART OF BHARSAR REORGANISATION WSS, BLOCK -BIRNO, ZONE 3, GRAM PANCHAYAT - JAGDISHPUR VIDYAPAT, TW-1**  
Under Jal Jeevan Mission, District- Ghazipur(U.P.)



DETAILS		AS PER DPR		ACTUAL	
1	Proposed Discharge	460.000	LPM		
2	Cear Depth of bore 600mm	0	Mbgl	0.000	Mbgl
3	Cear Depth of bore 500mm	65	Mbgl	65.000	Mbgl
4	Clear Depth of bore 450mm	295	Mbgl	359.000	Mbgl
5	Plane pipe 300MM	0	m	0.000	m
6	Plane pipe 200MM	60	m	42.050	m
7	Plane pipe 150MM	258	m	45.750	m
8	Reducer 200 X 150 MM	0		0.200	m
9	Slotted pipe 300MM	0	m	0.000	m
10	Slotted pipe 200MM	0	m	0.000	m
11	Slotted pipe 150MM	12	m	23.000	m
12	Date of lowering	02.11.2023			

 <b>Company Repre.</b> M/S VSAIPPL-SMC JV, Ghazipur (U.P.)	 (.....) <b>TPIA</b> Medhaj Techno Concept Pvt. Ltd., Ghazipur	 (A. Srivastava) Junior Engineer	 (Nitish Kumar) Assistant Engineer	 (Adarsh Verma) Exe. Engineer
Division Office(E/M) ,U.P. Jal Nigam(Rural), Varanasi				



# GEO INSTRUMENTS & TECHNIC'S

(A Division of Geophysical Exploration and Instrumentation)

Sales & Service Dealer : Uptron Borehole logging system, UPTRON INDIA LTD., LUCKNOW

Ref:GIT:UP: PJM:23-24:LS:K- 381

Dated: 27-10-2023

## GEOPHYSICAL BOREHOLE LOGGING REPORT

Site: Jagdishpur Vidyapat Zone - 3  
Block: Birno  
District: Ghazipur  
State: Uttar Pradesh  
Date of Logging: 26-10-2023  
Drilling Depth: 360.0 m bgl  
Logging Depth: 359.0 m bgl  
Rm - 14.0 Ωm Rw - 16.0 Ωm

Latitude: 25.6981850 Longitude: 83.5325560

Borehole Drilled by: M/s VSAIPPL SMC (JV), Ghazipur, Uttar Pradesh.

Based on the interpretation of Self Potential (SP), Short Normal (N-16"), Long Normal (N-64") and Lateral 6' Geophysical Logs, following informations/granular zones have been deciphered with respect to Salinity only:

Sl. No.	Depth Range (m bgl)	Thickness (meter)	Remark (Quality of Aquifer Water)
1.	18 - 28	10	Good
2.	33 - 50	17 - 8	Good
3.	80 - 84	04 - 3	Good
4.	92 - 102	10 - 9	Good
5.	104 - 108	04 - 3	Good

- Note: 1. Fine bands of kankar are intermixed with almost all the zones.  
2. Quality of ground water is deteriorating marginal to saline below 120.0 m bgl to till depth logged.  
3. Please ensure pre-monsoon water level before lower the well assembly.

For Geo Instruments & Technic's

*S. Shukla*  
(S. Shukla)



## M/S VSAIPPL-SMC JV, Ghazipur (U.P.)

Regd. Office-#10,APIIC Building,Type-III, I.E, Prashanth Nagar Kukatpally,Hyderabad-500072  
Under Jal Jivan Mission, District- Ghazipur(U.P.)

Yield Test Report Of T.W at Jagdishpur Vidyapat GP (Zone-3,TW-1) Tubewell under Bharsar  
Reorganisation WSS, Block-Birno by 1 Cusec O.P. Unit

Size of Ventury 4" X 3" Column Pipe Lowered(m): 30.00

Static water level(m): 7.90 Required Discharge(LPM)- 460 LPM Date: 24-12-2023

S.N.	Discharge		Running Water Level (m)	Depression (m)	Sand content in P.P.M.				
	Inch	LPM			At start	After 5 min	After 10 min	After 15 min	After 20 min
1	43.00	1041	15.00	7.10	600	300	200	150	100
2	22.00	746	13.10	5.20	400	200	150	100	50
3	8.00	462	11.80	3.90	100	50	Tr	Tr	Cl

**Remark-** Recommended discharge 460 LPM L.P.M. at 3.9 m depression after running 20 minute bypass.

  
 (.....)  
 Company Repr.


M/S VSAIPPL-SMC  
JV, Ghazipur (U.P.)

  
 (.....)  
 TPIA

Medhaj Techno Concept Pvt.  
Ltd., Ghazipur

  
 (Abhishek Srivastava)  
 Junior Engineer

Division Office (E&M), U.P. Jal Nigam(Rural), Varanasi

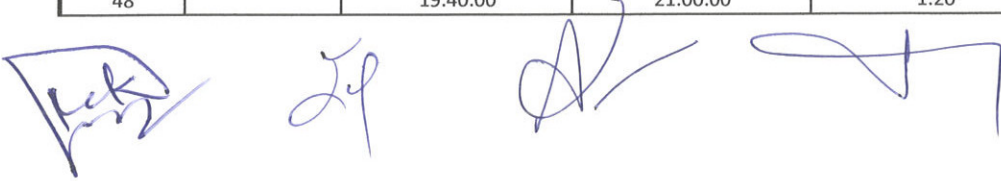
  
 (Nitish Kumar)  
 Assistant Engineer

Executive Engineer

  
 (Adarsh Verma)  
 Executive Engineer





**M/S VSAIPPL-SMC JV, Ghazipur (U.P)**

<b>Block:</b>	Birno		<b>Op unit Capacity</b>	<b>As per DPR:</b>	<b>1 cusec</b>
				<b>As per Site:</b>	<b>1 cusec</b>
<b>Scheme</b>	Bharsar REORGANISATION WSS		<b>Op unit Hours</b>	<b>As per DPR:</b>	<b>100</b>
<b>GP</b>	Jagdishpur Z-3, T.W-1			<b>As per Site:</b>	<b>97.09</b>
			<b>Compressor Testing Date :</b>	<b>09-12-2023</b>	
<b>SI No</b>	<b>Date</b>	<b>Start Time</b>	<b>End Time</b>	<b>Total Hours</b>	<b>Remarks</b>
1	11-12-2023	08:23:00	09:54:00	1:31	
2		10:24:00	11:56:00	1:32	
3		12:20:00	13:20:00	1:00	
4		15:46:00	17:00:00	1:14	
5		18:03:00	19:21:00	1:18	
6	12-12-2023	08:43:00	09:40:00	0:57	
7		10:44:00	11:48:00	1:04	
8		12:51:00	13:20:00	0:29	
9		15:56:00	17:17:00	1:21	
10	13-12-2023	19:41:00	20:30:00	0:49	
11		08:55:00	09:50:00	0:55	
12		10:33:00	11:54:00	1:21	
13		15:56:00	17:19:00	1:23	
14		18:06:00	19:10:00	1:04	
15	14-12-2023	19:40:00	20:32:00	0:52	
16		08:15:00	09:40:00	1:25	
17		10:45:00	11:50:00	1:05	
18		15:57:00	17:18:00	1:21	
19		18:02:00	19:11:00	1:09	
20	15-12-2023	19:40:00	20:34:00	0:54	
21		08:55:00	10:16:00	1:21	
22		10:44:00	11:55:00	1:11	
23		12:41:00	13:51:00	1:10	
24		15:56:00	17:23:00	1:27	
25		18:12:00	19:20:00	1:08	
26	16-12-2023	19:38:00	21:10:00	1:32	
27		08:45:00	10:10:00	1:25	
28		12:52:00	14:20:00	1:28	
29		15:46:00	17:16:00	1:30	
30		18:02:00	19:12:00	1:10	
31	17-12-2023	19:50:00	21:10:00	1:20	
32		08:35:00	10:05:00	1:30	
33		10:44:00	11:55:00	1:11	
34		12:42:00	14:12:00	1:30	
35		18:12:00	19:20:00	1:08	
36	18-12-2023	19:40:00	21:00:00	1:20	
37		08:45:00	10:10:00	1:25	
38		10:44:00	11:50:00	1:06	
39		12:50:00	14:10:00	1:20	
40		15:56:00	17:16:00	1:20	
41		18:02:00	19:10:00	1:08	
42	19-12-2023	19:40:00	21:00:00	1:20	
43		08:55:00	10:16:00	1:21	
44		10:44:00	11:55:00	1:11	
45		12:40:00	14:00:00	1:20	
46		15:56:00	17:26:00	1:30	
47		18:12:00	19:20:00	1:08	
48		19:40:00	21:00:00	1:20	





**M/S VSAIPPL-SMC JV,Ghazipur (U.P)**

<b>Block:</b>	Birno	<b>Op unit Capacity</b>	<b>As per DPR:</b>	1 cusec
			<b>As per Site:</b>	1 cusec
<b>Scheme</b>	Bharsar REORGANISATION WSS	<b>Op unit Hours</b>	<b>As per DPR:</b>	100
<b>GP</b>	Jagdishpur Z-3, T.W-1		<b>As per Site:</b>	97.09
		<b>Compressor Testing Date :</b>		09-12-2023
<b>SI No</b>	<b>Date</b>	<b>Start Time</b>	<b>End Time</b>	<b>Total Hours</b>
49	20-12-2023	08:45:00	10:00:00	1:15
50		10:44:00	11:50:00	1:06
51		12:50:00	14:10:00	1:20
52		15:56:00	17:08:00	1:12
53		18:02:00	19:10:00	1:08
54		19:40:00	21:00:00	1:20
55	21-12-2023	08:45:00	10:00:00	1:15
56		10:44:00	11:50:00	1:06
57		12:40:00	14:00:00	1:20
58		15:56:00	17:16:00	1:20
59		18:12:00	19:20:00	1:08
60		19:40:00	21:00:00	1:20
61	22-12-2023	08:45:00	10:10:00	1:25
62		10:44:00	11:50:00	1:06
63		12:50:00	14:10:00	1:20
64		15:56:00	17:18:00	1:22
65		18:02:00	19:10:00	1:08
66		19:40:00	21:09:00	1:29
67	23-12-2023	08:45:00	10:10:00	1:25
68		10:44:00	11:50:00	1:06
69		12:50:00	14:10:00	1:20
70		15:56:00	17:18:00	1:22
71		18:02:00	19:10:00	1:08
72		19:40:00	21:09:00	1:29
73	24-12-2023	08:45:00	10:10:00	1:25
74		10:44:00	11:50:00	1:06
75		12:50:00	14:10:00	1:20
76		15:56:00	17:18:00	1:22
77		18:02:00	19:10:00	1:08
78		19:40:00	21:09:00	1:29
			<b>Total</b>	<b>97:54</b>
			<b>Total (Hrs)</b>	<b>97.09</b>
				
<b>Site Incharge</b>	<b>TPIA</b>	<b>Junior Engineer</b>	<b>Assistant Engineer</b>	<b>Exe. Engineer</b>
M/S VSAIPPL-SMC JV,Ghazipur (U.P)	M/s Medhaj Techno Concept Pvt. Ltd.,Ghazipur	Construction Division Office(E/M) ,U.P.Jal Nigam(Rural),Varanasi		

# M/S VSAIPPL-SMC JV, Ghazipur (U.P.)

Regd. Office-#10, APIIC Building, Type-III, I.E, Prashanth Nagar Kukatpally, Hyderabad-500072

Under Jal Jivan Mission, District- Ghazipur(U.P.)

Test Report of Jagdispur Vidyapath GP (Zone-3, TW-1) Tubewell under Bharsar WSS, Block-Birno Development By 250 PSI Air Compressor

Size of tube well (mm): 200 X 150 RPM 1300

Static water level (m): 7.80 Discharge by-90 'V' notch (Rectangular)

Depth of TW (m): 110.500 Required Discharge- 460 LPM Date of testing 11-12-2023

S. N.	Pressure in kg/cm <sup>2</sup>		Depression In mtr.	Depth of air line at the time of testing (m)	Discharge by 'V' Notch		Sand content in P.P.M.				
	Starting Pressure	Running Pressure			Inch	LPM	At start	After 5 min	After 10 min	After 15 min	After 20 min
1	9.50	8.80	7.00	105.00	6 3/4	1008	6300	3500	3300	3100	3000
2	7.10	6.50	6.00	81.00	6 1/2	917	5800	3200	3000	2800	2700
3	3.20	2.70	5.00	42.00	6	751	5000	2800	2600	2400	2200

Remark- Recommended for further development by O.P. Unit

(.....)  
Company Repr.  
M/S VSAIPPL-SMC  
JV, Ghazipur (U.P.)

(.....)  
TPIA  
Medhaj Techno Concept Pvt.  
Ltd., Ghazipur

(Abhishek Srivastava)  
Junior Engineer

(Nitish Kumar)  
Assistant Engineer

(Adarsh Verma)  
Executive Engineer

Division Office (E&M), U.P. Jal Nigam(Rural), Varanasi







**M/S VSAIPPL-SMC JV, Ghazipur (U.P)**

<b>Job Code:</b>	VIRNO	<b>Compressor unit Capacity</b>	<b>As per DPR:</b>	600PSI	
<b>Block:</b>	MARDAH	<b>Compressor unit Hours</b>	<b>As per Site:</b>	250 PSI	
<b>Scheme</b>	Bharsar REORGANISATION WSS		<b>As per DPR:</b>	60.00	
<b>GP</b>	Jagdispur Vidyapat Z-3,		<b>As per Site:</b>	58.66 Hrs	
<b>Lowering Depth(mtr):</b>	110.5	<b>Cumm Gravel(cumt)</b>	<b>As per DPR:</b>	80.00	
<b>Lowering Date :</b>	02.11.2023	<b>Cumm Gravel(cumt)</b>	<b>As per Site:</b>	65.67	
<b>SI No</b>	<b>Date</b>	<b>Start Time</b>	<b>End Time</b>	<b>Total Hours</b>	<b>Remarks</b>
1	30-Nov-23	08:35:00	09:45:00	1:10	
2		10:10:00	11:32:00	1:22	
3		12:00:00	13:31:00	1:31	
4		14:10:00	15:11:00	1:01	
5	1-Dec-23	07:29:00	08:54:00	1:25	
6		10:22:00	11:31:00	1:09	
7		12:14:00	13:28:00	1:14	
8		14:23:00	15:10:00	0:47	
9		16:21:00	17:13:00	0:52	
10	2-Dec-23	07:35:00	08:45:00	1:10	
11		10:19:00	11:30:00	1:11	
12		12:11:00	13:30:00	1:19	
13		14:20:00	15:12:00	0:52	
14		16:20:00	17:15:00	0:55	
15	3-Dec-23	07:19:00	08:47:00	1:28	
16		10:10:00	11:32:00	1:22	
17		12:00:00	13:20:00	1:20	
18		14:05:00	15:10:00	1:05	
19		16:13:00	17:20:00	1:07	
20	4-Dec-23	07:25:00	08:50:00	1:25	
21		10:02:00	11:30:00	1:28	
22		12:03:00	13:30:00	1:27	
23		14:00:00	15:15:00	1:15	
24		16:00:00	17:22:00	1:22	
25	5-Dec-23	08:29:00	09:56:00	1:27	
26		10:00:00	11:32:00	1:32	
27		13:00:00	14:28:00	1:28	
28		16:22:00	17:30:00	1:08	
29		18:00:00	19:31:00	1:31	
30	6-Dec-23	09:00:00	10:12:00	1:12	
31		11:03:00	12:26:00	1:23	
32		14:04:00	15:29:00	1:25	
33		16:00:00	17:13:00	1:13	
34		18:29:00	19:35:00	1:06	





**M/S VSAIPPL-SMC JV, Ghazipur (U.P)**

<b>Job Code:</b>	VIRNO	<b>Compressor unit Capacity</b>	<b>As per DPR:</b>	600PSI	
<b>Block:</b>	MARDAH		<b>As per Site:</b>	250 PSI	
<b>Scheme</b>	Bharsar REORGANISATION WSS	<b>Compressor unit Hours</b>	<b>As per DPR:</b>	60.00	
<b>GP</b>	Jagdispur Vidyapat Z-3,		<b>As per Site:</b>	58.66 Hrs	
<b>Lowering Depth(mtr):</b>	110.5	<b>Cumm Gravel(cumt)</b>	<b>As per DPR:</b>	80.00	
<b>Lowering Date :</b>	02.11.2023		<b>As per Site:</b>	65.67	
<b>SI No</b>	<b>Date</b>	<b>Start Time</b>	<b>End Time</b>	<b>Total Hours</b>	<b>Remarks</b>
35	7-Dec-23	10:05:00	11:10:00	1:05	
36		12:03:00	12:50:00	0:47	
37		13:33:00	14:40:00	1:07	
38		15:00:00	16:18:00	1:18	
39		17:00:00	18:24:00	1:24	
40	8-Dec-23	08:04:00	09:14:00	1:10	
41		10:13:00	11:40:00	1:27	
42		13:32:00	14:10:00	0:38	
43		15:20:00	16:26:00	1:06	
44		17:30:00	18:25:00	0:55	
45	9-Dec-23	09:20:00	10:30:00	1:10	
46		11:05:00	12:01:00	0:56	
47		14:10:00	15:30:00	1:20	
48		16:06:00	17:10:00	1:04	
49		18:34:00	19:05:00	0:31	
		<b>Total</b>	<b>58:40</b>		
		<b>Total (Hrs)</b>	<b>58.66 Hrs</b>		
					
<b>Site Incharge</b>	<b>TPIA</b>	<b>Junior Engineer</b>	<b>Assistant Engineer</b>		
M/S VSAIPPL-SMC JV, Ghazipur (U.P)	M/s Medhaj Techno Concept Pvt. Ltd., Ghazipur	Construction Division Office(E/M) ,U.P.Jal Nigam(Rural),Varanasi			





# QA Testing Laboratories Pvt. Ltd.

(Govt. Approved Testing Laboratories)

B-76, Sector-64, Gautam Buddha Nagar, Noida-201301 (Uttar Pradesh)

Quality Assurance

Tel.: +91-120-4133953 • Mobile: +91-8287945370 • E-mail: admin@qatestinglaboratories.com

Website: www.qatestinglaboratories.com

CIN : U51100UP2018PTC108293 • GSTIN : 09AAACQ5609C1ZN



IAS-ANZ



M54009131N



ISO 9001:2015, 14001:2015, 45001:2018 & ISO/IEC 17025:2017 Accredited & BIS Recognised Laboratory

## TEST CERTIFICATE

(This Certificate is not Valid without Hologram)



Test Report No : QAL/WT/240103002512 Issue Date : 09/01/2024  
Sample Name: : Tube Well Water Sample Received On : 03/01/2024  
Sample Code : - Reference No : VSAIPPL/WT/UPJN/2023-24/59  
Issued To : VSAIPPL-SMC JV Sampling Date : 03/01/2024  
10, Floor, APIIC Building, Type III,IE, Prashanth Nagar, Sampling Quantity : 2Ltr.  
Kukatpally, Hyderabad 500072 Batch No./Lot No. : NA  
Sample Submitted By : VSAIPPL-SMC JV Date of Mfg. : NS  
Mfg. By : NA Date of Exp. : NS  
Sample Description : Physical, Chemical & Heavy Metal Date of Starting : 03/01/2024  
Location : D.-Ghazipur B-Birno GP-Jagdishpur Vidhayapat Date of Completion : 09/01/2024

S.No.	Test Parameter	Units	Results	Specification as per IS:10500:2012		Test Method
				Acceptable Limit	Permissible Limit	
1	Color	Hazen	1	5 max.	15 max.	IS : 3025( P-4)
2	Turbidity	NTU	0.3	1 max.	5 max.	IS : 3025( P-10)
3	pH value at 25°C	-	7.25	6.5-8.5	No Relaxation	IS : 3025 (P-11)
4	Total Hardness as CaCO3	mg/l	169	200 max	600 max.	IS : 3025 (P-21)
5	Calcium (as Ca)	mg/l	31.2	75 max	200 max	IS : 3025 (P-40)
6	Iron (as Fe)	mg/l	0.030	1 max	-	IS : 3025 (P-53)
7	Magnesium (as Mg)	mg/l	22.1	30 max	100 max	IS : 3025 (P-46)
8	Chloride (as Cl)	mg/l	26.0	250 max.	1000 max.	IS : 3025 (P-32)
9	Free Residual Chlorine	mg/l	Nil	0.2 max.	1 Max	IS : 3025 (P-26)
10	Sulphates (as SO4)	mg/l	8.6	200 max.	400 max.	IS : 3025 (P-24)
11	Total Alkalinity (as CaCO3)	mg/l	106	200 max.	600 max.	IS : 3025 (P-23)
12	Fluoride (as F)	mg/l	0.032	1 max.	1.5 max.	IS : 3025 (P-60)
13	Total Dissolved Solid (TDS)	mg/l	395	500 max.	2000 max.	IS : 3025 (P-16)
14	Total Coliform Bacteria	MPN/10 0 ml	Absent	Shall not be detectable in any 100 ml sample	Shall not be detectable in any 100 ml sample	IS : 1622
15	E coli	MPN/10 0 ml	Absent	Shall not be detectable in any 100 ml sample	Shall not be detectable in any 100 ml sample	IS : 1622

SAMPLE COLLECTED BY US

\*\*\*End of Report\*\*\*

Upendra Kumar  
Technical manager  
Authorized By (Sign & Stamp):

Dileep Kumar  
Quality Manager  
Approved By (Sign & Stamp):

**Note:** a) This report is not reproduced wholly or in partially and forbidden to be used as an evidence in the court of law and ought not be used in any advertisement media without our special permission in writing. b) The data reported in this TEST CERTIFICATE are valid at the time of and under the stipulated conditions of measurement and the test results are applicable to those items of product which have been tested and do not apply to the other products even though declared to be identical. c) Except by special arrangement, the test items will not be retained by the company not more than one month. d) Report refers to the sample received by M/s QA Testing Laboratories Pvt. Ltd. e) This report is valid for the tested sample only.





# QA Testing Laboratories Pvt. Ltd.

(Govt. Approved Testing Laboratories)

B-76, Sector-64, Gautam Buddha Nagar, Noida-201301 (Uttar Pradesh)

Tel.: +91-120-4133953 • Mobile: +91-8287945370 • E-mail: admin@qatestinglaboratories.com

Website : www.qatestinglaboratories.com

CIN : U51100UP2018PTC108293 • GSTIN : 09AAACQ5609C1ZN

IAS-ANZ



M54009131N



ISO 9001:2015, 14001:2015, 45001:2018 & ISO/IEC 17025:2017 Accredited & BIS Recognised Laboratory

## TEST CERTIFICATE (This Certificate is not Valid without Hologram)



Test Report No : QAL/WT/240103002512

Issue Date : 09/01/2024

Sample Name: : Tube Well Water

Sample Received On : 03/01/2024

S.No.	Test Parameter	Units	Results	Specification as per IS:10500:2012		Test Method
				Acceptable Limit	Permissible Limit	
16	Nitrate (as NO <sub>3</sub> )	mg/l	0.32	45 max	No Relaxation	IS : 3025 (P-34)
17	Copper (as Cu)	mg/l	ND	0.05 max	1.5 max	IS : 3025 (P-42)
18	Manganese (as Mn)	mg/l	0.020	0.1 max	0.3 max	IS : 3025 (P-59)
19	Mercury (as Hg)	mg/l	ND	0.001 max	No Relaxation	IS : 3025 (P-48)
20	Cadmium (as Cd)	mg/l	ND	0.003 max	No Relaxation	IS : 3025 (P-41)
21	Selenium (as Se)	mg/l	ND	0.01 max	No Relaxation	IS : 3025 (P-56)
22	Total Arsenic (as As)	mg/l	ND	0.01 max	0.05 max	IS : 3025 (P-37)
23	Lead (as Pb)	mg/l	ND	0.01 max	No Relaxation	IS : 3025 (P-47)
24	Zinc (as Zn)	mg/l	0.028	5 max	15 max	IS : 3025 (P-49)
25	Cobalt	mg/l	ND	-	-	IS : 3025 (P-2)
26	Aluminium (as Al)	mg/l	ND	0.03 max	0.2 max	IS : 3025 (P-55)
27	Boron (as B)	mg/l	0.012	0.5 max	1.0 max	IS : 3025 (P-57)
28	Barium (as Ba)	mg/l	0.014	0.7 max	No Relaxation	IS:13428
29	Silver (as Ag)	mg/l	ND	0.1 max	No Relaxation	IS:13428
30	Molybdenum (as Mo)	mg/l	ND	0.07 max	No Relaxation	IS : 3025 (P-2)
31	Nickel (as Ni)	mg/l	ND	0.02 max	No Relaxation	IS : 3025 (P-54)
32	Total Chromium (as Cr)	mg/l	ND	0.05 max	No Relaxation	IS : 3025 (P-52)
33	Antimony (as Sb)	mg/l	ND	-	-	IS :3025 (P-2)

Note: ND= Not Detected

SAMPLE COLLECTED BY US

\*\*\*End of Report\*\*\*

Upendra Kumar  
Technical manager

Authorized By (Sign & Stamp):

Dileep Kumar  
Quality Manager

Approved By (Sign & Stamp):

Note: a) This report is not reproduced wholly or in partially and forbidden to be used as an evidence in the court of law and ought not to be used in any advertisement media without our special permission in writing. b) The data reported in this TEST CERTIFICATE are valid at the time of and under the stipulated conditions of measurement and the test results are applicable to those items of product which have been tested and do not apply to the other products even though declared to be identical. c) Except by special arrangement, the test items will not be retained by the company not more than one month. d) Report refers to the sample received by M/s QA Testing Laboratories Pvt. Ltd. e) This report is valid for the tested sample only.