


M/S VSAIPPL-SMC JV, Ghazipur (U.P)
Actual Strata Chart of ARSADPUR(JANGIPUR) REORGANISATION WSS,BLOCK - VIRNO,ZONE - 6,GRAM
PANCHAYAT - PARMANANDPUR
Under Jal Jeevan Mission,District- Ghazipur(U.P.)

PHYSICAL STRATA			
S.No.	BGL in meter		Formation
	From	to	
1	0	10	Clay
2	10	22	Kankad Ckay
3	22	49	Very Fine Sand
4	49	90	Kankad Clay
5	90	110	Kankad with Very Fine
6	110	150	Kankad Clay
7	150	188	Sandy Clay
8	188	204	Kankad

Logging Report
15.06.2023

S.N.	Depth Range	Thickn ess	Remark
1	25 - 38	13	Good
2	40 - 45	5	Good
3	92 - 98	6	Good
4	101 - 105	4	Good

1. The water quality for these zones is given as per our logger's response and calibration.
 2. Ground water quality is deteriorated from 116 m below ground level till depth log.

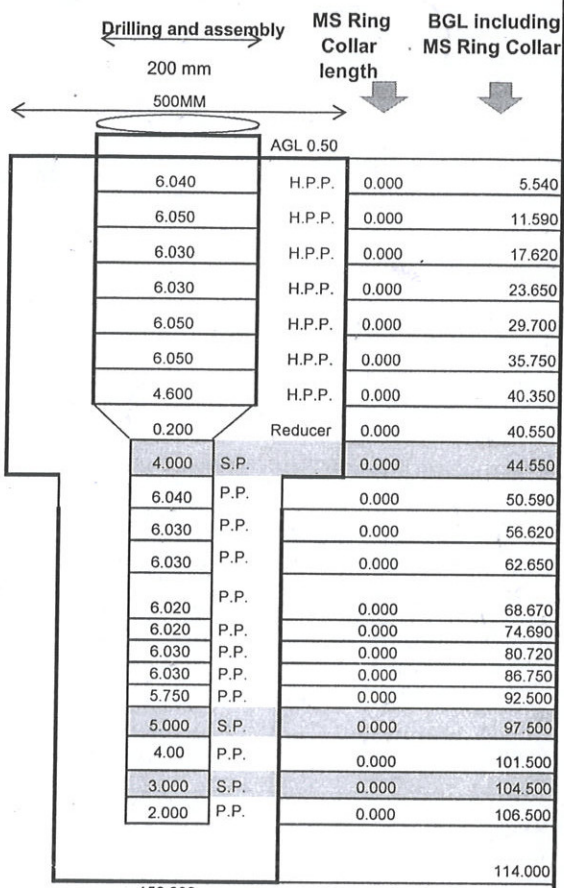

DETAILS	AS PER DPR	ACTUAL
1 Proposed Discharge	400.000 LPM	
2 Clear Depth of bore 600mm	0 Mbgl	
3 Clear Depth of bore 500mm	65 Mbgl	45.000 Mbgl
4 Clear Depth of bore 450mm	360 Mbgl	204.000 Mbgl
5 Plane pipe 300MM	0 m	0.000 m
6 Plane pipe 200MM	60 m	40.850 m
7 Plane pipe 150MM	258 m	53.950 m
8 Reducer 200x150 MM		0.200 m
9 Slotted pipe 300MM	0 m	0.000 m
10 Slotted pipe 200MM	0 m	0.000 m
11 Slotted pipe 150MM	12 m	12.000 m
12 Date of lowering		20.06.2023



Jap
 (.....)
TPIA
 Medhaj Techno Concept Pvt.
 Ltd., Ghazipur

A *N* *Sar*
 (A.Srivastava) (Nitish Kumar) (Adarsh Verma)
 Junior Engineer Assistant Engineer Exe. Engineer
 Division Office(E/M) ,U.P.Jal Nigam(Rural),Varanasi

GEOPHYSICAL BOREHOLE LOGGING REPORT

SOILTECH
(INDIA) PRIVATE LIMITED
GROUND ENGINEERS & CONSULTANTS

Ref: SIPL/Elog/2023/ 96

Date 16-06-2023

SITE Gp-Parmanandpur
Block Biron
District Ghazipur
State Uttar Pradesh
Date of Logging 15th June 2023
Logging Depth ~~204~~
Drilling Depth 360 (As reported by driller)
Latitude 25.659414
Longitude 83.588499
Rm: 16.2 ~~Ohm-m~~ **Rw:** 12.6 ~~Ohm-m~~

Borehole Drilled by VSAIPPL SMC JV

Based on the interpretation of Geophysical Logging Record Parameter of Self Potential (SP), Long Normal (N-64"), Short Normal (N-16"), Natural Gamma and single point Resistance (SPR) log data, the given borehole formation Granular zone deciphered with respect of salinity and Resistivity.

Sr.No.	Depth Range (Below Ground Level)		Thickness (Meters)	Quality of aquifer Water	Remarks
	Depth From	Depth to			
1	25	38	13	Good	
2	40	45	5	Good	
3	92	98	6	Good	
4	101	105	4	Good	

Notes

1. The water quality for these zones is given as per our logger's response and calibration
2. Ground water quality is deteriorated from 116 m below ground level till depth log

Verified as per
logs provided

GSL
17/06/23.

For Soiltech India Pvt. Ltd.

M/S VSAIPPL-SMC JV, Ghazipur (U.P.)

Regd. Office-#10, APIIC Building, Type-III, I.E, Prashanth Nagar Kukatpally, Hyderabad-500072

Under Jal Jivan Mission, District- Ghazipur(U.P.)

Test Report of Permanandpur GP (Zone-6, TW-1) Tubewell under Arsadpur Jangipur WSS, Block-Jangipur Devlopment By 250 PSI Air Compressor

Size of tube well (mm): 200 X 150 RPM 1300

Static water level (m): 12.00 Discharge by-90 'V' notch (Rectangular)

Depth of TW (m): 106.500 Required Discharge- 400 Date of testing 19-08-2023

S. N.	Pressure in kg/cm ²		Depression		Depth of air line at the time of testing (m)	Discharge by 'V' Notch		Sand content in P.P.M.				
	Starting Pressure	Running Pressure	In kg/cm ²	In mtr.		Inch	LPM	At start	After 5 min	After 10 min	After 15 min	After 20 min
1	8.80	8.10	0.70	7.00	102.00	6 1/2	917	6400	3500	3300	3100	3000
2	7.90	7.30	0.60	6.00	93.00	6	751	5600	3100	2900	2700	2600
3	2.70	2.20	0.50	5.00	41.00	5	476	4900	2800	2600	2400	2200

Remark- Recommended for further development by O.P. Unit



(.....)
 (Abhishek Srivastava)
 Junior Engineer

(.....)
 (Nitish Kumar)
 Assistant Engineer

(.....)
 (Adarsh Verma)
 Executive Engineer

Medhaj Techno Concept Pvt.
 Ltd., Ghazipur

Division Office (E&M), U.P. Jal Nigam(Rural), Varanasi






M/S VSAIPPL-SMC JV, Ghazipur (U.P)

Job Code:		Compressor unit	As per DPR:	600 PSI	
Block:	VIRNO	Capacity	As per Site:	250 PSI	
Scheme	ARSADPUR (JANGIPUR)	Compressor unit	As per DPR:	60	
GP	PARMANANDPUR, ZONE 6	Hours	As per Site:	58:00	
Lowering Depth(mtr):	106.500	Cumm			
Lowering Date :	20-Jun-23	Gravel(cumt)	As per DPR:	80	
		Cumm			
		Gravel(cumt)	As per Site:	48.81	
SI No	Date	Start Time	End Time	Total Hours	Remarks
1	11-Aug-23	7:39 AM	8:00 AM	0:21	
2		10:30 AM	11:34 AM	1:04	
3		1:00 PM	1:31 PM	0:31	
4		2:10 PM	3:20 PM	1:10	
5		4:10 PM	5:20 PM	1:10	
6	12-Aug-23	7:29 AM	8:44 AM	1:15	
7		10:00 AM	11:30 AM	1:30	
8		12:00 PM	1:21 PM	1:21	
9		2:00 PM	3:20 PM	1:20	
10		4:00 PM	5:20 PM	1:20	
11	13-Aug-23	8:29 AM	9:54 AM	1:25	
12		10:00 AM	11:25 AM	1:25	
13		1:00 PM	2:30 PM	1:30	
14		4:20 PM	5:50 PM	1:30	
15		6:00 PM	7:30 PM	1:30	
16		9:00 AM	10:20 AM	1:20	

M/S VSAIPPL-SMC JV,Ghazipur (U.P)

Job Code:		Compressor unit	As per DPR:	600 PSI	
Block:	VIRNO	Capacity	As per Site:	250 PSI	
Scheme	ARSADPUR (JANGIPUR)	Compressor unit	As per DPR:	60	
GP	PARMANANDPUR,ZONE 6	Hours	As per Site:	58:00	
Lowering Depth(mtr):	106.500	Cumm			
Lowering Date :	20-Jun-23	Gravel(cumt)	As per DPR:	80	
		Cumm			
		Gravel(cumt)	As per Site:	48.81	
SI No	Date	Start Time	End Time	Total Hours	Remarks
17	14-Aug-23	11:00 AM	12:16 PM	1:16	
18		2:00 PM	3:25 PM	1:25	
19		4:00 PM	5:10 PM	1:10	
20		6:29 PM	7:44 PM	1:15	
21	15-Aug-23	10:00 AM	11:20 AM	1:20	
22		12:00 PM	12:50 PM	0:50	
23		1:30 PM	2:50 PM	1:20	
24		3:00 PM	4:06 PM	1:06	
25		5:00 PM	6:00 PM	1:00	
26	16-Aug-23	8:00 AM	9:14 AM	1:14	
27		10:10 AM	11:20 AM	1:10	
28		1:30 PM	2:40 PM	1:10	
29		3:20 PM	4:46 PM	1:26	
30		5:30 PM	6:51 PM	1:21	
31		8:00 AM	9:24 AM	1:24	
32		10:10 AM	11:30 AM	1:20	

M/S VSAIPPL-SMC JV,Ghazipur (U.P)

Job Code:		Compressor unit	As per DPR:	600 PSI	
Block:	VIRNO	Capacity	As per Site:	250 PSI	
Scheme	ARSADPUR (JANGIPUR)	Compressor unit	As per DPR:	60	
GP	PARMANANDPUR,ZONE 6	Hours	As per Site:	58:00	
Lowering Depth(mtr):	106.500	Cumm			
Lowering Date :	20-Jun-23	Gravel(cumt)	As per DPR:	80	
		Cumm			
		Gravel(cumt)	As per Site:	48.81	
SI No	Date	Start Time	End Time	Total Hours	Remarks
33	17-Aug-23	1:30 PM	2:50 PM	1:20	
34		3:20 PM	4:46 PM	1:26	
35		5:30 PM	6:51 PM	1:21	
36	18-Aug-23	9:00 AM	10:10 AM	1:10	
37		11:00 AM	12:16 PM	1:16	
38		2:00 PM	3:30 PM	1:30	
39	19-Aug-23	4:00 PM	5:30 PM	1:30	
40		6:29 PM	7:54 PM	1:25	
41		9:00 AM	10:35 AM	1:35	
42	19-Aug-23	11:00 AM	12:33 PM	1:33	
43		2:00 PM	3:30 PM	1:30	
44		4:00 PM	5:30 PM	1:30	
45		6:29 PM	7:54 PM	1:25	
			Total	58:00	
					
Site Incharge	TPIA	Junior Engineer	Assistant Engineer	Exe. Engineer	
M/S VSAIPPL-SMC JV,Ghazipur (U.P)	M/s Medhaj Techno Concept Pvt. Ltd.,Ghazipur	Construction Division Office(E/M) ,U.P.Jal Nigam(Rural),Varanasi			

M/S VSAIPPL-SMC JV, Ghazipur (U.P.)

Regd. Office-#10, APIIC Building, Type-III, I.E, Prashanth Nagar Kukatpally, Hyderabad-500072

Under Jal Jivan Mission, District- Ghazipur(U.P.)

Yield Test Report Of T.W at Parmanandpur GP (Zone-6, TW-1) Tubewell under Arsadpur(Jangipur) Village

WSS, Block-Birno by 1 Cusec O.P. Unit

Size of Ventury 4" X 3" Column Pipe Lowered(m): 30.00

Static water level(m): 12.20 Required Discharge(LPM)- 400 LPM Date: 30-12-2023

S.N.	Discharge		Running Water Level (m)	Depression (m)	Sand content in P.P.M.				
	Inch	LPM			At start	After 5 min	After 10 min	After 15 min	After 20 min
1	33.00	916	19.00	6.80	650	300	200	150	100
2	20.00	708	18.10	5.90	350	200	150	100	50
3	6.00	409	16.10	3.90	100	50	Tr	Tr	Cl

Remark- Recommended discharge 400 LPM L.P.M. at 3.9 m depression after running 20 minute bypass.

(.....) 0
Company Repr. (.....) (Abhishek Srivastava) (Nitish Kumar) (Adarsh Verma)
TPIA Junior Engineer Assistant Engineer Executive Engineer
Medhaj Techno Concept Pvt. Division Office (E&M), U.P. Jal Nigam(Rural), Varanasi
Ltd., Ghazipur

(.....)

(.....)

(.....)





(.....)

(.....)

M/S VSAIPPL-SMC JV, Ghazipur (U.P)

Block:	VIRNO		Op unit Capacity	As per DPR:	1 cusec
				As per Site:	1 cusec
Scheme	ARSADPUR(JANGIPUR) REORGANISATION WSS		Op unit Hours	As per DPR:	100
				As per Site:	98.63 Hrs
GP	Parmanandpur Z-6,T.W-1		Compressor Testing Date :		19-08-2023
SI No	Date	Start Time	End Time	Total Hours	Remarks
1	19-12-2023	08:21:00	09:54:00	1:33	
2		10:24:00	11:52:00	1:28	
3		12:20:00	13:38:00	1:18	
4		14:43:00	16:12:00	1:29	
5		17:04:00	18:47:00	1:43	
6		19:38:00	21:28:00	1:50	
7		22:12:00	23:30:00	1:18	
8	20-12-2023	00:10:00	01:47:00	1:37	
9		08:05:00	09:54:00	1:49	
10		10:15:00	11:36:00	1:21	
11		12:28:00	13:43:00	1:15	
12		14:47:00	16:14:00	1:27	
13		17:11:00	18:48:00	1:37	
14		19:40:00	21:30:00	1:50	
15	22:00:00	23:45:00	1:45		
16	21-12-2023	00:14:00	01:45:00	1:31	
17		08:25:00	09:57:00	1:32	
18		10:24:00	11:54:00	1:30	
19		12:20:00	13:55:00	1:35	
20		15:47:00	17:18:00	1:31	
21		18:05:00	19:23:00	1:18	
22		19:40:00	21:30:00	1:50	
23	22-12-2023	08:25:00	09:54:00	1:29	
24		10:23:00	11:54:00	1:31	
25		12:20:00	13:40:00	1:20	
26		14:46:00	16:10:00	1:24	
27		17:02:00	18:45:00	1:43	
28		19:40:00	21:30:00	1:50	
29		22:10:00	23:30:00	1:20	
30	23-12-2023	00:10:00	01:45:00	1:35	
31		08:45:00	09:40:00	0:55	
32		10:41:00	11:53:00	1:12	
33		12:50:00	13:21:00	0:31	
34		15:58:00	17:18:00	1:20	
35		18:02:00	19:11:00	1:09	
36		19:40:00	20:30:00	0:50	
37	24-12-2023	08:57:00	09:52:00	0:55	
38		10:34:00	11:53:00	1:19	
39		12:53:00	13:25:00	0:32	
40		15:56:00	17:18:00	1:22	
41		18:02:00	19:10:00	1:08	
42		19:45:00	20:40:00	0:55	
43	25-12-2023	08:15:00	09:40:00	1:25	
44		10:44:00	11:50:00	1:06	
45		12:50:00	13:20:00	0:30	
46		15:56:00	17:18:00	1:22	
47		18:02:00	19:10:00	1:08	
48		19:40:00	20:34:00	0:54	

M/S VSAIPPL-SMC JV, Ghazipur (U.P)

Block:	VIRNO		Op unit Capacity	As per DPR:	1 cusec
				As per Site:	1 cusec
Scheme	ARSADPUR(JANGIPUR) REORGANISATION WSS		Op unit Hours	As per DPR:	100
				As per Site:	98.63 Hrs
GP	Parmanandpur Z-6,T.W-1		Compressor Testing Date :		19-08-2023
SI No	Date	Start Time	End Time	Total Hours	Remarks
49	26-12-2023	08:55:00	10:16:00	1:21	
50		10:44:00	11:55:00	1:11	
51		12:40:00	13:50:00	1:10	
52		15:56:00	17:26:00	1:30	
53		18:12:00	19:20:00	1:08	
54		19:40:00	21:10:00	1:30	
55	27-12-2023	08:45:00	10:10:00	1:25	
56		10:45:00	11:50:00	1:05	
57		12:50:00	14:20:00	1:30	
58		15:46:00	17:16:00	1:30	
59		18:02:00	19:10:00	1:08	
60		19:50:00	21:18:00	1:28	
61	28-12-2023	08:35:00	10:05:00	1:30	
62		10:46:00	11:55:00	1:09	
63		12:46:00	14:12:00	1:26	
64		15:46:00	17:16:00	1:30	
65		18:12:00	19:20:00	1:08	
66		19:40:00	21:04:00	1:24	
67	29-12-2023	08:35:00	10:05:00	1:30	
68		10:44:00	11:55:00	1:11	
69		12:42:00	14:14:00	1:32	
70		15:46:00	17:16:00	1:30	
71		18:12:00	19:20:00	1:08	
72	30-12-2023	08:35:00	10:15:00	1:40	
73		10:44:00	11:56:00	1:12	
			Total	98:38	
			Total (Hrs)	98.63 Hrs	
					
Site Incharge	TPIA	Junior Engineer	Assistant Engineer	Exe. Engineer	
M/S VSAIPPL-SMC JV, Ghazipur (U.P)	M/s Medhaj Techno Concept Pvt. Ltd., Ghazipur	Construction Division Office(E/M) , U.P. Jal Nigam(Rural), Varanasi			



QA Testing Laboratories Pvt. Ltd.

(Govt. Approved Testing Laboratories)

B-76, Sector-64, Gautam Buddha Nagar, Noida-201301 (Uttar Pradesh)

Quality Assurance

Tel.: +91-120-4133953 • Mobile: +91-8287945370 • E-mail: admin@qatestinglaboratories.com

Website : www.qatestinglaboratories.com

CIN : U51100UP2018PTC108293 • GSTIN : 09AAACQ5609C1ZN

IAS-ANZ



M5400913IN



As per IS: 9001:2015, 14001:2015, 45001:2018 & ISO/IEC 17025:2017 Accredited & BIS Recognised Laboratory

TEST CERTIFICATE

(This Certificate is not Valid without Hologram)



Test Report No : QAL/WT/240122002640
Sample Name: : Tube Well Water
Sample Code : -
Issued To : VSAIPPL-SMC JV
District-Ghazipur.

Issue Date : 29/01/2024
Sample Received On : 22/01/2024
Reference No : VAIPPL/EE/UPJN/23-24/66
Sampling Date : 22/01/2024
Sampling Quantity : 2 Ltr.
Batch No./Lot No. : NA
Date of Mfg. : NS
Date of Exp. : NS
Date of Starting : 22/01/2024
Date of Completion : 29/01/2024

Sample Submitted By : VSAIPPL-SMC JV
Mfg. By : NA
Sample Description : Physical, Chemical & Heavy Metals Of Water Sample
Location : Block-Birno GP-Pramanandpur

S.No.	Test Parameter	Units	Results	Specification as per IS:10500:2012		Test Method
				Acceptable Limit	Permissible Limit	
1	Color	Hazen	2	5 max.	15 max.	IS : 3025(P-4)
2	Turbidity	NTU	0.3	1 max.	5 max.	IS : 3025(P-10)
3	pH value at 25°C	-	7.54	6.5-8.5	No Relaxation	IS : 3025 (P-11)
4	Total Hardness as CaCO3	mg/l	172	200 max	600 max.	IS : 3025 (P-21)
5	Calcium (as Ca)	mg/l	47.3	75 max	200 max	IS : 3025 (P-40)
6	Iron (as Fe)	mg/l	0.034	1 max	-	IS : 3025 (P-53)
7	Magnesium (as Mg)	mg/l	13.6	30 max	100 max	IS : 3025 (P-46)
8	Chloride (as Cl)	mg/l	22	250 max.	1000 max.	IS : 3025 (P-32)
9	Free Residual Chlorine	mg/l	Nil	0.2 max.	1 Max	IS : 3025 (P-26)
10	Sulphates (as SO4)	mg/l	10.3	200 max.	400 max.	IS : 3025 (P-24)
11	Total Alkalinity (as CaCO3)	mg/l	118	200 max.	600 max.	IS : 3025 (P-23)
12	Fluoride (as F)	mg/l	0.040	1 max.	1.5 max.	IS : 3025 (P-60)
13	Total Dissolved Solid (TDS)	mg/l	412	500 max.	2000 max.	IS : 3025 (P-16)
14	Total Coliform Bacteria	MPN/10 0 ml	Absent	Shall not be detectable in any 100 ml sample	Shall not be detectable in any 100 ml sample	IS : 1622
15	E coli	MPN/10 0 ml	Absent	Shall not be detectable in any 100 ml sample	Shall not be detectable in any 100 ml sample	IS : 1622

SAMPLE COLLECTED BY US

End of Report

Upendra Kumar
Technical manager
Authorized By (Sign & Stamp):

Dilshan Kumar
Quality Manager
Approved By (Sign & Stamp):

Note: a) This report is not reproduced wholly or in partially and forbidden to be used as an evidence in the court of law and ought not be used in any advertisement media without our special permission in writing. b) The data reported in this TEST CERTIFICATE are valid at the time of and under the stipulated conditions of measurement and the test results are applicable to those items of product which have been tested and do not apply to the other products even though declared to be identical. c) Except by special arrangement, the test items will not be retained by the company not more than one month. d) Report refers to the sample received by M/s QA Testing Laboratories Pvt. Ltd. e) This report is valid for the tested sample only.



QA Testing Laboratories Pvt. Ltd.

(Govt. Approved Testing Laboratories)

B-76, Sector-64, Gautam Buddha Nagar, Noida-201301 (Uttar Pradesh)

Quality Assurance

Tel.: +91-120-4133953 • Mobile: +91-8287945370 • E-mail: admin@qatestinglaboratories.com

Website : www.qatestinglaboratories.com

CIN : U51100UP2018PTC108293 • GSTIN : 09AAACQ5609C1ZN

IAS-ANZ



M5400913IN



ISO 9001:2015, 14001:2015, 45001:2018 & ISO/IEC 17025:2017 Accredited & BIS Recognised Laboratory

TEST CERTIFICATE

(This Certificate is not Valid without Hologram)



Test Report No : QAL/WT/240122002640

Issue Date : 29/01/2024

Sample Name: : Tube Well Water

Sample Received On : 22/01/2024

S.No.	Test Parameter	Units	Results	Specification as per IS:10500:2012		Test Method
				Acceptable Limit	Permissible Limit	
16	Nitrate (as NO3)	mg/l	0.40	45 max	No Relaxation	IS : 3025 (P-34)
17	Copper (as Cu)	mg/l	ND	0.05 max	1.5 max	IS : 3025 (P-42)
18	Manganese (as Mn)	mg/l	0.018	0.1 max	0.3 max	IS : 3025 (P-59)
19	Mercury (as Hg)	mg/l	ND	0.001 max	No Relaxation	IS : 3025 (P-48)
20	Cadmium (as Cd)	mg/l	ND	0.003 max	No Relaxation	IS : 3025 (P-41)
21	Selenium (as Se)	mg/l	ND	0.01 max	No Relaxation	IS : 3025 (P-56)
22	Total Arsenic (as As)	mg/l	ND	0.01 max	0.05 max	IS : 3025 (P-37)
23	Lead (as Pb)	mg/l	ND	0.01 max	No Relaxation	IS : 3025 (P-47)
24	Zinc (as Zn)	mg/l	0.028	5 max	15 max	IS : 3025 (P-49)
25	Cobalt	mg/l	ND	-	-	IS : 3025 (P-2)
26	Aluminium (as Al)	mg/l	ND	0.03 max	0.2 max	IS : 3025 (P-55)
27	Boron (as B)	mg/l	0.014	0.5 max	1.0 max	IS : 3025 (P-57)
28	Barium (as Ba)	mg/l	0.018	0.7 max	No Relaxation	IS:13428
29	Silver (as Ag)	mg/l	ND	0.1 max	No Relaxation	IS:13428
30	Molybdenum (as Mo)	mg/l	ND	0.07 max	No Relaxation	IS : 3025 (P-2)
31	Nickel (as Ni)	mg/l	ND	0.02 max	No Relaxation	IS : 3025 (P-54)
32	Total Chromium (as Cr)	mg/l	ND	0.05 max	No Relaxation	IS : 3025 (P-52)
33	Antimony (as Sb)	mg/l	ND	-	-	IS :3025 (P-2)

Note: ND= Not Detected

SAMPLE COLLECTED BY US

End of Report

Upendra Kumar

Technical manager

Authorized By (Sign & Stamp):

Dileep Kumar

Quality Manager

Approved By (Sign & Stamp):

Note: a) This report is not reproduced wholly or in partially and forbidden to be used as an evidence in the court of law and ought not be used in any advertisement media without our special permission in writing. b) The data reported in this TEST CERTIFICATE are valid at the time of and under the stipulated conditions of measurement and the test results are applicable to those items of product which have been tested and do not apply to the other products even though declared to be identical. c) Except by special arrangement, the test items will not be retained by the company not more than one month. d) Report refers to the sample received by M/s QA Testing Laboratories Pvt. Ltd. e) This report is valid for the tested sample only.



VSAIPPL - SMC JV



Regd. Office : # 10, APIIC Building, Type - III, I.E, Prashanth Nagar Kukatpally, Hyderabad - 500072.
Email: vsainfraprojects@gmail.com. Phone: 040-40113158, 040-2307 8060

Ref. VSAIPPL-SMC JV/EE/UPJN2023-24/66

22nd Jan 2024

To

QA TESTING LABORATORIES PVT.LTD,
E-26/49, Transport agar, Near Parking No.9,
Luck now, Uttar Pradesh, 226012

Sub: Submission of Drinking water for Acidic & Non-Acidic test.

Dear Sir,

This is about the above-mentioned subject; we are submitting the Drinking water for acidic & non-acidic test for the following GP.

SN	District	Block	GP	Sample Source	Date Of Sampling
1.	Ghazipur	Barachawar	Karrimuddinpur zone-1 tw-1	Tube well Water	12-01-2024
2.	Ghazipur	Birno	Pramanandpur	Tube well Water	31-12-2023

For VSAIPPL-SMC (JV)



Authorized Signatory

CC TO:

1. Office of the Executive Engineer, (E&M) Divisional Office Varanasi,
2. M/S Medhaj Techno Concept Pvt Ltd. Ghazipur

QAL/WT/240122002639 to 2640