

May Begins With (C)

Lowering of T.W. Assembly at Aund Jungal T/w Bore

Drilling/Lowering - 18/120

T.W. Assembly Size - 300 x 150 mm

Bore Size - 550 x 500 mm

S.W.L. - 10 feet





Recommended Discharge - 900 L.P.M.

D.O.L. - 19/10/20

M/S Upendra Singh

Time	Depth (m)	Soil Type	Remarks	Time	Depth (m)	Soil Type	Remarks
10:00	15-22	7	Logging Report	6:00	59.53m		
11:00	25-32	7		6:00	59.68m		
	33-51	13		6:00			
	55-65	10		5:98			
	70-83	13		6:00			
12:00	90-100	10		5:99			
	105-112	7		5:99			
14:00	122-127	5		6:04			
				6:03			
				6:00			
15:00	0-14	clay	Strata as Per Actual	6:11			
16:00	14-32	M.Sand		4:70	10.81m		70.49m
	32-35	clay	6:02				
17:00	35-65	F. to M.Sand	6:02		12.04m		82.53m
	65-68	clay		6:12			
18:00	68-92	F. to M.Sand		1:85	7.97m		90.50m
	92-98	M.Sand	6:01				
19:00	99-104	clay	3:00		9.01m		99.51m
	104-113	F.Sand + Kankar		6:10	6.10m		105.61m
20:00	113-121	clay			6:01m		111.62m
	121-128	F.Sand		6:12	6.12m		117.74m
	128-135	clay					
					AGL (C)	0.50m	
							total 118.24m


CTOBER  
 5 12 19 26  
 6 13 20 27  
 7 14 21 28  
 1 8 15 22 29  
 2 9 16 23 30  
 3 10 17 24 31  
 4 11 18 25

 (Upendra Kumar) Contractor  
 (Sampurnanand) JE  
 (Babbar Yadav) AE  
 (Adarsh Verma) EE

Drilling/Louasing of T.W. Assembly at Parasri T/Us Prsli  
 Bore Size - 550 x 580 m.m.  
 S.W.L. - 6 feet  
 T.W. Assembly Size - 200 x 180 m.m.  
 Recommended Rise charge - 400 L.P.M.  
 D.O.L - 07/11/20

Logging Report

- 1. 22-28 → 6
- 2. 40-44 → 4
- 3. 50-58 → 8
- 4. 64-86 → 22
- 5. 97-110 → 13
- 6. 115-119 → 4

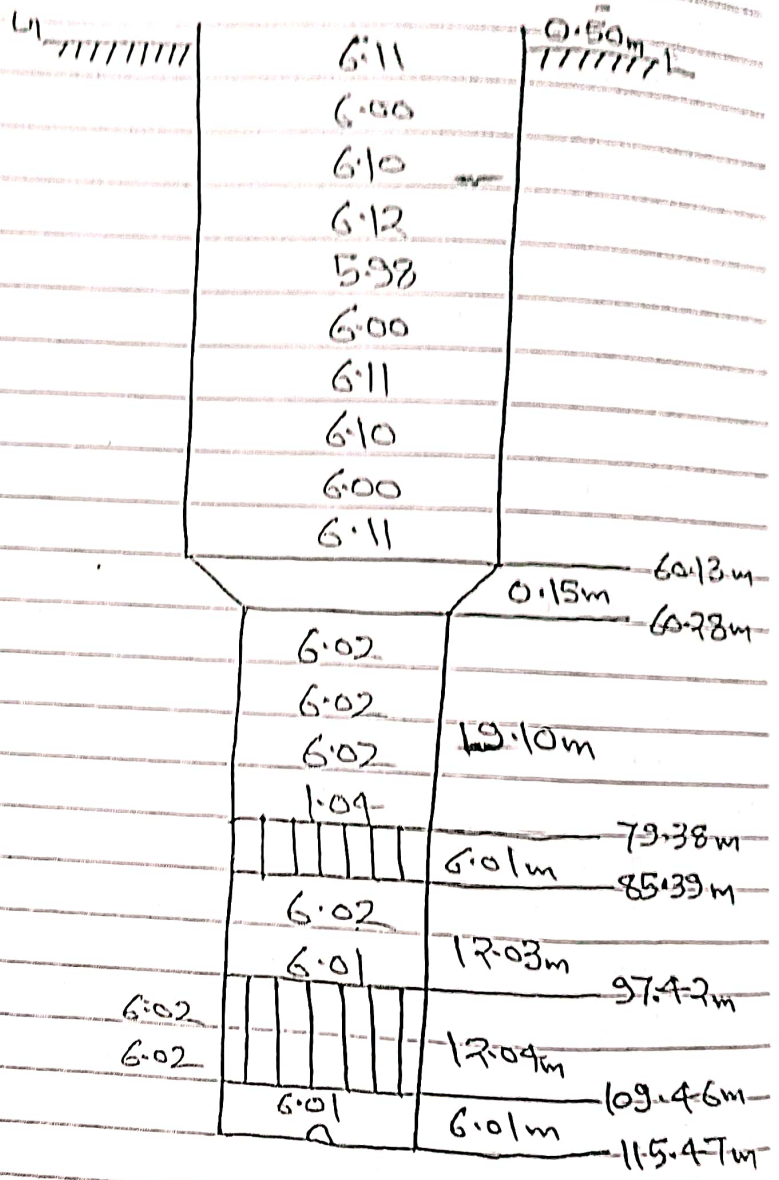

Strata as per Actual

- 0 - 20 clay
- 20 - 30 M. Sand
- 30 - 40 clay
- 40 - 45 M. Sand
- 45 - 50 clay
- 50 - 59 F. to M. Sand
- 59 - 65 clay
- 65 - 88 F. to M. Sand
- 88 - 95 clay
- 95 - 111 M. Sand + Kantkari
- 111 - 115 clay
- 115 - 120 Kantkari clay
- 120 - 135 clay

MEMBER

2	9	16	23
3	10	17	24
4	11	18	25
5	12	19	26
6	13	20	27
7	14	21	28
8	15	22	29

(Mstai Babash chaudhary) Contractor  
 (Sampuramand) J.E.  
 (Babban Yadav) M.F.  
 (Adarsh Verma) M.F.  
 Scanned with CamScanner

Lowering of T.W. Assembly at Sikra Bargah T.W. Bawali

Drilling/Lowering - 132/20

T.W. Assembly Size - 200X150mm

Bore Size - 550X500mm

Recommended Discharge - 450 L.P.M

S.W.L. - 5 feet

D.O.L. - 24/10/20

Logging Report.

1. 12-28 - 16m	6.12	0.50m	
2. 54-67 - 13m	6.00		
3. 72-86 - 14m	6.13		
4. 90-97 - 7m	6.13		
5. 104-114 - 10m	6.12		
6. 117-130 - 13m	6.12		
<u>Strata as Per Actual</u>			
0 - 10m clay	6.12		
10 - 30m M.Sand	6.10		
30 - 55m clay		0.15m	60-58m
55 - 64m M.Sand	6.01		60-73m
64 - 70m clay	6.01	18.04m	
70 - 85m F.to M.Sand	6.02		
85 - 89m clay		6.02m	78-77m
89 - 93m F.to M.Sand	5.70	5.70m	84.79m
93 - 103m clay		6.01m	90.49m
103 - 131m F.to M.Sand	6.01		96.50m
131 - 135m clay	5.00	11.01m	107.51m
		6.00m	113.51m
	6.01	6.01m	119.52m
			AGL (+) 0.50m
			<u>Total 120.02m</u>

OCTOBER

M	5	12	19	26
T	6	13	20	27
W	7	14	21	28
T	8	15	22	29
F	9	16	23	30
S	3	10	17	24
S	4	11	18	25


(M/S Jai Prakash Chaudhary) (Sampuranand) (Babban Yadav) (Adarsh Verma)  
 Contractor J.E. A.E. E.E.

315-051

Location of T.W. Assembly at Shivpur T/W Bench Day Begins With  
 Drilling/Logging - 13/12/20  
 Hole Size - 550 x 500 mm  
 S.W.L. - 8-feet  
 T.W. Assembly Size - 200 x 150 mm  
 Recommended Discharge - 400 L per  
 D.O.L. - 10/11/20

Logging Report

- 1. 17-18 ⇒ 4
- 2. 21-28 ⇒ 7
- 3. 30-46 ⇒ 7
- 4. 48-58 ⇒ 10
- 5. 62-72 ⇒ 10
- 6. 77-90 ⇒ 13
- 7. 112-119 ⇒ 7

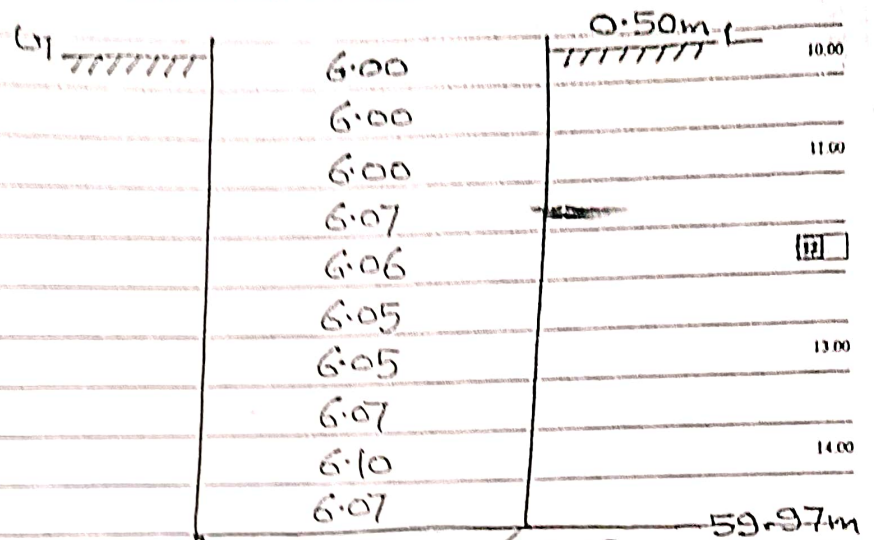

Strata as per Actual

0 - 13 clay			0.50m	10.00
13 - 19 M.Sand				11.00
19 - 22 clay				
22 - 30 F.to M.Sand				
30 - 40 clay	6.03			12.00
40 - 47 F.Sand	6.00			13.00
47 - 49 clay				14.00
49 - 59 V.F. Sand				15.00
59 - 61 clay				16.00
61 - 73 V.F. Sand				17.00
73 - 76 clay				18.00
76 - 92 M.Sand				19.00
92 - 111 clay				
111 - 120 M.Sand				
120 - 132 clay				
			AGL (+) 0.50m	
			<b>Total ⇒</b>	<b>121.55m</b>

DECEMBER  
 7 14 21 28  
 8 15 22 29  
 9 16 23 30  
 10 17 24 31  
 11 18 25  
 12 19 26  
 13 20 27

(M/S Jai Babarsh Chaudhary) Contractors  
 (Sampuranand) JE.  
 (Bibban Yadav) A.E.  
 (Adarsh Verma) E.E.  
 Scanned with CamScanner

Lowering of T.W. Assembly at Adampur T.W. Burti

Billing/Lowering - 15/2/20

T.W. Assembly Size - 200x200mm

Recommended Discharge - 600 L.P.M.


Size - 550x550mm

S.W.L. - 4 feet

D.O.L. - 30/10/20

Logging Report

- 1. 14 - 34 - 20
- 2. 42 - 46 - 4
- 3. 52 - 65 - 13
- 4. 78 - 88 - 10
- 5. 110 - 118 - 8
- 6. 122 - 130 - 8

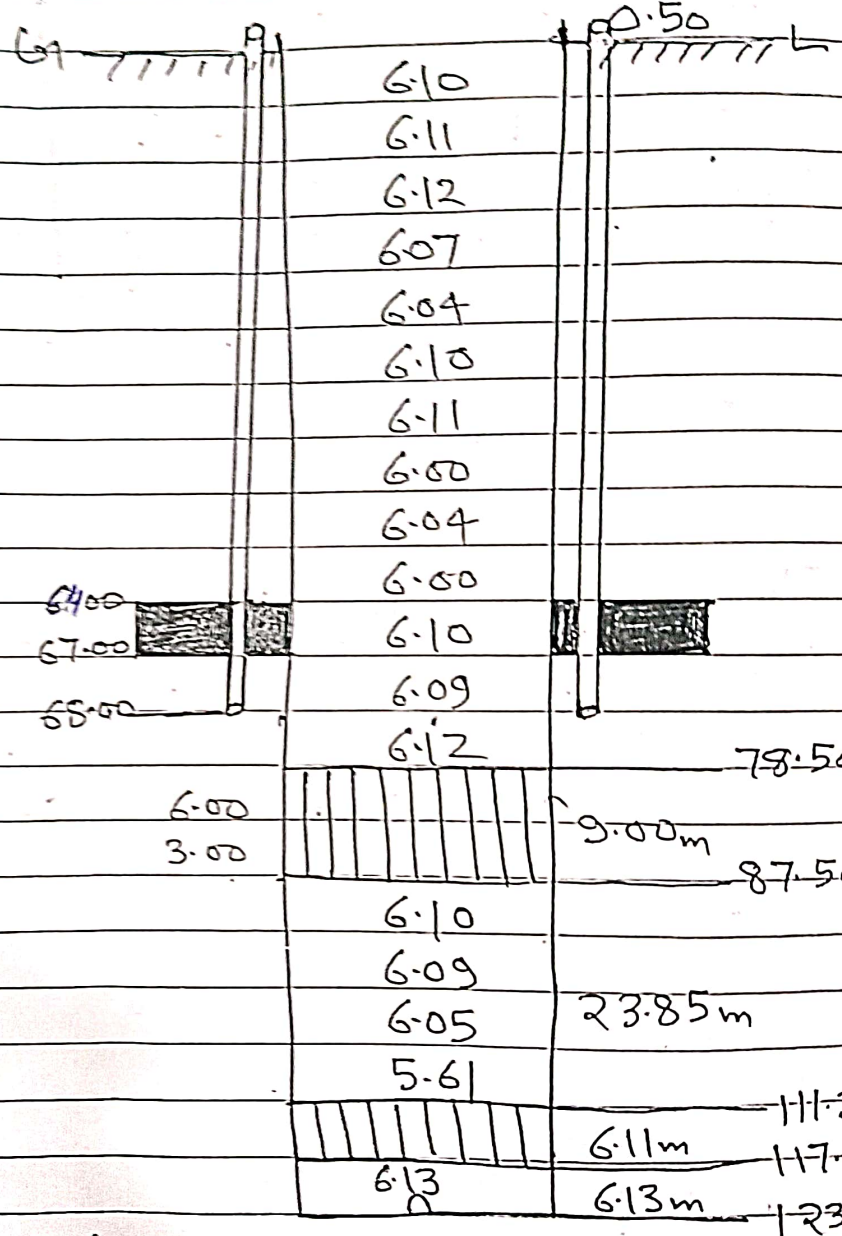

Soils as Per Actual

0 - 6m clay	6.00		
6 - 9 m M. Sand	67.00		
9 - 12m clay	68.00		
12 - 36m M. Sand	6.00		78.50
36 - 40m clay	3.00		81.50
40 - 45 m F. to M. Sand		6.10	
45 - 54m clay		6.09	
54 - 66m F. to M. Sand		6.05	23.85m
66 - 77m clay		5.61	
77 - 89 m F. to M. Sand		6.11m	111.35m
89 - 107 m clay		6.13	117.46m
107 - 119 m F. to M. Sand			123.59m
119 - 124m clay			
124 - 129 m F. to M. Sand			
129 - 135 m clay			
			AGL (+) 0.50m
			<u>Total 124.09m</u>

OCTOBER

5	12	19	26
6	13	20	27
7	14	21	28
8	15	22	29
9	16	23	30
10	17	24	31
11	18	25	

(M/S Jai Prakash Chaurhary) Contractor  
 (Sampurnanand) J.E.  
 (Babban Yadav) A.C.  
 (Adarsh Verma) E.E.  
 Scanned with CamScanner

Way Begins With ☺

# Lowering of T.W. Assembly at Kuniyar T.W. Basti

Drilling/Lowering - 182/120

Bore Size - 550 x 500 m.m.

S.W.L - 5 feet

T.W. Assembly Size - 200 x 150 mm

Recommended Discharge - 400 L.P.H.

D.O.L. - 31/10/20

09.00

0.50m

Time	Logging Report	Depth (m)	Remarks
10.00	1. 15 - 25 ⇒ 10	6.13	
11.00	2. 30 - 37 ⇒ 7	6.15	
	3. 56 - 64 ⇒ 8	6.13	
	4. 71 - 84 ⇒ 13	6.13	
	5. 110 - 120 ⇒ 10	6.14	
13.00	6. 124 - 128 ⇒ 4	6.15	
		6.14	
		6.14	
		6.15	

## Strata as per Actual

Time	Strata	Depth (m)	Remarks
	0 - 12 clay	0.20m	60.85m
15.00	12 - 24 M. Sand	6.03	61.03m
	24 - 28 clay	4.35	10.38m
16.00	28 - 36 M. Sand	6.10	71.46m
	36 - 54 clay	6.10	12.20m
17.00	54 - 63 F. to M. Sand	6.01	83.66m
	63 - 70 clay	6.01	
18.00	70 - 84 F. to M. Sand	6.02	27.10m
	84 - 109 clay	6.06	
19.00	109 - 117 F. to M. Sand	3.00	
	117 - 125 clay		
	125 - 128 F. Sand	6.15m	110.76m
20.00	128 - 135 clay	3.04m	116.91m
		3.04m	119.95m

AGL (±) 0.50m

Total 120.45m

### NOVEMBER

M	30	2	9	16	23
T		3	10	17	24
W		4	11	18	25
T		5	12	19	26
F		6	13	20	27
S		7	14	21	28
S		8	15	22	29

(M/S Dhananjay Tripathi)  
Contractor

(Sampuranand)  
J.E.

(Babbar Yadav)  
A.E.

(Adarsh Verma)  
E.E.

Drilling/Lowering of T.W. assembly at Batrinhwa T/W-1 Basti  
 Date 13/1/20  
 T.W. Assembly Size 300 X 150 m.m.  
 Recommended Discharge - 1000 L.P.M.  
 Bore Size - 675 mm, 20.500 m.m.  
 S.W.L. - 7 feet  
 D.O.L. - 06/11/20

Logging Report

1	16-20 → 4	6.14	0.50m
2	22-30 → 8	6.12	
3	38-62 → 24	6.10	
4	66-73 → 7	6.12	
5	76-83 → 7	6.12	
6	87-94 → 7	6.13	
7	110-114 → 4	6.11	
8	116-120 → 4	6.11	
9	122-126 → 4	6.13	
		6.11	

Soil Data as Per Actual

0-15	clay		0.20m	60.69m
15-18	M.Sand	5.60	5.60m	60.89m
18-21	clay		6.10m	66.49m
21-32	M.Sand	3.85	3.85m	72.59m
32-39	clay		6.13m	76.44m
39-60	F.to M.Sand	4.85	4.85m	82.57m
60-65	clay		6.12	87.42m
65-95	F.to M.Sand	6.11		93.54m
95-109	clay	6.12	16.93m	
109-114	F.to M.Sand	4.70		
114-122	Sandy clay		3.00m	110.47m
122-127	V.V.F.Sand	6.02	6.02m	113.47m
127-135	clay			119.49m
			AGL (+)	0.50m
			<b>Total</b>	<b>119.99m</b>

NOVEMBER

M	30	2	9	16	23
T		3	10	17	24
W		4	11	18	25
T		5	12	19	26
F		6	13	20	27
S		7	14	21	28
S	1	8	15	22	29

(M/S G.R. Enterprises) (Sampurnanand) (Babban Yadav) (Adarsh Kerala)  
 Contractor J.E. A.E. E.E.

Lowering of T.W. Assembly at Mahatha T/W Basti  
 Billing/Lowering - 132/20  
 T.W. Assembly Size - 200 X 150 mm  
 Reccomanded Discharge - 950 L.P.P.  
 S.W.L. - 5 feet  
 D.O.L. - 31/10/20

Logging Report

1-17-22 → 8	6.11	0.50m	09.00
2-18-22 → 22	6.12		10.00
3-19-22 → 10	6.12		11.00
4-20-22 → 7	6.12		
5-21-22 → 7	6.12		
6-22-22 → 4	6.11		13.00
	6.12		
	6.12		
	6.11		14.00

Strata as per Actual

0 - 12 clay		0.15m	60.61m	14.00
12 - 23 M.Sand	6.12		60.76m	15.00
23 - 43 - clay	6.10	17.77m		
43 - 65 - M.Sand	5.55		78.53m	16.00
65 - 76 - clay	6.04	9.04m		
76 - 88 - F.to M.Sand	3.00		87.57m	17.00
88 - 92 - clay	6.00	6.00m	93.57m	18.00
92 - 101 - F.to M.Sand		6.00m	99.57m	18.00
101 - 105 - clay	6.04	6.04m	105.61m	19.00
105 - 113 - F.to M.Sand		6.00m	111.61m	
113 - 125 - clay	6.04	6.04m	117.65m	
125 - 132 - F.Sand				
		Abt (+) 0.50m		
		<u>Total</u> → 118.15m		

NOVEMBER

30	2	9	16	23
3	10	17	24	
4	11	18	25	
5	12	19	26	
6	13	20	27	
7	14	21	28	
8	15	22	29	

(M/S Sundigo Salar)  
Contractor

(Sampuranand)  
J.E.

(Babbar Yadav)  
A.E.

(Adarsh Verma)  
E.E.




ORY  
RSES  
Business Pvt. Limited

Lowering of T.W. Assembly at Pokhas Bhinda (Gauribazar) T.W. Decaria.  
 Drilling/Lowering - 100/90  
 Bore Size - 550x800 mm  
 B.W.L. - 3.90 m  
 T.W. Assembly Size - 200x150 mm.  
 Recommended Discharge - 400 L.P.H.  
 D.O.L. - 08/01/21

1000 Logging Report

- 1. 12 - 16 → 4
- 1100 2. 18 - 26 → 8
- 3. 31 - 52 → 18
- 1200 4. 66 - 80 → 14
- 5. 86 - 96 → 10
- 1300 6. 104 - 108 → 4

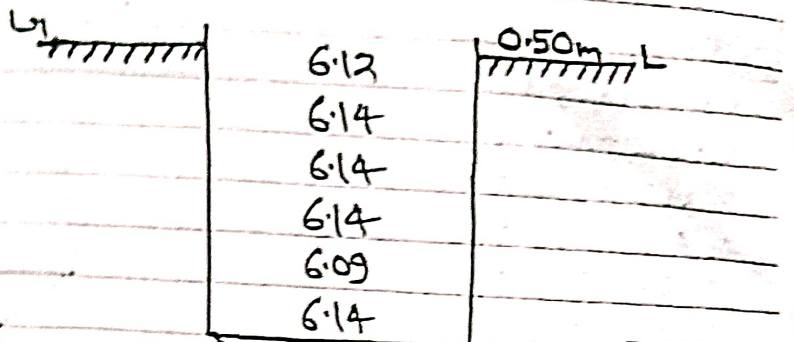

200 Strata as per Actual

0 - 10m clay	6.12		
10 - 15m M.Sand	6.14		
15 - 20m clay	6.14		
20 - 25m M.Sand	6.14		
25 - 35m clay	6.09		
35 - 51m F-to M.Sand	6.14		
51 - 66m clay	6.04		
66 - 80m F-to M.Sand	6.12		
80 - 90m clay	6.05	30.29m	
90 - 95m F-to M.Sand	6.03		
95 - 105m clay	6.05		66.69m
105 - 110m F.Sand	6.04	12.09m	
	6.03		78.78m
	6.02	12.05m	
	3.00	3.00m	90.83m
	0	3.00m	93.83m
			96.83m
			AGL (+) 0.50m
			<u>Total → 97.33m</u>

(M/S Shivam Enterprises) (Sampurnand) (R.P. Rai) (Adarsh Verma)  
 Contractor J.E. A.E. E.E

Important Notes

(C)