

12

12

GEO-PHYSICAL WELL ELECTROLOGGING REPORT

Re No – 1101

Date 27/06/2022

NAME OF SITE

DASHARI (AMISHA)
KADAURA
JALAUN

NAME OF AGENCY

ABHISHEK SHARMA
JALAUN

M/S MAHALAXMI TUBEWELL

CONSTRUCTION OF DEEP AND SHALLOW TUBEWELL, WELL ELECTRO-
LOGGING AND DEVELOPMENT OF TUBE WELL BY AIR COMPRESSUR
RAJENDRA NAGAR MILL COLONY PUKHRAYAN KANPUR, 209111
9935299290, 8090118811, nky.phn@gmail.com

M/S MAHALAXMI TUBEWELL

Geophysical Well Logging Report

Ref No – 1101

Date 27/06/2022

Site Location : - Dashari Kadaura Jalaun

District : - Jalaun

Logged Depth : - 103 M BGL

Date of Logging : - 27/06/2022

Types of Log : - S.P & N-16, N-64 LAT


Logger used : - IGIS

The following permeable granular zones have been deciphered with the help of Electrical Logger.

Sr. No	Depth Range From M.B.G.L	Depth Range M.B.G.L.	Thickness Mtr.	Inferred Lithology	Quality of G.W.
01	0	24	24	Surface Clay Kankar	
02	24	32	09	Sandy Kankar	
03	32	48	16	Sandy Clay Kankar	
04	48	55	07	Fine to Medium Sand	Good
05	55	60	05	Cay Kankar	
06	60	82	22	Fine to Medium Sand	Good
07	82	88	06	Cay Kankar	
08	88	103	15	Fine to Medium Sand	Good

Note- Sr no 2,4,6,8 are intermixed with fine bands of kankar

Encl : - E. Logs




(For M/s Mahalaxmi Tubewell)

☒ N 16(SN)
☒ N 64(LN)
☒ LAT

Location: Dastehi Khasra Jilun
 Log No.: LOGSNG01
 Date: Mon Jun 27 2012
 Time: 6:32 PM
 Operator:
 Well Depth:
 Notes:


☒ SP

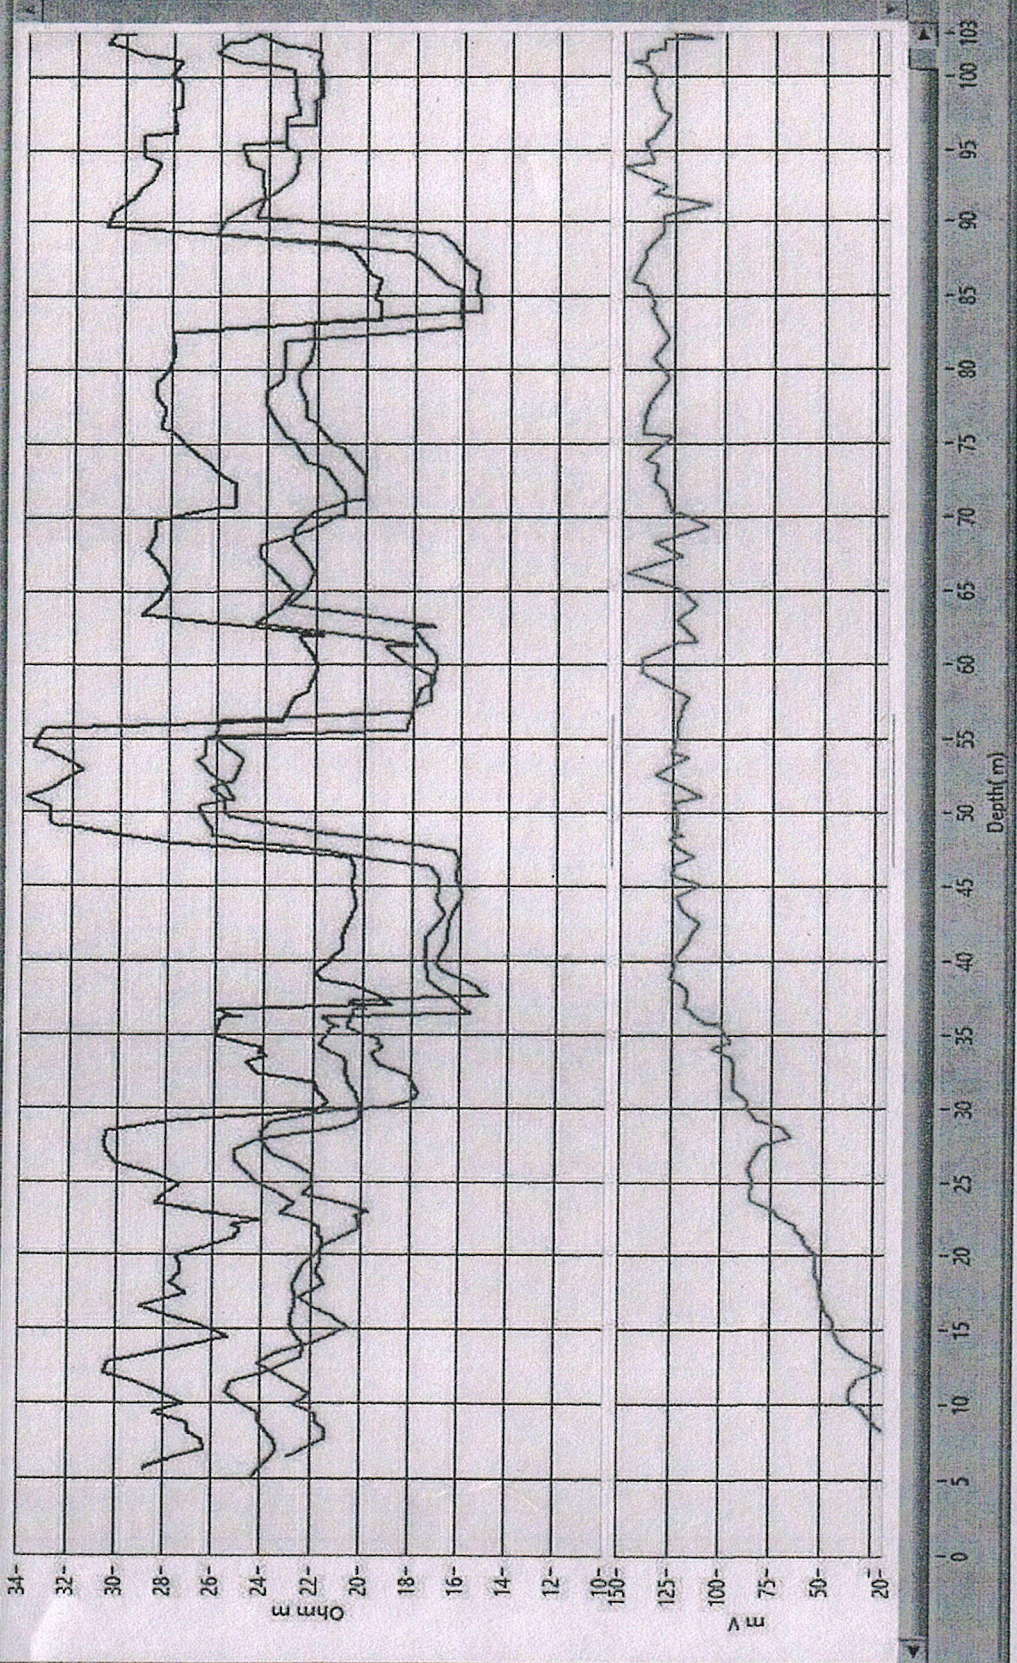

PROPOSED ASSEMBLY CHART OF TUBEWELL

NAME OF SCHEME : -AMISA GP WSS
 NAME OF SITE : -DASHERI
 BLOCK : -Kadaura
 NAME OF COMPANY : -BGCCPL
 TYPE OF RIG M/C : -D.C.

DISTRICT : -JALAUN (ORAI)
 SIZE OF BORE : -500 X 450 MM
 SIZE OF ASSEMBLY : -200 X 150 MM
 SPRING WATER LEVEL: -.....MTR

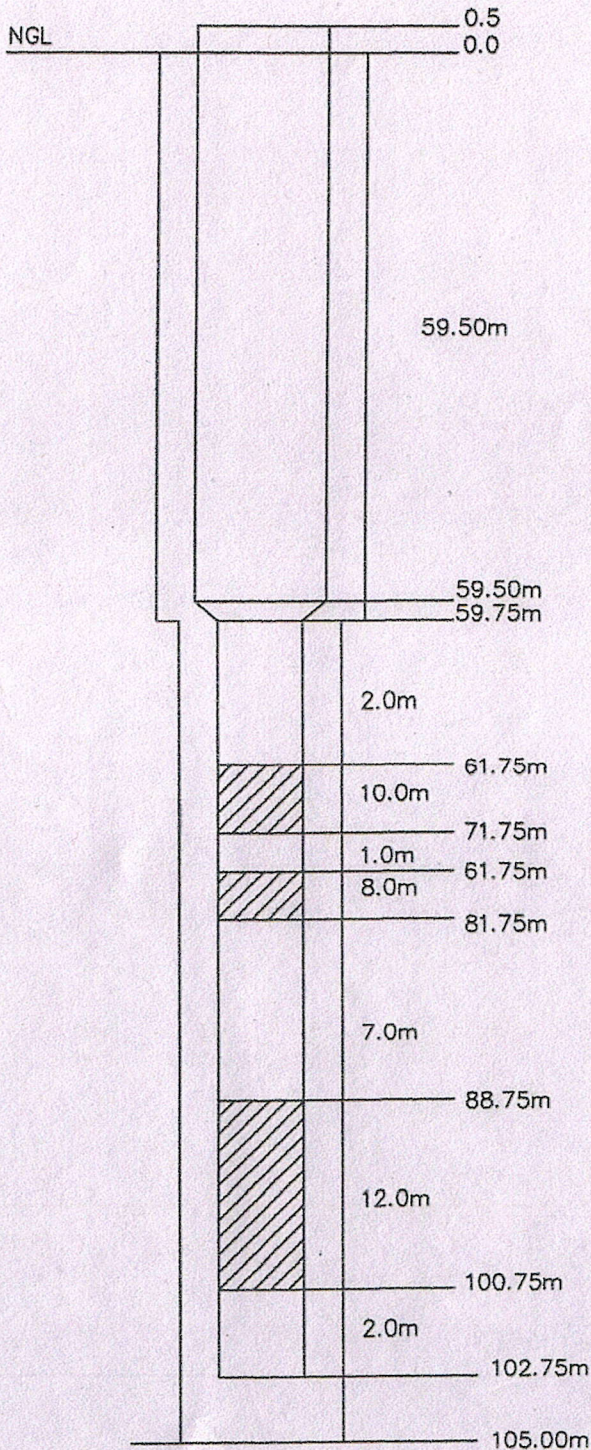

LOGGING DATE: - 27/06/2022			
LPM REQUIRED: -380			
Sr.N	Depth Range (M)	Thickness (M)	Remark
1			GOOD
2	60 TO 82	22	
3	88 TO 103	15	
4			
5			
6			
7			
8			
9			
10			
Abstract			
1. Drilling completed on dt.....			
2. Lowering on Dt.....			
3. Drilling DepthM			
4. 200 mm Dia Housing pipe.....M			
5. 200x150 mm Dia reducer...0.25.M			
6. 150 mm Dia Plain pipe.....M			
7. 150 mm Dia Slotted Pipe.....M			
8. Total Assy. Length.....M			
9. Pea Gravel Quality.....			



Proposed By

RECOMMENDED BY

APPROVED BY

JR. ENGINEER

ASS. ENGINEER

EXECUTIVE ENGINEER