

130 T.W. + Conf. + OK

YIELD TEST REPORT				
NAME OF SCHEME		T.W. 8 (270)		
LOCATION OF T/W		Mahga 3 Pura		
REQUIRED DISCHARGE AS PER SCHEME		200 LPM		
DATE OF TESTING		8/12/21		
TASTE OF WATER		Sweet		
PHYSICAL WATER QUALITY				
S. No.	S.W.L. IN MTR.	R.W.L. IN MTR.	DEPRESSION IN MTR.	DISCHARGE IN LPM
	25	24		1241
REMARKS:-				
RECOMMENDED DISCHARGE				
?	Vivek Agnihotri	Signature		
BGCC	NAME OF SWSM/JALNIGAM /PMC/TPI ENGINEER	SIGNATURE OF SWSM/JALNIGAM /PMC/TPI ENGINEER		

Request For Inspection (RFI)

Client:-	STATE WATER SANITATION MISSION		
PMC:-	TES-WTESL(I.V.) PMC JHANSI		
CONTRACTOR:-	BRIGOPAL CONSTRUCTION COMPANY		
SCHEME NAME:-	IMLOTA / TEHARKA / BARTHARI / JALAUN		
Request for Inspection / Approval	Vill. Mahajpuria, Block - Madhugadh		
RFI NO.:-		Request Date/Time:- 08/12/21	
Request for Inspection on scheme work (tick as applicable)			
CIVIL	MECHANICAL	ELECTRICAL	
INSTRUMENTATION	COMMISSIONING		
WORK PARTICULARS:-			
Description of works	Comments be PMC/Client/	Signature by PMC/Client/T.P.I	Remark
release discharge checking of Unit			① R.F.I for lowering & compressor work not raised by the E.P.C Agency.
Vill. Mahajpuria, Block Madhugadh			② P. Gravel Stone Analysis, Specific Gravity & Impact Value test reports not provided by the E.P.C Agency.
Inspection Date:-		Inspection Time:-	
Request by BGCC Representative		Received by PMC Representative / T.P.I	
NAME Ashok Yadav		NAME - Vinod Agnihotri	
Signature 09/12/21		Signature -	
Inspection Date		Inspection Date - 9/12/2021	
Inspection Time		Inspection Time - 10:00 AM.	

Encl. :-

YIELD TEST REPORT BT 250 P.S.I COMPRESSOR

DATE OF TEST:-

STATIC W/L

TEST OF WATER

Seal

Village: Malwa's para Block - Madhogach

DISCHARGE		ST.PR.	RU PR	Depre		SAND CONTENTS						
INC	LPM	KG/CM ²	KG/CM ²	KG	MTR	START	5 MIN	10 MIN	15 MIN	20 MIN	25 MIN	REMARKS
		5.90	5.40	0.50	5.00	3600	3000	2000	1600	900		
		8.70	8.10	0.60	6.00	4200	3600	2400	1800	1000		
		9.60	8.90	7.0	7.00	4600	4000	2600	2000	1200		
		12.00	11.20	8.0	8.00	4800	4200	2800	2100	1400		

Note: Recommended for further development by O.P. Unit.

Proposed Tubewell Assembly Maharaipura Block-Madhya Pradesh Logging report-2017-2018

- (1) 50m - 50.00 = 08.00
- (2) 60m - 50.00 = 07.00

200mm dia MSERW plain pipe.

- 1-
- 2-
- 3-
- 4-
- 5-
- 6-
- 7-
- 8-
- 9-
- 10-

200mm dia MSERW slotted pipe


- 1-
- 2-
- 3-

200mm dia Plain pipe cutting

0.6.00 $\begin{cases} 02.50 \\ 03.50 \end{cases}$ 0.6.00 $\begin{cases} 02.50 \\ 03.50 \end{cases}$

200mm dia slotted pipe cutting

0.6.00 $\begin{cases} 02.00 \\ 02.00 \end{cases}$

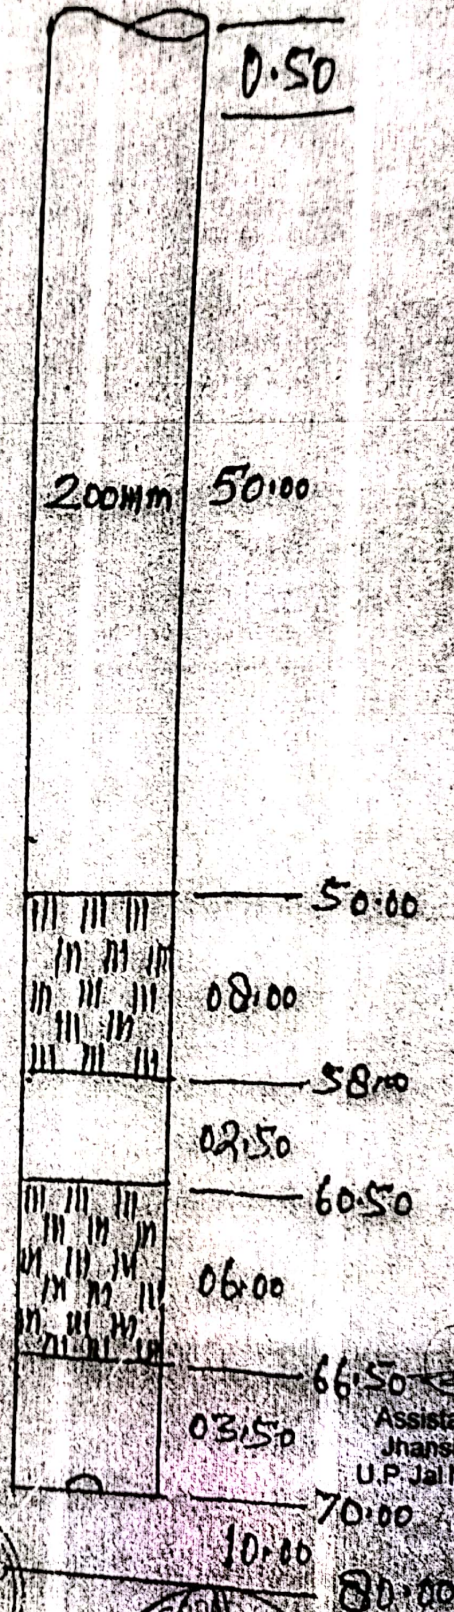

Assistant Engineer
 Jhansi Khand- 1st
 U.P. Jal Nigam, Jhansi

Aqua Xplore

(Groundwater Assessment & Allied Services)

15/5, New Colony Extn, Hazratganj, Lucknow - 226001

Mob: 9918102516, 9889421122, Email: aquaxploreko@gmail.com

Advisor - Dr. R. A. Yadav, ex-Manager (Groundwater), U. P. Jal Nigam

Ref. 1120 - M AX - 2021 Date: 20.11.2021

Geophysical Borehole Logging Report

Name of the site : Maharajpura, Block - Madhayanagar

District : Jalaun

Date : 20.11.2021

Depth logged : 75.00 mbgl

Depth drilled : 80.00 mbgl

Logged by : Aqua Xplore

Present : Mr. Ranjeet Rami, J.E. & Rep. of M/S A.Sharma, Jalaun

Based on the interpretation of geophysical logs, following information may be deciphered, particularly with respect to salinity of the formation water

SLNo	Depth range (mbgl)	Thickness (m)	Remarks
1	50.0 - 58.0	8.0	Good all
2	60.0 - 67.0	7.0	

Note. All zones are intermixed with fine bands of kankar stones.

for Aqua Xplore

CC:

1. E.L., Jhansi Divn. Ist., U.P. Jal Nigam, Jhansi

2. M/S. Abhishek Sharma, Khandirav, Jalaun