

(115) TOW + Comp + TP

YIELD TEST REPORT				
NAME OF SCHEME		TOWOS (270)		
LOCATION OF T/W		Andai (madhogarhi)		
REQUIRED DISCHARGE AS PER SCHEME		50 LPM		
DATE OF TESTING		14/12/21		
TASTE OF WATER		Sweet		
PHYSICAL WATER QUALITY				
S.No.	S.W.L. IN MTR.	R.W.L. IN MTR.	DEPRESSION IN MTR.	DISCHARGE IN LPM
	10	14		1268.8
REMARKS:-				
RECOMMENDED DISCHARGE				
?	Vivek Agnihotri			
BGCC	NAME OF SWSM/JALNIGAM /PMC/TPI ENGINEER	SIGNATURE OF SWSM/JALNIGAM /PMC/TPI ENGINEER		

Request For Inspection (RFI)

bogcc

Client:-	STATE WATER SANITATION MISSION		
PMC:-	TES-WTES(I.V.) PMC JHANSI		
CONTRACTOR:-	BRUGOPAL CONSTRUCTION COMPANY		
SCHEME NAME:-	IMLOTA / TEHARKA / BARTHARI / JALAUN		
Request for Inspection / Approval	Vill. Pandhri Block. Madhogadha		
RFI NO. :-			
Request for Inspection on scheme work (tick as applicable)	Request Date/Time:- 13/12/21		
CIVIL	MECHANICAL	ELECTRICAL	
INSTRUMENTATION	COMMISSIONING		
WORK PARTICULARS:-			
Description of works	Comments be PMC/Client	Signature by PMC/Client	Remark
Water discharge Checkin			① R.F.I not raised
of Unit			timely by the E.P.C
Vill. Pandhri			Agency
Block. Madhogadha			
Inspection Date:-	Inspection Time:-		
Request by BGCC Representative	Received by PMC Representative	T.P.T	
NAME Ashok Yadav	NAME Vivek Agnihotri		
Signature	Signature		
Inspection Date 14/12/21	Inspection Date - 14/12/21		
Inspection Time	Inspection Time		

Encl. :-

YIELD TEST REPORT BT 250 P.S.I COMPRESSOR

DATE OF TEST:-

STATIC W/L

TEST OF WATER

Signature

Village: Andol . Block . Madhagach

DISCHARGE		ST.PR.	RU PR	Depre		SAND CONTENTS						
INC	LPM	KG/CM ²	KG/CM ²	KG	MTR	START	5 MIN	10 MIN	15 MIN	20 MIN	25 MIN	REMARKS
		5.90	5.40	0.50	5.00	3600	3000	2000	1600	900		
		8.70	8.10	0.60	6.00	4200	3600	2400	1800	1000		
		9.60	8.90	7.0	7.00	4600	4000	2600	2000	1200		
		1200	11.20	8.0	8.00	4800	4200	2800	2100	1400		

Note: Recommended for further development by O.P. Unit.

PROPOSED TUBE WELL ASSEMBLY DETAIL CHART


Name of Scheme:- JAL JEEVAN MISSION

District :- Jalaun

Name of T/W Site :- Village - Andai , Block - Madhavgarh

Name of Contractor :- M/s Brij Gopal Construction Co & SPML (JV)

Type of Rig. M/c :- D.C.

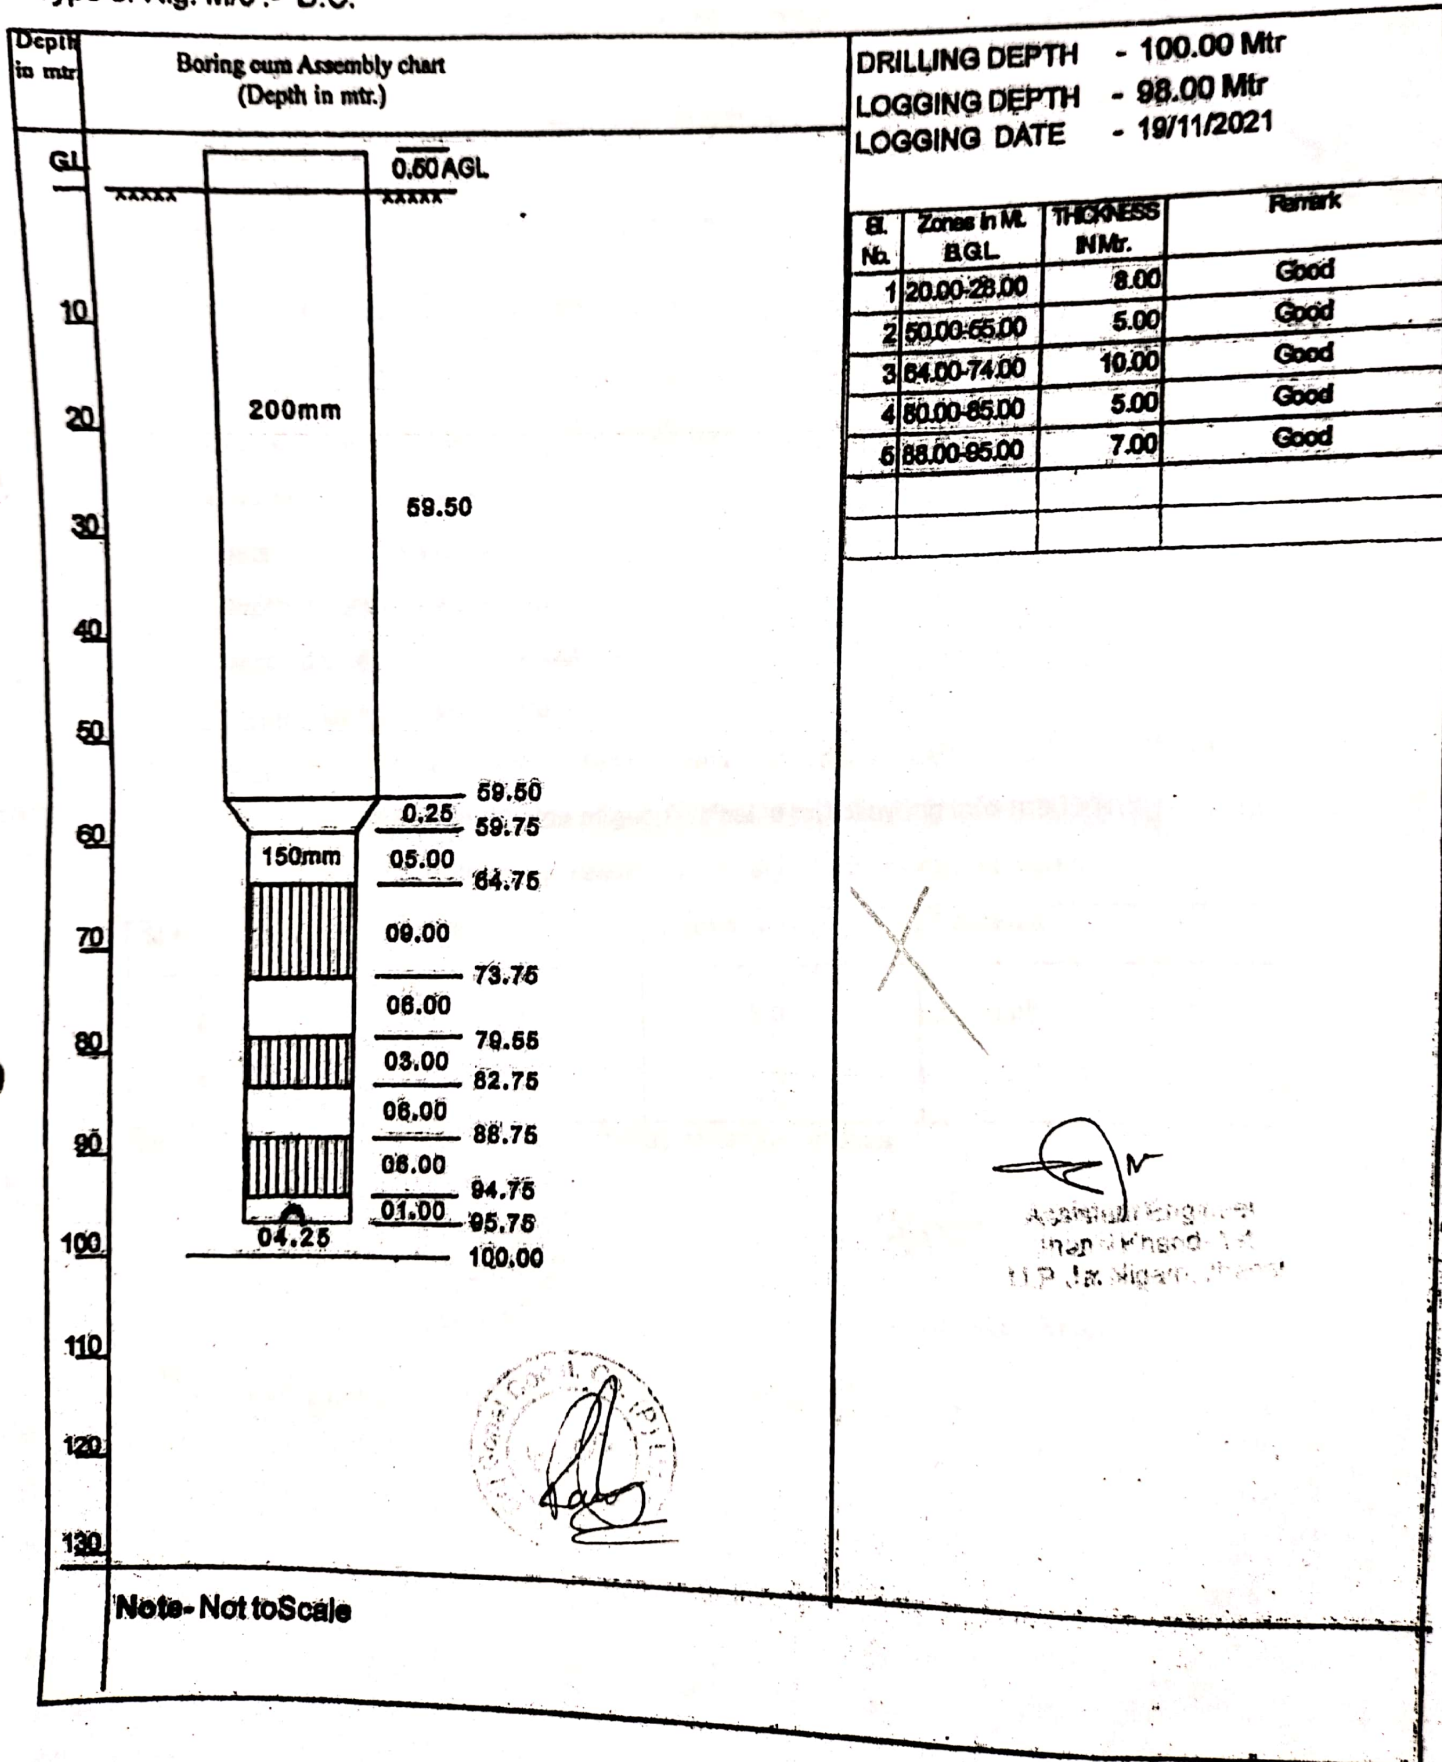

[Signature]
Asst. Engineer
Jalaun District
11 P. Jalaun, Jalaun



Aqua Xplore

(Groundwater Assessment & Allied Services)
243/5, New Colony Jiyamau, Hazratganj, Lucknow - 226001

Mob. 9918202546 / 9889323322, E mail- aquaxploreko@gmail.com

Advisor - Dr. R. A. Yadav, ex-Manager (Groundwater), U. P. Jal Nigam

Ref. 1119 - A / AX - 2021 Date 19.11.2021

Geophysical Borehole Logging Report

Name of the site : Andai, Block - Madhavgarh

District : Jalaun

Date : 19.11.2021

Depth logged : 98.00 mbgl

Depth drilled : 100.00 mbgl

Logger used : Aqua Xplore

Presence : Rep. of M/S Maa Katyani Enterprises, Pukhrayan, Kanpur Dehat

Based on the interpretation of geophysical logs, following information may be deciphered, particularly with respect to salinity of the formation water.

Sl.No.	Depth range(mbgl)	Thickness(m)	Remarks
1	20.0—28.0	8.0	Good all
2	50.0—55.0	5.0	
3	64.0—74.0	10.0	
4	80.0—85.0	5.0	
5	88.0—95.0	7.0	

Note, All zones are intermixed with fine bands of kankat/stones.



[Signature]

for Aqua Xplore

CC:

M/S Maa Katyani Enterprises, 11, Rajendra Nagar, Pukhrayan, Kanpur Dehat,
U.P. 209111

