


CONSTRUCTION DIVISION (E/M) U.P. JAL NIGAM, GORAKHPUR

COMPLETION PLAN OF :- BARDIHA DAL DISTRICT :- DEORIA BLOCK :- BHALUANI
 TYPE OF RIG M/C :- RC SIZE OF BORE :- 800 X 500 MM
 STATIC WATER LEVEL :- 6 FEET NAME OF FIRM :- LC INFRA PVT LTD
 D. O. L :- 30/03/2022 REQUIRED DISCHARGE - 850 LPM TUBEWELL ASSEMBLY SIZE - 300 X 150 MM HEAD - 45 M

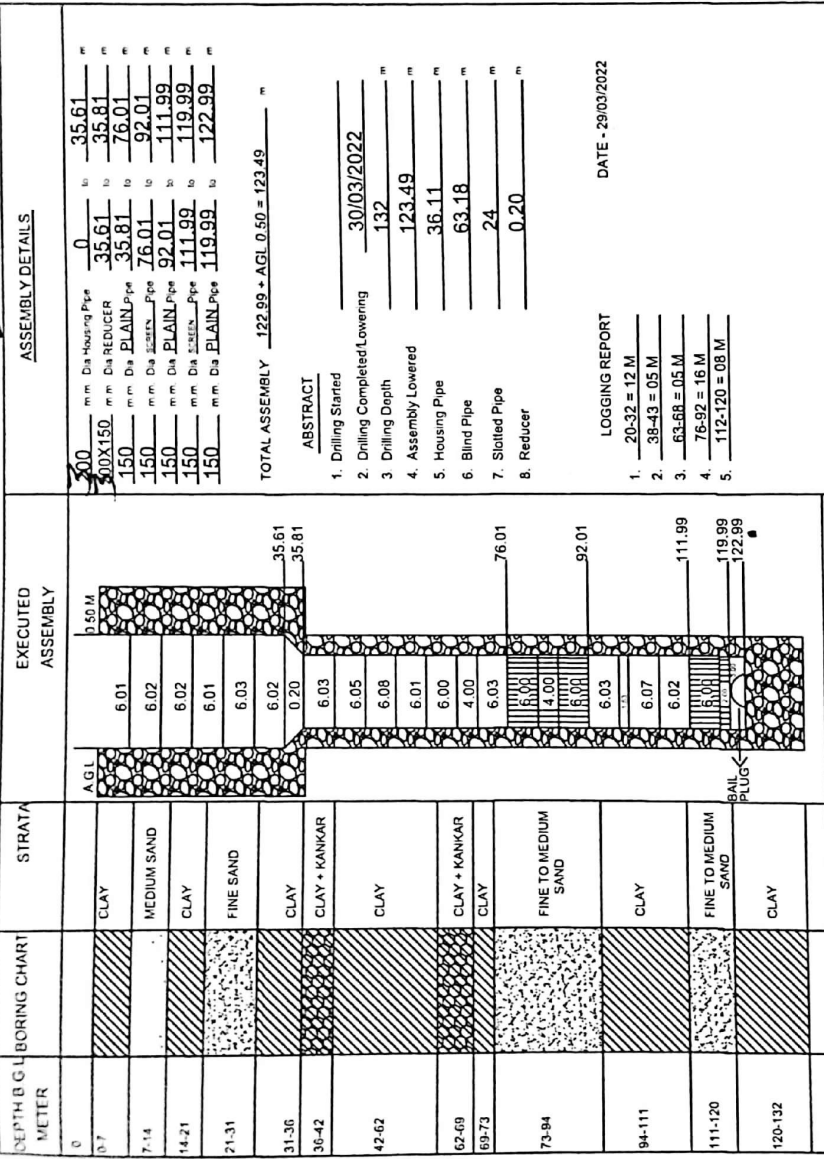

TKC TPI JE AE EE

YIELD TEST REPORT BY 250 P.S.I COMPRESSOR				YIELD TEST REPORT BY O.P. UNIT																		
Date of Test - 05/05/2022 Static W/L 4.10 M Taste of Water SWEET				Date of Test - 16/05/2022 Static W/L 4.10 M Taste of Water SWEET Office size- 6' X 4'																		
AIR LINE LOWER	DISCHARGE	PR	RU	PR	DEPRE	DISCH	R.W.L	S.W.L	DEPRE	Sand Contents												
Mtr	INC	L.P.M	Kg	Kg	Mtr	Start	M	M	M	5 min	10 min	20 min										
81	7.50	1346	8.20	7.80	0.40	0.40	4000	2400	1600	1600	400	1000	32.5	1363	9.20	4.10	5.10	250	200	150	100	50
87	8.00	1578	8.80	8.30	0.50	0.40	4000	2600	1800	1500	1200	250	1200	8.60	4.10	4.50	150	100	50	Tr	Tr	Cl
114	8.50	1831	11.50	10.90	0.60	0.60	5000	3000	2000	1600	1200	18.0	1025	7.60	4.10	3.50	50	Tr	Cl	Cl	Cl	Cl
117	9.00	2109	11.80	11.20	0.60	0.60	5200	3600	2200	1800	1400	12.0	851	7.20	4.10	3.10	Tr	Cl	Cl	Cl	Cl	Cl

NOTE: RECOMMENDED FOR FURTHER DEVELOPMENT BY O.P. UNIT. NOTE: RECOMMENDED DISCHARGE
 RUNNING BY PASS : 8 TO 10 MIN

TKC TPI JE AE EE

