


(2)

Actual Stratigraphic Chart of Banghusara Singh village w/s

Scheme Dist - Jhanda (World Bank w/s Scheme)

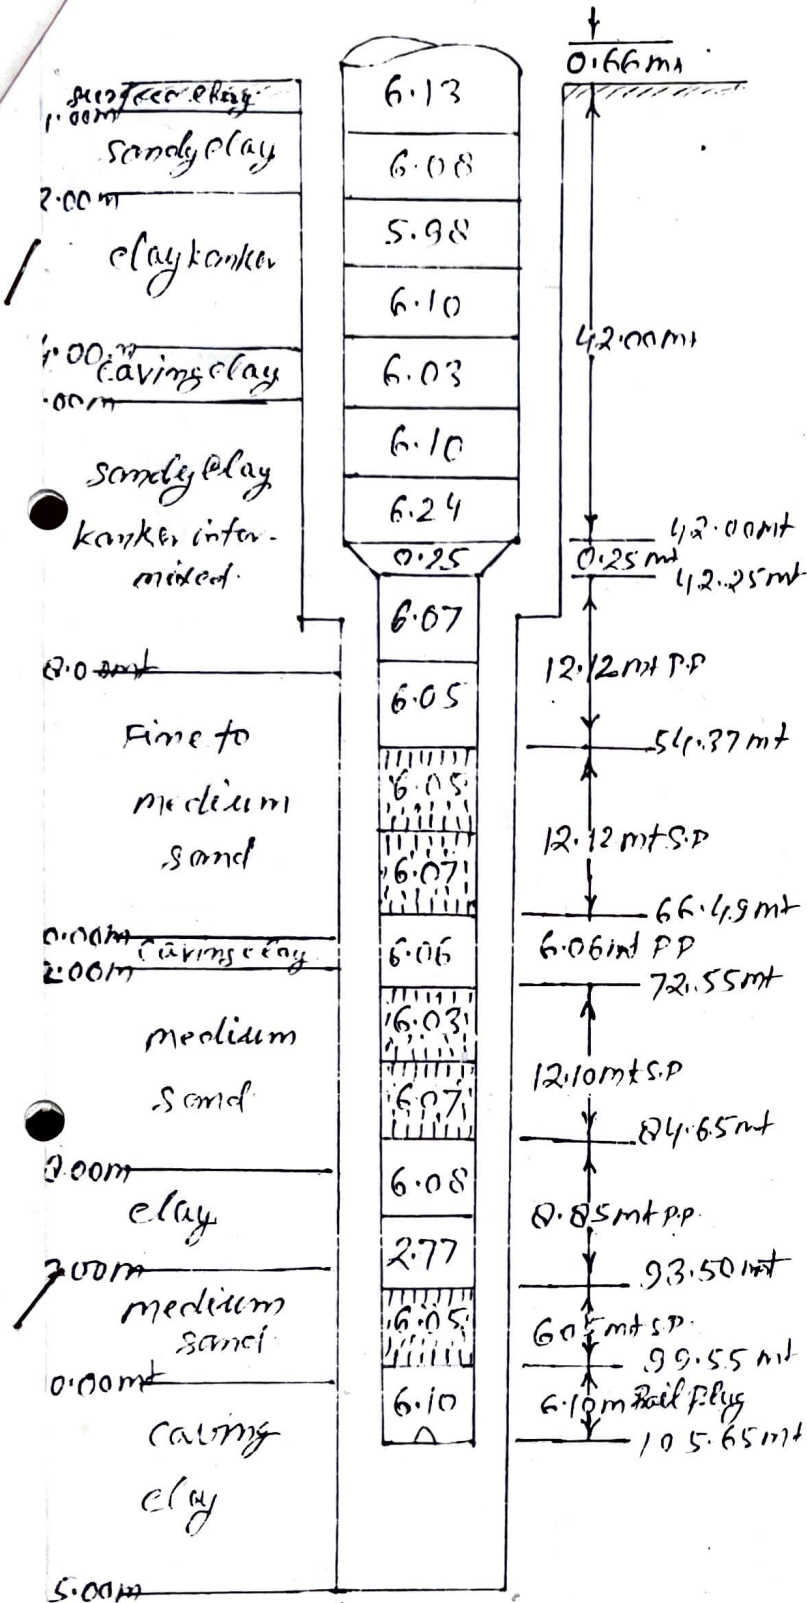

Required Discharge - 500 L.P.M.

Bore size - 675 x 450 mm

Assembly size 800 x 150 mm

Logging Depth - 112.0 m bgl

Drilling Depth - 115.0 m bgl

Date of Logging - 24/6/15

Date of lowering - 27/6/15

Logging Report:-

Sl. No.	Depth Range (m bgl)	Thickness in meter	Remarks
1.	48-70	22.00	Good
2.	72-88	16.00	
3.	93-100	7.00	

by - Aqua x plomateck

Wellcare Society Lucknow.

(1) Total lowering - 106.31 mt

A.C.L - 0.66 mt

B.G.L - 105.65 mt

(2) 300 mm of Housing pipe - 42.66 mt

(3) 150 mm of plain pipe - 33.13 mt

(4) 150 mm of slotted pipe - 30.27 mt

(5) 300 x 150 mm of Reducer - 0.25 mt

(6) 150 mm of Rail Plug - 1.10 mt

Sheet 1

Signature

MS Steel Sai Construction Company (En. Mohar Singh) (En. Sit Karmelhar)

Regd. Hasan Road Lucknow

75

85

95

Aqua Xploretech Welfare Society

(Groundwater Assessment & Allied Services)

243/5, New Colony Jiyamau, Hazratganj, Lucknow-226001

Ref 6024 - M / AXWS - 2015

Date 24.06.2015

Geophysical Borehole Logging Report

Name of the site : Banghusra

District : Gonda

Date : 24.06.2015

Depth logged : 112.0 mbgl

Depth drilled : 115.0 mbgl

Logger used : AXWS

Based on the interpretation of geophysical logs, following information may be deciphered, particularly with respect to salinity of the formation water.

Sl.No.	Depth range(mbgl)	Thickness(m)	Remarks
1	48.0-----70.0	22.0	Good all
2	72.0-----88.0	16.0	
3	93.0-----100	7.0	

Note.



for Aqua Xploretech
Welfare Society

To

M/S Shri Sai Construction Company

50/4, Wazir Hasan Road, Lucknow