


Under N.R.D.W.F. Programme. (Q.P.V.)

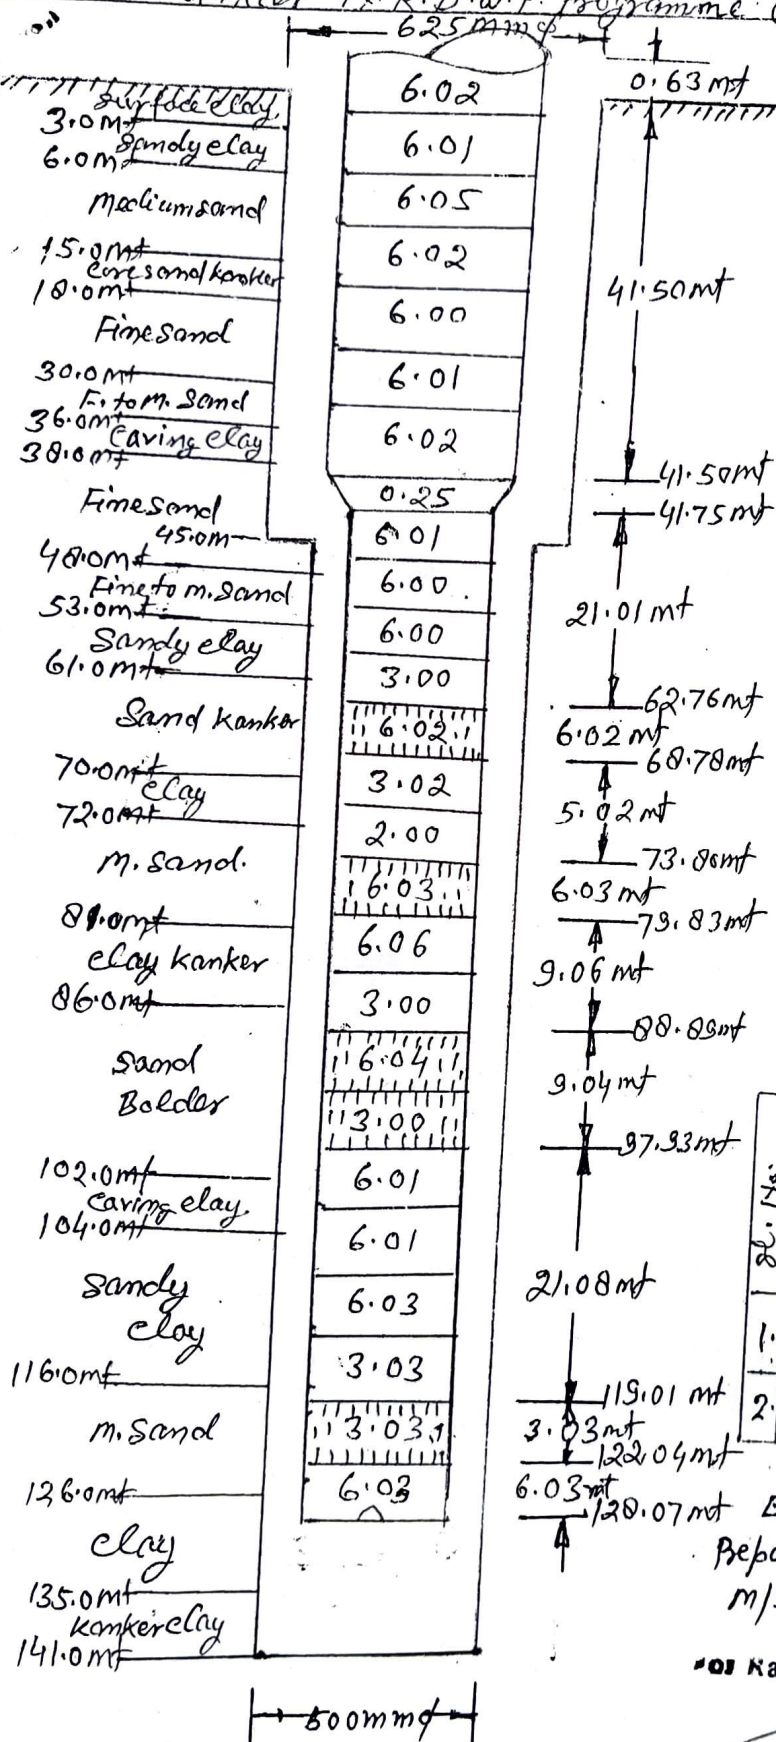

Required Discharge - 1000 L.P.M

Assembly size - 300 x 150 mm

Base size — 625x500 mm

Type of Rig m/e - R.C.

Date of Logging - 11.9.14

Date of flowering. 1-10-14

Drilling depth - 141.0 m

Logging depth — 138.0 m

Depth of lowering - 128.70 m

B. (n) L. — 120.07 m

A.G.L. — 0.63 m

Logging Report

Sl. No.	Depth Range in mt	Thickness in mt	Result
1.	47.0 - 53.0	6.0 mt	Good
2.	62.0 - 69.0	7.0 mt	
3.	73.0 - 81.0	8.0 mt	
4.	88.0 - 101.0	13.0 mt	
5.	117.0 - 125.0	8.0 mt	

By - Dr. R. A. Yadav

U.P.J.N. Lucknow.

13.9.14 Zone Testing Report

	Sr.	No.	Range of Zone in mt	Fluoride	Chlorine	Iron	Arsenic	Nitrate	Hardness	sulfonide	Bacteriological sample
1.	62-01	0.30	NIL	0.20	0.007	NIL	NIL	210	10	-	FIT
2.	88-125	0.30	NIL	0.20	0.005	NIL	NIL	210	10	-	FIT

By- (Lab)

Ex. En. C.D.U.P.J.N. Bahraich

Repaired & Recommended by,

m/s Rajkaran Tubewells Pvt Ltd
Lucknow

01 Kalkaran Tubewells Pvt. Ltd.

Authorized Signature

Pringle
Er Mohar Singh
J.E

Er. S. K. Karnadhar
A. E.

Er. H.C. Nayak
Ex. En.