


Actual assembly chart of Keshav Nrgoant Zone-1st (East) T.W No-1 GONDAR

Under N.R.W.S.P.

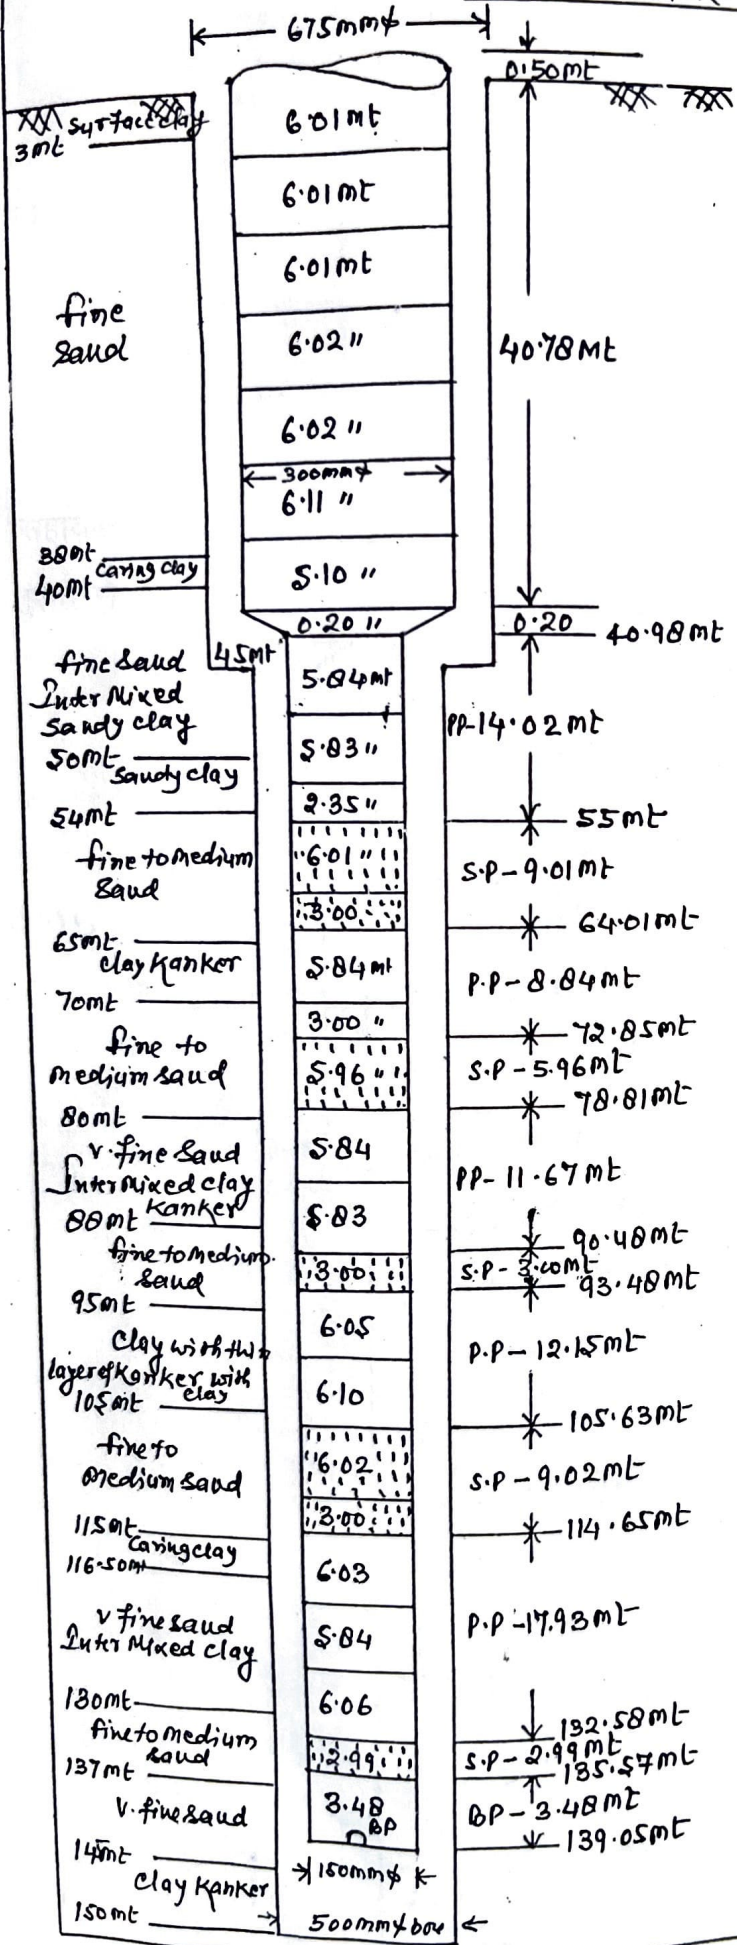

Required discharge:- 1200 LPM
 Bore Size:- 675 mmφ x 500 mmφ
 Assembly Size:- 300 mmφ x 150 mmφ
 Depth of bore:- 150 mt BGL
 Logging depth:- 150 mt BGL
 Date of logging:- 31.1.014
 Date of lowering:- 2.2.014
 Lowering Depth:- BGL:- 139.05 mt
 AGL:- 00.50 mt
 Total:- 139.55 mt

Logging report

SP No	Depth range in mt	Thickness in mt	Result
1-	40-50	10 mt	Good
2-	54-65	11 mt	"
2-	70-80	10 mt	"
4-	88-95	7 mt	"
5-	105-115	10 mt	"
6-	130-145	15 mt	"

By Dr. R.A. Yadav
 Manager
 Ground Water
 U.P.J.N. LKO
 300 mmφ m.s. Housing pipe- 41.28 mt
 150 mmφ m.s. Plain pipe - 64.61 mt
 150 mmφ m.s. Slotted pipe - 29.98 mt
 300 x 150 mmφ m.s. Reducer - 00.20 mt
 150 mmφ m.s. Bail Plug - 3.48 mt
 Total 139.55 mt
 AGL 00.50 mt
 BGL 139.05 mt
 M/s. Harish Chandra Singh
 m/s Harish Chandra Singh Gorakhpur
 Manager

(D.K. Kanaujia) JE
 (S.K. Karmhar) AE
 (S.B. Prasad) EE