


Actual assembly chart of Belsar w/s scheme (T.W No -1) Gonda

under M.R.W.S.P

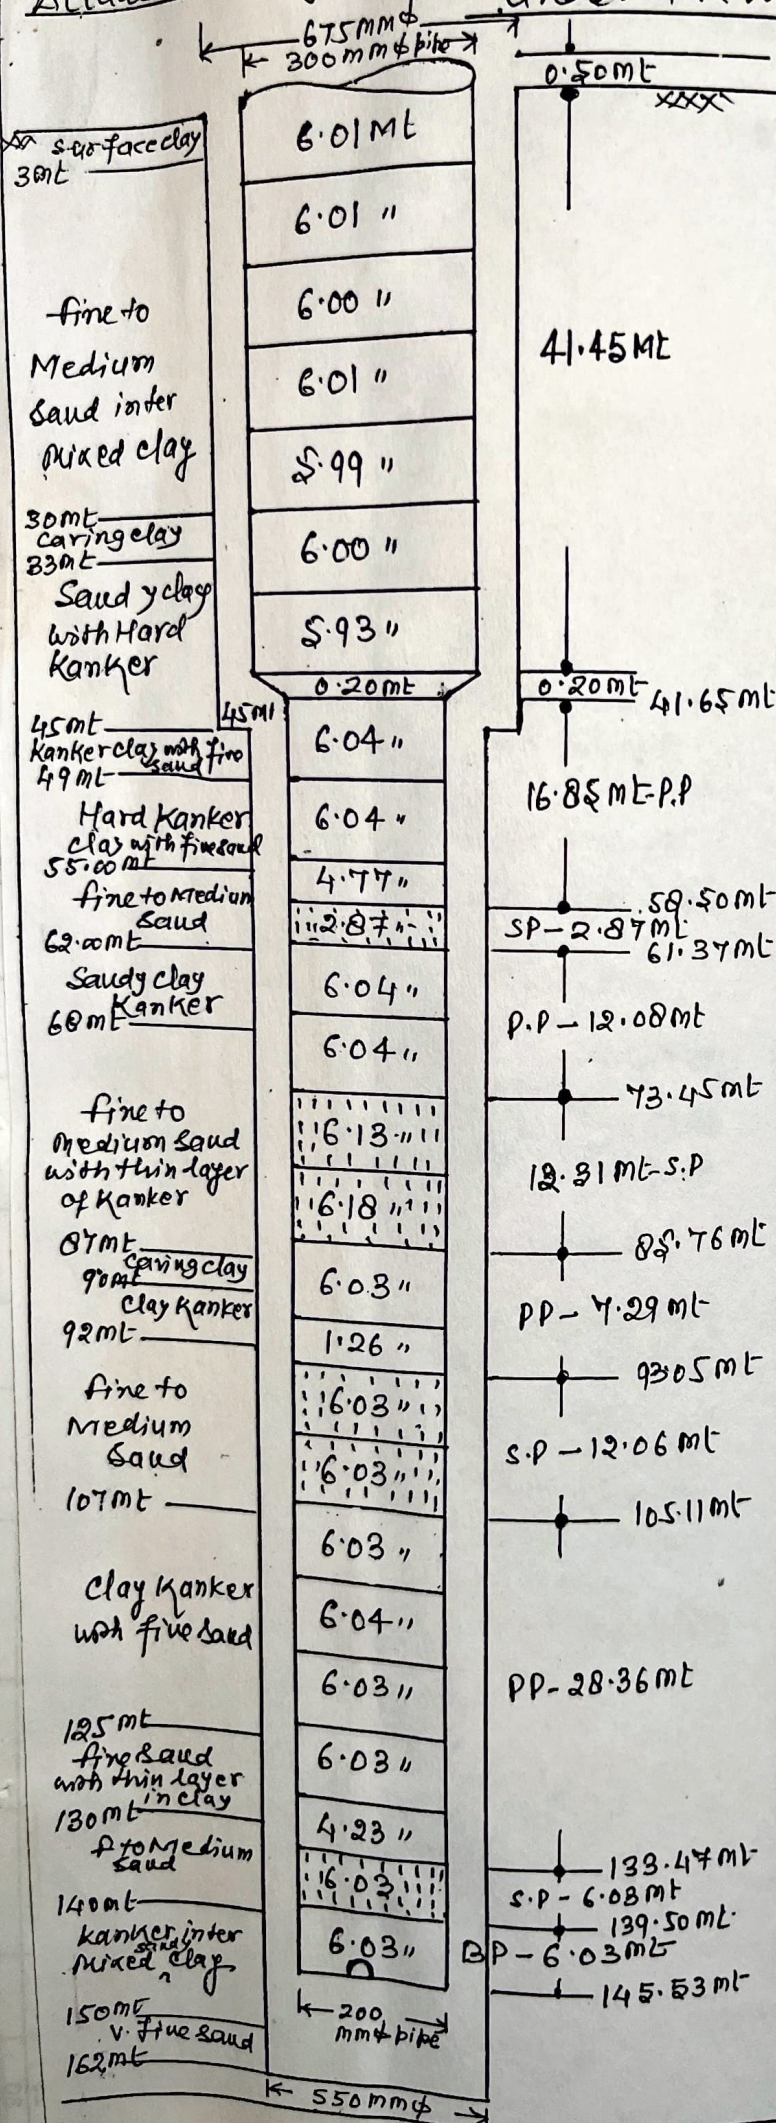

Required Discharge:- 1500 LPM
 Bore Size:- 675mm ϕ x 550mm ϕ
 Assembly size:- 300mm ϕ x 200mm ϕ
 Depth of bore:- 162mt
 Logging depth:- 160mt
 Date of Logging:- 25.1.014
 Depth of Lowering:- 145.53mt BGL
 Total Lowong:- 00.50mt AGL
 Dt of Lowong:- 3.2.014

SP NO	Depth range in mt	Thickness in mt	Result
1-	45-49	4.00	Good
2-	55-62	7.00	"
3-	68-87	19.00	"
4-	92-111	19.00	"
5-	125-140	15.00	"
6-	150-155	5.00	Good v. fine sand

by Dr. R.A. Yadav
 Manager
 Ground Water
 U.P. Jal Nigam
 Lko.

300mm ϕ m.s. Housing pipe - 41.95mt
 200mm ϕ m.s. Plain pipe - 64.58mt
 200mm ϕ m.s. Slotted pipe - 33.27mt
 300x200mm ϕ m.s. Reducer - 0.20mt
 200mm ϕ m.s. Ball Plug - 6.03mt
 Total 146.03mt
 AGL 00.50mt
 BGL 145.53mt

Prepared & Recommended by

m/s Shrinidhi Kulkarni

Recommended by

(D.K. Kanaujia) (S.K. Karndhar)
 JE AE

(S.B. Prasad)
 EE