


MEGHA ENGINEERING & INFRASTRUCTURE LIMITED

Actual Completion Plan of Tubewell Assembly Chart cum strata Chart For Gp. Pandrawan Block. Siddhaur water supply scheme, District- Barabanki.

(Not to Scale)

Detail of Strata

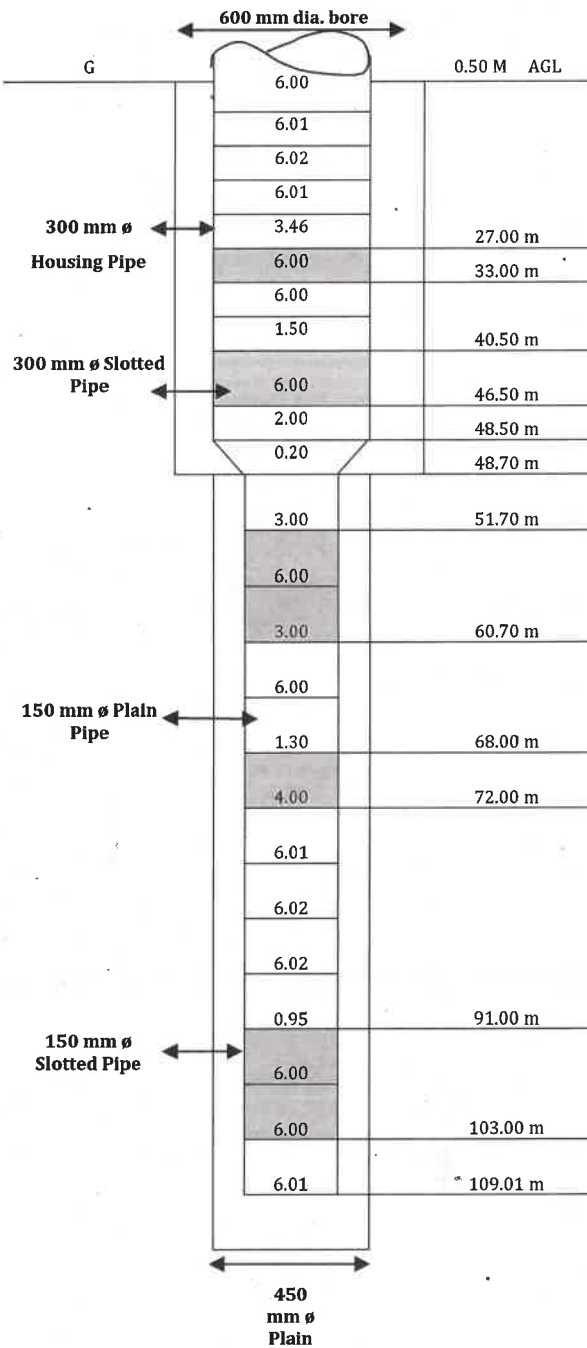

AGL + BGL
0.50 + 109.01 m = 109.51 mtr.

Detail of Lowering

Date- 22/04/2023

1	Drilling depth	165 mtr.
2	Drilling by contractor	D.C. Rig M/C
3	Total housing pipe dia 300 mm	37.00 mtr
4	Total Plain pipe dia 150 mm	35.31 mtr
5	Total Slotted pipe dia 300 mm	12.00 mtr
6	Total Slotted pipe dia 150 mm	25.00 mtr
7	Size of assembly lowering	300mmø x 150 mmø
8	200mmø x 150 mmø M.S. Reducer	0.20 mtr.
9	Discharge	1000 Lpm.

Detail of Strata

From (m)	To (m)	Thick (m)	Desperation of the Strata
0	10	10	Surface Clay
10	18	8	Sandy
18	27	7	Medium sand
27	33	10	Medium sand with Kankar
33	40	5	Sand with kankar
40	55	15	Medium sand
55	62	12	Medium sand
62	68	8	Medium Sand
68	72	10	Medium sand
72	91	17	Fine to Medium sand
91	103	6	Medium sand
103	125	20	Medium sand with Kankar
125	140	12	Medium sand with Kankar
140	155	15	Sand with kankar
155	165	10	Sand with kankar

Logging Report

Date: 17/04/2023

Sl. N.	Depth Range (mbgl)	Thickness (m)	Remark
1	27-33	06	Good
2	40-62	22	Good
3	68-72	04	Good
4	91-103	12	Good

M/s Megha Engg. Infr. Ltd.

E&M


Assistant Engineer
E&M

Executive Engineer
E&M

MEGHA ENGINEERING & INFRASTRUCTURE LIMITED

Proposed Completion Plan of Tubewell Assembly Chart cum strata Chart For Gp. Pandrawan Block. Siddhaur water supply scheme, District- Barabanki.

(Not to Scale)

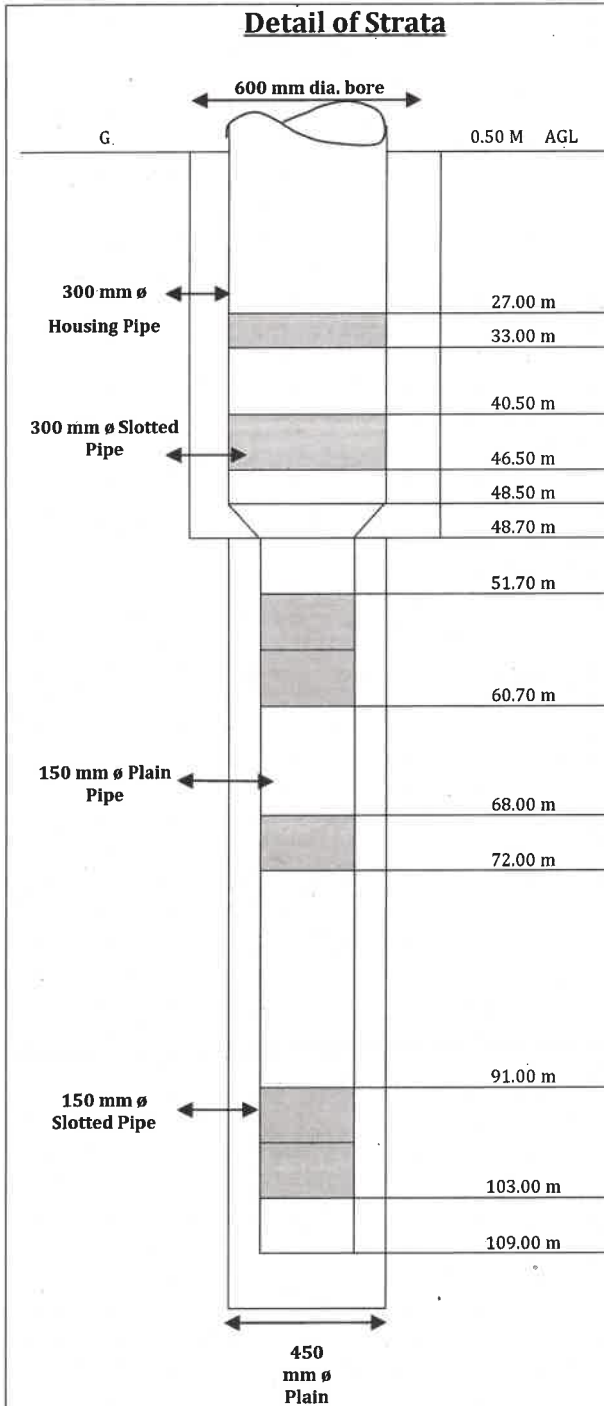

Detail of Lowering

Date- 22/04/2023

1	Drilling depth	165 mtr.
2	Drilling by contractor	D.C. Rig M/C
3	Total housing pipe dia 300 mm	37.00 mtr
4	Total Plain pipe dia 150 mm	35.30 mtr
5	Total Slotted pipe dia 300 mm	12.00 mtr
6	Total Slotted pipe dia 150 mm	25.00 mtr
7	Size of assembly lowering	300mmø x 150 mmø
8	200mmø x 150 mmø M.S. Reducer	0.20 mtr.
9	Discharge	1000 Lpm.

Detail of Strata

From (m)	To (m)	Thick (m)	Desperation of the Strata
0	10	10	Surface Clay
10	18	8	Sandy
18	27	7	Medium sand
27	33	10	Medium sand with Kankar
33	40	5	Sand with kankar
40	55	15	Medium sand
55	62	12	Medium sand
62	68	8	Medium Sand
68	72	10	Medium sand
72	91	17	Fine to Medium sand
91	103	6	Medium sand
103	125	20	Medium sand with Kankar
125	140	12	Medium sand with Kankar
140	155	15	Sand with kankar
155	165	10	Sand with kankar

Logging Report

Date: 17/04/2023

Sl. N.	Depth Range (mbgl)	Thickness (m)	Remark
1	27-33	06	Good
2	40-62	22	Good
3	68-72	04	Good
4	91-103	12	Good


M/s Megha Engg. Infr. Ltd.

E.E.
E&M

Assistant Engineer
E&M

Executive Engineer
E&M

proposed Tw Assembly chart of Padraawa w/s scheme block - Siddhaur distt.
Barabanki

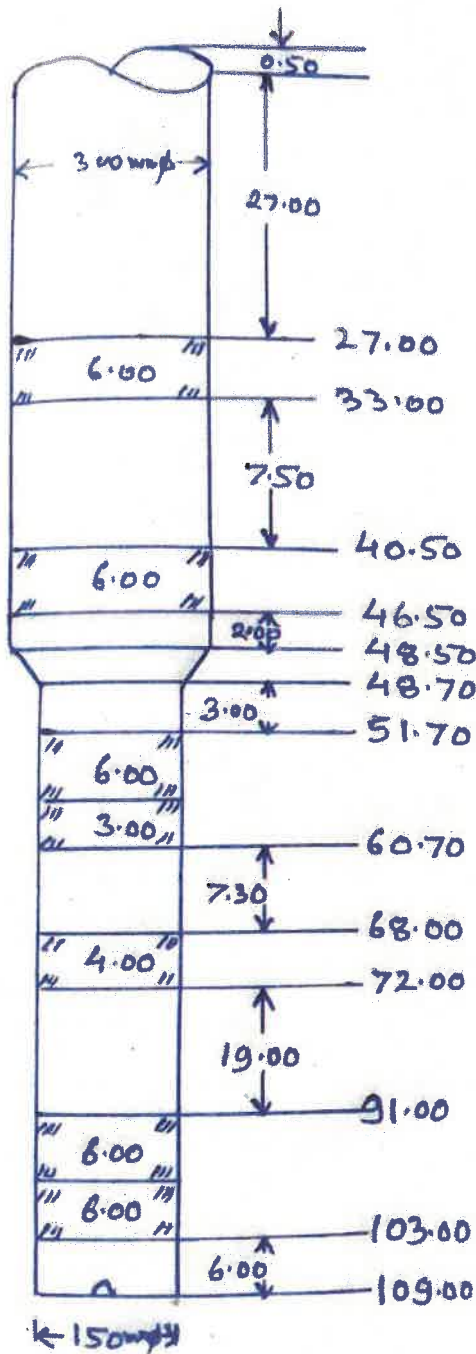

1. Discharge 1000 LPH
2. Motor HP 17.5 HP
3. Assembly size 300x15
4. Bore $\phi = 600 \times 45$
5. Logging Report dt-17-

- 1- 27-33=6
- 2- 40-62=22
- 3- 68-72=4
- 4- 91-103=12

formation of water is
below 110m to bgl to till
depth logged