


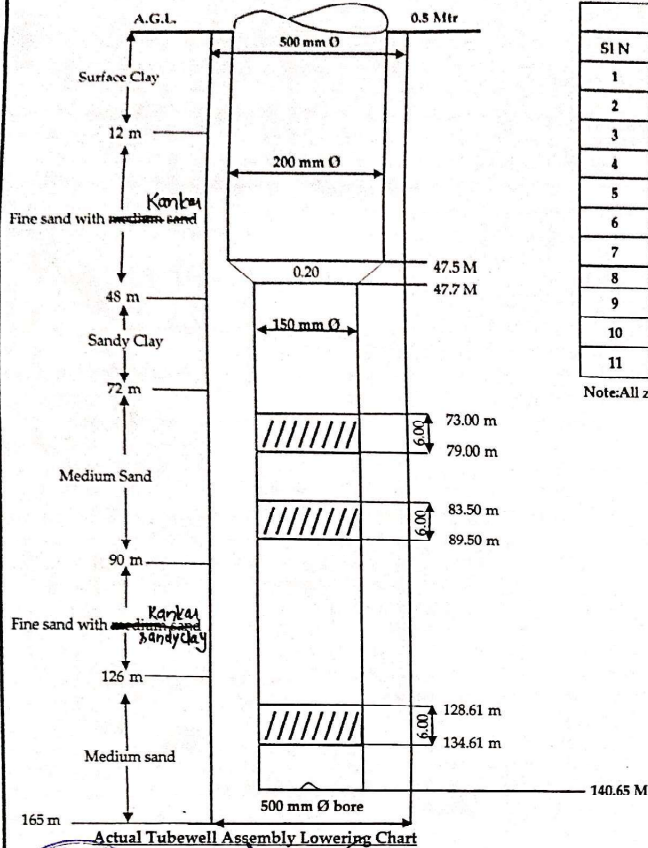

LOGGING REPORT			
S/N	Depth Range	Thickness(M)	Remarks
1	17 - 20	3	Good
2	28 - 34	6	Good
3	53 - 63	10	Good
4	73 - 79	6	Good
5	83 - 90	7	Good
6	93 - 97	4	Good
7	105 - 108	3	Good
8	119 - 123	4	Good
9	126 - 136	10	Good
10	139 - 143	4	Good
11	154 - 158	4	Good

Note: All zone are intermixed with kankar

1	District:-	Siddharthnagar
2	Block:-	KHUNTYAGON
3	Scheme Name:-	TURK VALIYA
4	Date of Logging:-	06.01.2025
5	Date of Lowering:-	10.01.2025
6	Size of Assembly:-	200 mm Ø X 150 mm Ø
7	Size of Bore:-	500 mm Ø X 500 mm Ø
8	Required Discharge:-	300 LPM
9	Logging By:-	Aqua Xplore

1	Housing Pipe:-	48.00 M
2	Plain Pipe	74.95 M
3	Slotted Pipe	18.00 M
4	Total Assembly Lowered :-	141.15 M

CLIENT:				
 STATE WATER SANITATION MISSION (NAMAMI GANGE & RURAL WATER SUPPLY SCHEME DEPARTMENT) GOVERNMENT OF UTTAR PRADESH				
PROJECT:- SIDDHARTH NAGAR GROUP OC VILLAGE WATER SUPPLY SCHEME				
 EPC CONTRACTOR: JAKSON - VISHVARAJ JV				
DRWN	NAME	SIGN	TITLE:	SCALE:
DSGN:-			ACTUAL TUBEWELL ASSEMBLY LOWERING DRAWING GP: TURK VALIYA WATER SUPPLY SCHEME	
CHKD :-				
DAPP :-				
DATE :-				SHEET NO. 1 OF 1
DRAWING NO.:-				SIZE A4